

THRHA Craig Senior Center Phase I

Craig, AK

PARTICIPANTS

CLIENT:
Tlingit-Haida Regional Housing Authority
5446 Jenkins Drive
Juneau, AK 99801
907.780.6868

ARCHITECT / CIVIL ENGINEER:
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
907.225.7917

MECHANICAL ENGINEER:
SPURLOCK & ASSOCIATES
3705 ARCTIC BLVD #1567
ANCHORAGE, AK 99503
907.344.8222

ELECTRICAL ENGINEER:
EIC Engineering
6927 Old Seward HWY, Suite 200
Anchorage, AK 99518
907.349.9712

CODE REVIEW

PROJECT LOCATION:
ADDRESS

IBC 2021 REVIEW

I. TYPE OF CONSTRUCTION (Chapter 6)

V-B
SPRINKLED - YES

II. USE & OCCUPANCY CLASSIFICATION (Chapter 3)

R-2

III. OCCUPANCY SEPARATIONS (Table 508.4)

1/2-Hr Separation Between Dwelling Units
1/2 Hr Separation Between Dwelling Units & Corridors
1 Hr Seoration Residential and Assembly

IV. BUILDING AREA (Table 503)

ALLOWED:
RESIDENTIAL: UL SQ, 4 Stories

PROPOSED: 1 STORY, 9613 SF

V. BUILDING HEIGHT (Table 503)

ALLOWED: 60'
PROPOSED: 19' - 3"

VI. OCCUPANT LOAD (Table 1004.1.2)

Residential	2272 GROSS SF / 200	12
Unoccupied	7092 GROSS SF / 300	24
	TOTAL OCCUPANT LOAD	36

ZONING REVIEW

CITY OF CRAIG TITLE 18 REVIEW

ZONING: RM - MEDIUM DENSITY RESIDENTIAL

LOT SIZE:

COVERAGE:
MAXIMUM: 50%
PROPOSED: 26.5%

BUILDING GROSS AREA: 9613 SF

BUILDING HEIGHT:
MAXIMUM: 30'
PROPOSED: 11' - 0"

SETBACKS:

MINIMUM: 10' FROM ALL LOT LINES
PROPOSED: SEE SITE PLAN

PARKING:

MINIMUM: 1 SPACE FOR EVERY 1-1/2 BEDROOMS
4 BEDROOMS / 1.5 = 3 SPACES MIN
PROPOSED: 3+

SHEET INDEX

GENERAL

G100 Cover Sheet
G101 Abbreviations & Symbols

CIVIL

C002 Legend
C100 Existing Conditions
C200 Civil Site Plan
C201 Utility Plan
C202 Parking Plan
D100 Details
D101 Details
D102 Details

ARCHITECTURAL

A001 Egress Plan
A002 Notes & Wall Types
A003 Schedules
A100 Site Plan
A200 Main Floor Plan
A201 Reflected Ceiling Plan
A202 Roof Plan
A203 Partial Floor Plans
A204 Enlarged Plans & Interior Elevations
A300 Sections
A301 Sections
A400 Elevations
A401 Elevations
A500 Wall Sections
A501 Wall Sections
A502 Wall Sections
A700 Details
A701 Details
A702 Interior Details
A703 Interior Details

STRUCTURAL

S100 Structural Notes
S200 Foundation Plan
S201 Main Floor Framing Plan
S202 Header & Shearwall Plan
S203 Roof Framing Plan
S300 Structural Details
S301 Structural Details

MECHANICAL

M101 Legends, Abbreviations & Schedules
M102 Mechanical Schedules
M200 Underfloor Plumbing Reference Plan
M201 Underfloor Plumbing Plan - Phase 1
M202 Plumbing Partial Plan - Phase 1
M301 HVAC Partial Plan Phase 1
M302 Overall HVAC Plan
M801 Mechanical Details

ELECTRICAL

E0.1 Legend and Specifications
E1.1 Electrical Site Plan
E2.1 Lighting Plan
E3.1 Power and Signal Plan
E4.1 Unit Electrical Plans & Schedules
E5.1 One-Line Diagrams, Details, & Schedules
E6.1 Panel Schedules



REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:

Cover Sheet

G100

SHEET:

01 of xx

ARCHITECTURAL ABBREVIATIONS

AB	ANCHOR BOLT
ABV	ABOVE
ACOUS	ACOUSTICAL
ACT	ACOUSTICAL CEILING TILE
AD	AREA DRAIN
ADDL	ADDITIONAL
ADJ	ADJUSTABLE
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AFS	ABOVE FINISHED SLAB
AL	ALUMINUM
ALT	ALTERNATE
AP	ACCESS PANEL
APPROX	APPROXIMATE(LY)
ARCH	ARCHITECT(URAL)
ASPH	ASPHALT
AUTO	AUTOMATIC
BD	BOARD
BKG	BACKING
BLDG	BUILDING
BLKG	BLOCKING
BLW	BELOW
BOT	BOTTOM
BRKT	BRACKET
BSMT	BASEMENT
BTW	BETWEEN
BURS	BUILT UP ROOFING SYSTEM
CAB	CABINET
CB	CATCH BASIN
CCTV	CLOSED CIRCUIT TELEVISION
CG	CORNER GUARD
CEM	CEMENT
CER	CERAMIC
CER TILE	CERAMIC TILE
CL	CENTERLINE
CLG	CEILING
CLJ	CONTROL JOINT
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
CNTR	COUNTER
CO	CASED OPENING
CONC	CONCRETE
CONF	CONFERENCE
CONN	CONNECTION
CONSTR	CONSTRUCTION
CONT	CONTINUOUS
CORR	CORRIDOR
CRPT	CARPET
CSWK	CASEWORK
CT	CARPET TILE
CUST	CUSTOM
CW	COLD WATER
DBL	DOUBLE
DEMO	DEMOLISH
DET	DETAIL
DF	DRINKING FOUNTAIN
DIA	DIAMETER
DIAG	DIAGONAL
DIFF	DIFFUSER
DIM	DIMENSION
DIM PT	DIMENSION POINT
DISP	DISPENSER
DIST	DISTANCE
DLV	DOOR LOUVER
DMPF	DAMP PROOFING
DN	DOWN
DR	DRAIN
DS	DOWNSPOUT
DT	DRAIN TILE
DWG	DRAWING
DWGS	DRAWINGS
DWR	DRAWER
(E)	EXISTING
E	EAST
EA	EACH
ECAB	ELECTRICAL CABINET
EG	EDGE GUARD
EIFS	EXTERIOR INSULATION FINISH SYSTEM
EL	ELEVATION
ELEC	ELECTRICAL
ELEV	ELEVATION
EMER	EMERGENCY
ENCL	ENCLOSURE
ENGR	ENGINEER
EO	ELECTRICAL OUTLET
EQL SP	EQUALLY SPACED
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
EXP	EXPANSION
EXPO	EXPOSED
EXIST	EXISTING
EXT	EXTERIOR


F/F	FACE TO FACE
F.F	FINISH FLOOR
FA	FIRE ALARM
FBD	FIBERBOARD
FD	FLOOR DRAIN
FDC	FIRE DEPARTMENT CONNECTION
FND	FOUNDATION
FDV	FIRE DEPARTMENT VALVE
FE	FIRE EXTINGUISHER
FEB	FIRE EXTINGUISHER BRACKET
FEC	FIRE EXTINGUISHER CABINET
FHY	FIRE HYDRANT
FIN	FINISH
FIN GR	FINISH GRADE
FL	FLOOR(ING)
FLASH	FLASHING
FLEX	FLEXIBLE
FLR SK	FLOOR SINK
FLUOR	FLUORESCENT
FNR	FEMININE NAPKIN RECEPTACLE
FNTD	FEMININE NAPKIN-TAMPON DISPENSER
FOC	FACE OF CONCRETE
FOF	FACE OF FINISH
FOM	FACE OF MASONARY
FOS	FACE OF STUD
FRPF	FIREPROOFING
FRZ	FREEZER
FSB	FOLDING SHOWER BENCH
FSTNR	FASTENER
FT	FOOT, FEET
FTG	FOOTING
FURN	FURNITURE
FURR	FURRING
FUS	FOLDING UTILITY SEAT
FUT	FUTURE
FXTR	FIXTURE
GA	GAUGE
GALV	GALVANIZED
GB	GRAB BAR
GC	GENERAL CONTRACTOR
GL	GLASS
GL BLK	GLASS BLOCK
GLULAM	GLUE LAMINATED
GLZ	GLAZING
GND	GROUND
GR	GRADE, GRADING
GRV	GRAVEL
GYP BD	GYP SUM BOARD
H	HIGH
HB	HOSE BIB
HC	HOLLOW CORE
HCP	HANDICAPPED
HD	HEAD
HDBD	HARDBOARD
HDWE	HARDWARE
HM	HOLLOW METAL
HNDRL	HANDRAIL
HR	HOUR
HT	HEIGHT
HVAC	HEATING, VENTILATION, AIR CONDITIONING, & COOLING
HW	HOT WATER
ID	INSIDE DIAMETER
INCAND	INCANDESCENT
INCL	INCLUDING
INFO	INFORMATION
INSUL	INSULATION
INT	INTERIOR
JAN	JANITOR
JB	JUNCTION BOX
JT	JOINT

KIT	KITCHEN
KPL	KICK PLATE
KS	KNEE SPACE
LAB	LABORATORY
LAM	LAMINATE
LAV	LAVATORY
LB	POUND
LF	LINEAR FOOT
LG	LENGTH
LH	LEFT HAND
LIN	LINEAR
LKR	LOCKER
LT	LIGHT
LT WT	LIGHT WEIGHT
LTG	LIGHTING

MACH	MACHINE
MAN	MANUAL
MATL	MATERIAL
MAX	MAXIMUM
MC	MEDICINE CABINET
MECH	MECHANICAL
MEMB	MEMBRANE
MET	METAL
MFR	MANUFACTURER
MH	MANHOLE
MIN	MINIMUM
MIR	MIRROR
MISC	MISCELLANEOUS
MOD	MODULAR
MTD	MOUNTED
MTG	MOUNTING
MULL	MULLION
(N)	NEW
N	NORTH
NA	NOT APPLICABLE
NAT	NATURAL
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NRC	NOISE REDUCTION COEFFICIENT
NTS	NOT TO SCALE
OA	OVERALL
OC	ON CENTER
OD	OUTSIDE DIAMETER
OFCl	OWNER FURNISHED-CONTRACTOR INSTALLED
OFCl	OWNER FURNISHED-OWNER INSTALLED
OH	OPPOSITE HAND
OPNG	OPENING
OPP	OPPOSITE
OVHD	OVERHEAD
PBD	PARTICLE BOARD
PCF	POUNDS PER CUBIC FOOT
PERF	PERFORATED
PERIM	PERIMETER
PERM	PERMANENT
PERP	PERPENDICULAR
PH	PANIC HARDWARE
PL	PROPERTY LINE
PLAM	PLASTIC LAMINATE
PLAT	PLATFORM
PLBG	PLUMBING
PLF	POUNDS PER LINEAL FOOT
PLYWD	PLYWOOD
PNL	PANEL
PREFAB	PREFABRICATED
PRKG	PARKING
PROJ	PROJECT
PROP	PROPERTY
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PT	POINT
PTD	PAPER TOWEL DISPENSER
PTD/R	PAPER TOWEL DISPENSER W/ RECEPTACLE
PTR	PAPER TOWEL RECEPTACLE
PVMT	PAVEMENT
PWR	POWER
QT	QUARRY TILE
QTR	QUARTER
QTY	QUANTITY
R	RISER
RA	RETURN AIR
RAD	RADIUS
RCP	REFLECTED CEILING PLAN
RD	ROOF DRAIN
REF	REFRIGERATOR
REINF	REINFORCED
REQD	REQUIRED
RESIL	RESILIENT
RET	RETURN
REV	REVISION
RH	RIGHT HAND
RM	ROOM
RO	ROUGH OPENING
ROW	RIGHT OF WAY
S	SOUTH
SA	SUPPLY AIR
SASU	SELF-ADHERING SHEET UNDERLAYMENT
SB	SPLASH BLOCK
SC	SOLID CORE
SCD	SEAT COVER DISPENSER
SCHED	SCHEDULED
SCR	SHOWER CURTAIN ROD
SD	SOAP DISPENSER
SECT	SECTION
SEP	SEPARATION
SF	SQUARE FOOT

SHR	SHOWER
SHT	SHEET(ING)
SHV	SHELVES, SHELVING
SIM	SIMILAR
SK	SINK
SP	SPACE, SPACING
SPEC	SPECIFICATION
SPKLR	SPRINKLER
SPKR	SPEAKER
SQ	SQUARE
SQ IN	SQUARE INCH
SST	STAINLESS STEEL
ST	STREET
STAG	STAGGERED
STD	STANDARD
STL	STEEL
STOR	STORAGE
STRUCT	STRUCTURAL
SUSP CLG	SUSPENDED CEILING
SERV	SERVICE
SYM	SYMBOL
T	TREAD
T&B	TOP & BOTTOM
T&G	TONGUE & GROOVE
TB	TOWEL BAR
TEL	TELEPHONE
TEMP	TEMPORARY
THERM	THERMAL
THK	THICK, THICKNESS
THRES	THRESHOLD
THRU	THROUGH
TOL	TOLERANCE
TYP	TYPICAL
UC	UNDER COUNTER
UNFIN	UNFINISHED
UON	UNLESS OTHERWISE NOTED
UR	URINAL
UTIL	UTILITY
VAC	VACUUM
VB	VINYL BASE
VCT	VINYL COMPOSITION TILE
VERT	VERTICAL
VEST	VESTIBULE
VF	VERIFY IN FIELD
VNR	VENEER
VOL	VOLUME
VWC	VINYL WALL COVERING
W	WEST
W/	WITH
W/O	WITHOUT
W/W	WALL TO WALL
WC	WATER CLOSET
WD	WOOD
WDW	WINDOW
WF	WIDE FLANGE
WHCH	WHEEL CHAIR
WO	WHERE OCCURS
WR	WATER RESISTANT
WSCT	WAINSCOTING
WT	WEIGHT
WTRPRF	WATERPROOFING
WWF	WELDED WIRE FABRIC
XFMR	TRANSFORMER

DRAWING SYMBOLS

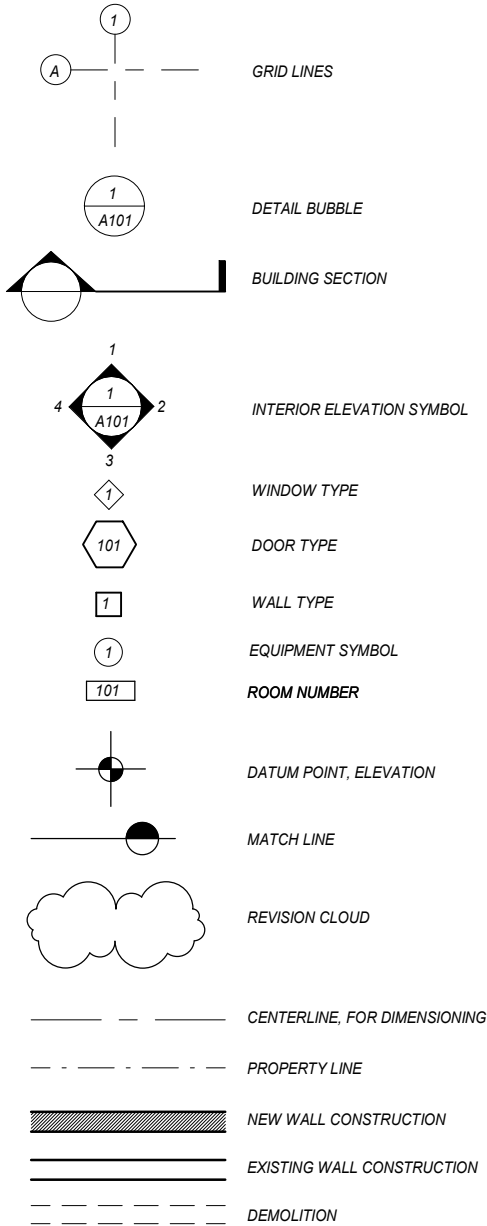

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:

Abbreviations & Symbols

G101

SHEET:

02 of xx

GENERAL NOTES

HORIZONTAL DATA:

1) THE HORIZONTAL CONTROL IN THIS DRAWING ARE LOCAL GRID COORDINATES AT GROUND. THE BASIS OF BEARING IS GPS DELIVERED.

VERTICAL DATA:

1) ELEVATIONS DETERMINED ON THIS PROJECT HAVE BEEN ADJUSTED TO MEAN LOWER LOW WATER FOR CRAIG.

GENERAL NOTES:

- 1) ALL UTILITIES SHOWN WERE LOCATED FROM SURFACE EVIDENCE AND ASBUILT RECORDS BY THE CITY OF CRAIG.
- 2) THE PROPERTY LINES SHOWN ON THIS SURVEY CONSTITUTE A COMPLETE BOUNDARY RESOLUTION.
- 3) WATER DISTRIBUTION SYSTEM CONSTRUCTION SHALL BE ACCORDANCE WITH THESE PLANS, THE CITY OF CRAIG STANDARD SPECIFICATIONS, AND ADEC REGULATIONS AS CONTAINED IN 18-AAC-80, DRINKING WATER.
- 4) ALL TRENCHING, COMPACTION, AND AGGREGATES SHALL BE COMPLETED IN ACCORDANCE WITH THE CITY OF CRAIG STANDARD SPECIFICATIONS (DIVISION 20) UNLESS OTHERWISE NOTED.
- 5) WASTEWATER SYSTEM CONSTRUCTION SHALL BE IN ACCORDANCE WITH THESE PLANS, THE CITY OF CRAIG STANDARD SPECIFICATIONS AND ADEC REGULATIONS AS CONTAINED IN 18-AAC-72, WASTEWATER DISPOSAL.
- 6) MAINTAIN MINIMUM 10 FOOT HORIZONTAL, AND 18 INCH VERTICAL SEPARATION BETWEEN SEWER AND WATER MAIN LINES AT ANY POINT UNLESS OTHERWISE NOTED IN PLANS.
- 7) WATER MAINS SHALL CROSS OVER THE TOP OF SEWER MAINS WITH 18 INCHES OF SEPARATION BETWEEN OUTSIDE EDGES OF THE PIPES. THE WATER LINE JOINTS SHALL BE AT LEAST 9 FEET FROM THE SEWER JOINTS. SEE DETAILS.
- 8) WATER PIPE SHALL BE 4710 RESIN SDR11 HDPE PIPE.
- 9) GRAVITY SEWER MAINS AND SERVICES SHALL BE C900 PVC PIPE.
- 10) ALL PRESSURE SEWER MAINS AND LATERALS SHALL BE 4710 RESIN SDR11 HDPE PIPE.
- 11) DO NOT CHANGE UTILITY DESIGN, LINE, GRADE, SIZE, MATERIALS, ETC. WITHOUT APPROVAL FROM THE DESIGN ENGINEER OR THE CITY OF CRAIG.
- 12) THE WATER LINE DESIGN IS BASED ON HDPE PIPE WITH AN ALLOWABLE BENDING RADIUS = 10-D. THE CONTRACTOR SHALL SUBMIT ALIGNMENT SHOP DRAWINGS IF SELECTED HDPE PIPE MANUFACTURER'S ALLOWABLE BENDING RADIUS IS GREATER.
- 13) MAINTAIN 5' MINIMUM COVER ON WATER MAINS AND 5' MINIMUM COVER OVER SANITARY SEWER FORCE MAINS AND PRESSURE LATERALS.
- 14) SEWER PIPE ELEVATIONS ARE TO INVERT OF PIPE
- 15) SEWER PIPE SLOPES ARE CALCULATED FROM FACE OF MANHOLE
- 16) SUBMITTALS – THE CONTRACTOR SHALL SUBMIT DATA SHEETS FOR ALL CONSTRUCTION MATERIALS TO THE CRAIG PUBLIC WORKS DEPARTMENT AND OBTAIN WRITTEN APPROVAL FOR THE CONSTRUCTION MATERIALS PRIOR TO PURCHASING AND INSTALLING THEM. THE CONSTRUCTION MATERIALS INCLUDE BUT ARE NOT LIMITED TO ALL PIPE, FITTINGS, VALVES, CURB STOPS, CORPORATION STOPS, TAPPING SADDLES, MANHOLES, FRAMES & LIDS, CLEANOUTS, AND HYDRANTS.

LEGEND

FEATURE DESCRIPTION	EXISTING	PROPOSED
PROPERTY LINE		N/A
PROPERTY LINE (INFORMATIONAL)		N/A
CENTERLINE		
CONCRETE		
ASPHALT		
BUILDING LINE		
BUILDING OVERHANG		AS NOTED
EDGE OF ASPHALT/CONCRETE		(PATCH)
EDGE OF GRAVEL		N/A
TOP/TOE/DITCH (GENERAL)		
OVERHEAD UTILITY LINE		N/A
UNDERGROUDN UTILITY LINE		N/A
STORM DRAIN		
SEWER LINE		
SEWER LINE (RECORD)		N/A
SANITARY SEWER PRESSURE LINE		
SEWER SERVICE	N/A	
WATER LINE		
WATER SERVICE	N/A	
WATER LINE (RECORD)		N/A
RAW SALTWATER LINE		N/A
FUEL/GAS LINE		N/A
FENCE		
GUARD RAIL		N/A
MAJOR CONTOUR		
MINOR CONTOUR		
POSSIBLE UNKNOWN LINE DETECTED BY GPR		N/A

NOTE: LINE WEIGHTS VARY BETWEEN SHEETS

FEATURE DESCRIPTION	EXISTING	PROPOSED
UTILITY POLE		
GUY ANCHOR		N/A
CONTROL POINT (AS NOTED)		N/A
FOUND MONUMENT (AS NOTED)		N/A
STORM DRAIN MANHOLE		
STORM CATCH BASIN		
STORM CLEANOUT		
SANITARY SEWER MANHOLE		
SANITARY SEWER CLEANOUT		
BOLLARD/POST (TYPE AS NOTED)		
WATER VALVE		
FIRE HYDRANT		
LIGHT POLE		N/A
ELECTRICAL METER		N/A
SIGN		N/A
TEST PIT		N/A
ROCK WALL		

				Designed: TSS	Approved:	Scale: AS_NOTED	
				Drawn: TSS	Date: 2/8/2024	Project: 222321.02	R&M ENGINEERING-KETCHIKAN, INC. 7180 REVILLA ROAD, SUITE 300 KETCHIKAN, ALASKA 99901 AELC 576
Date	No.	Description	By	Checked: TSS	DO NOT SCALE FROM THESE PLANS – USE DIMENSIONS ONLY		
Revision							


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER

Sheet Description: LEGEND

Sheet No. C002



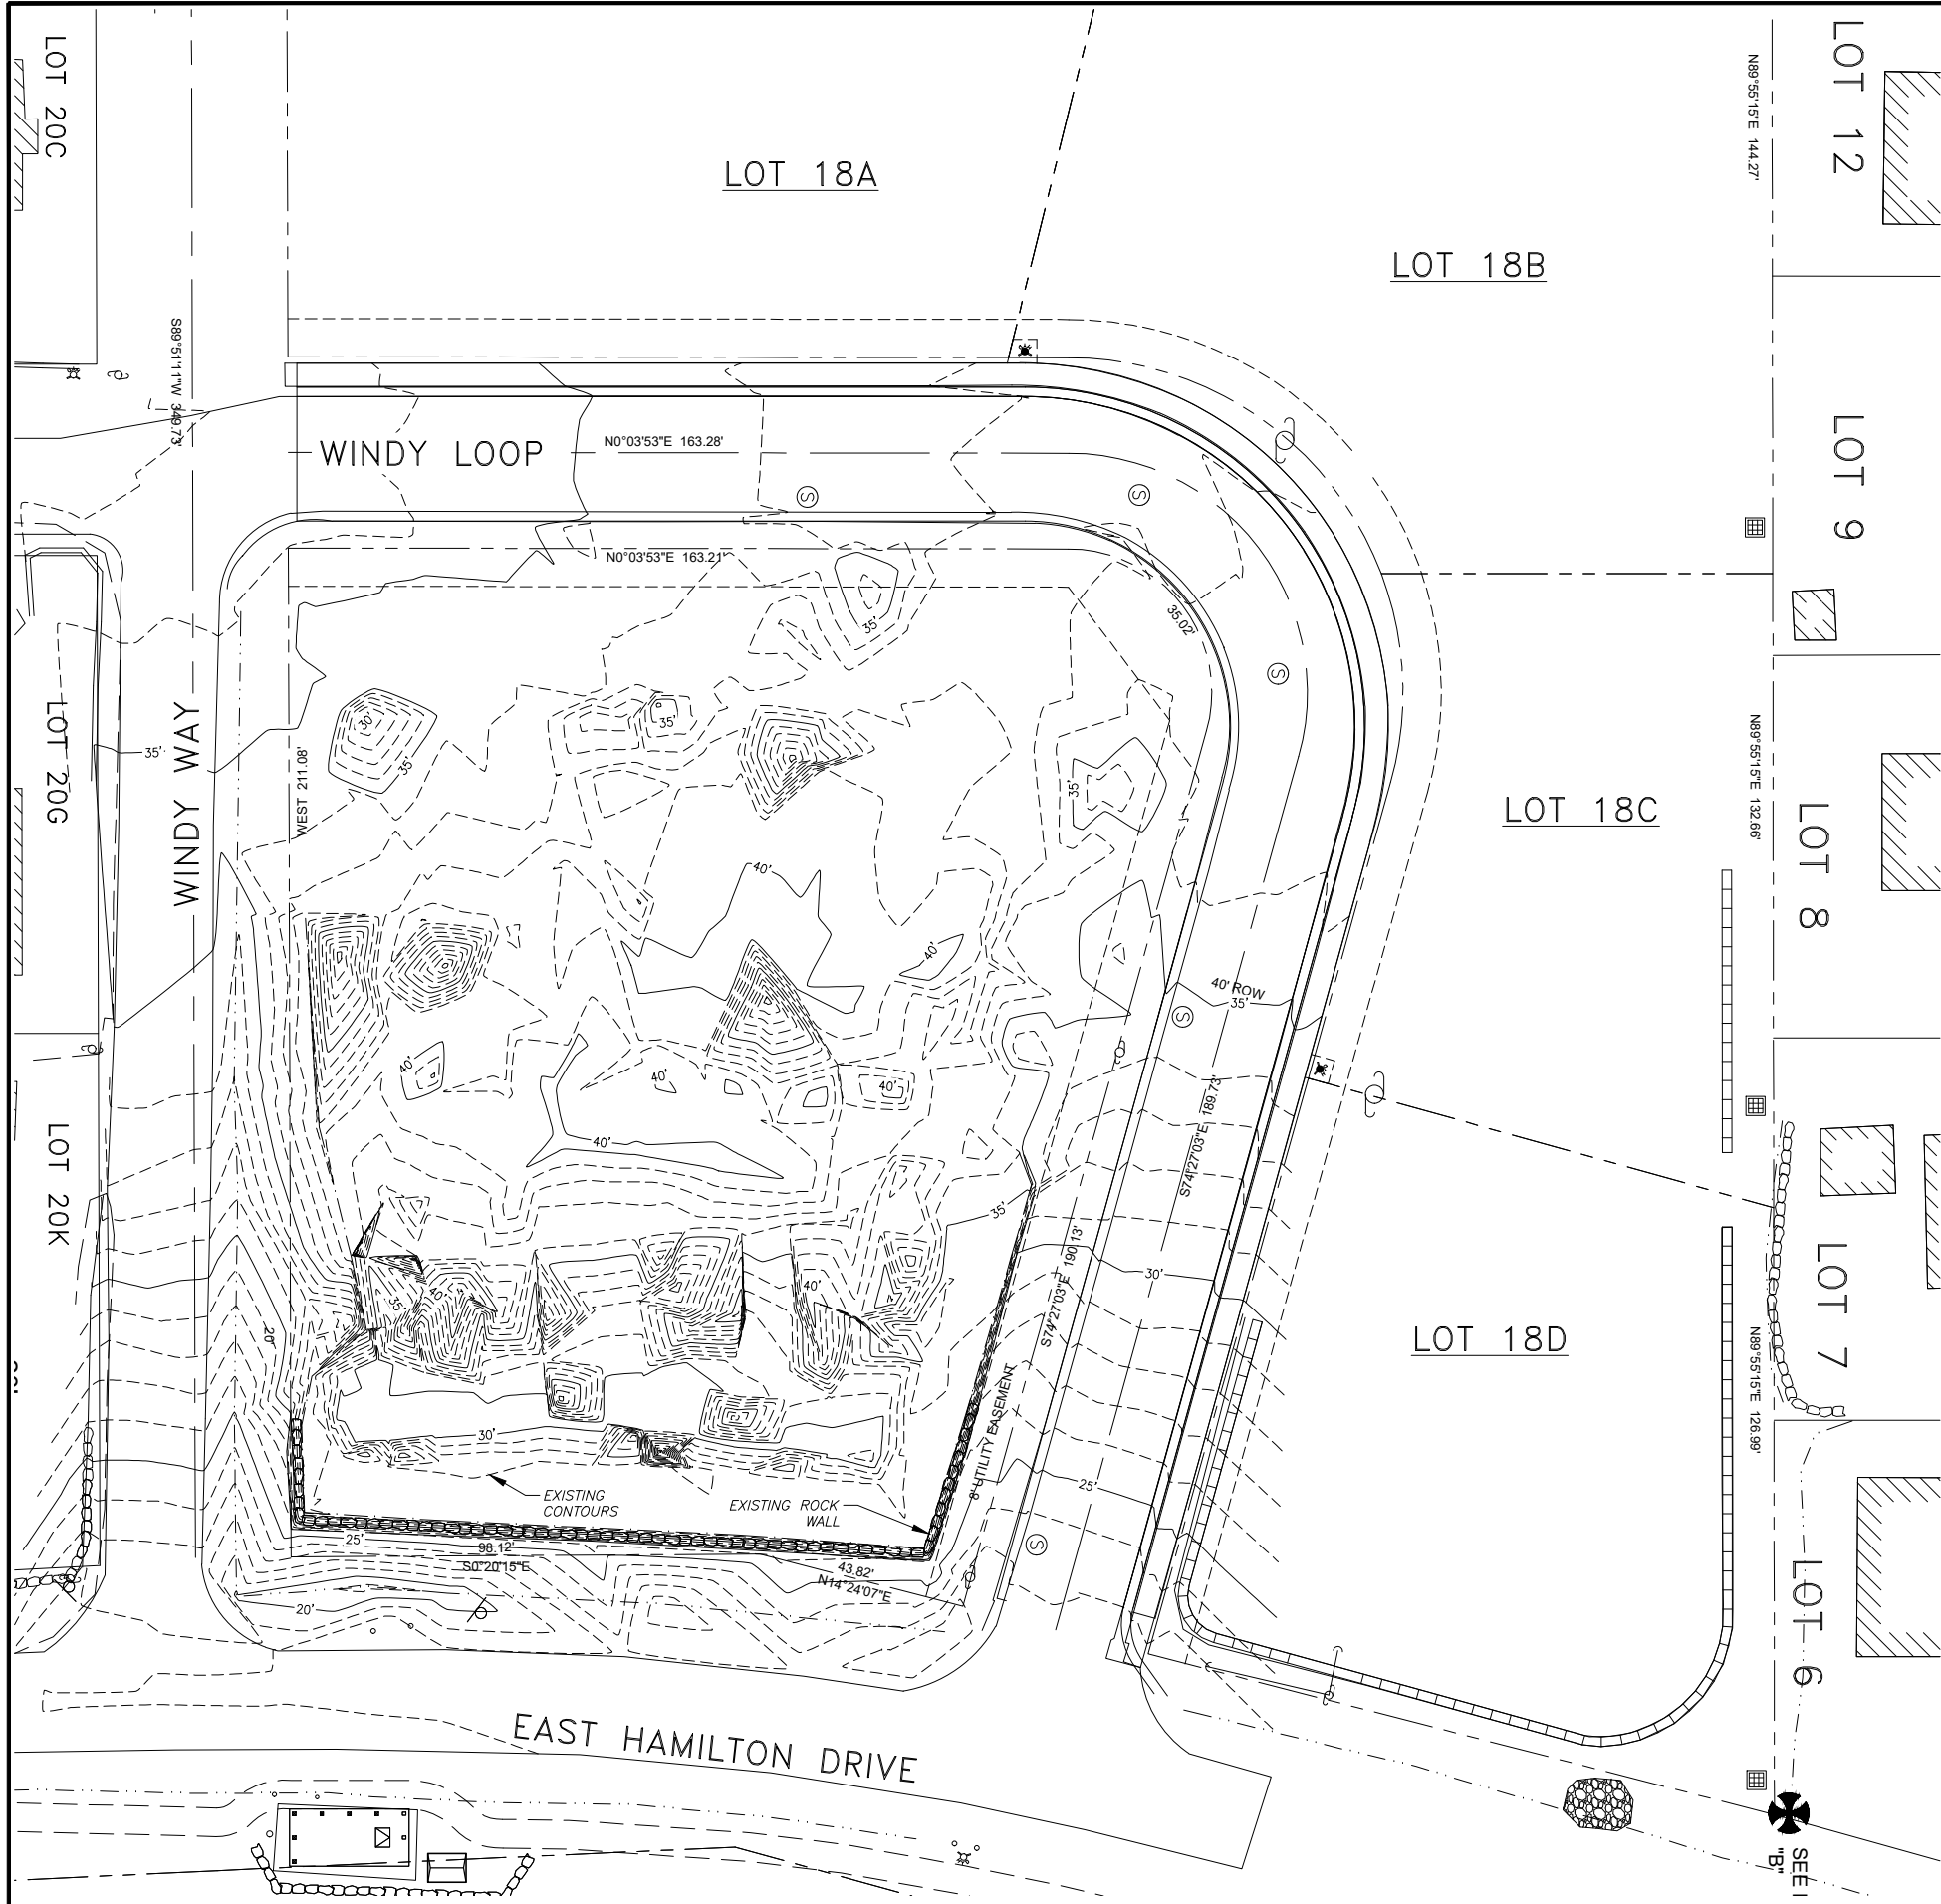


SCALE 1"=20'

THIS DRAWING MAY BE REDUCED, VERIFY SCALE BEFORE USING

0 10 20 40 60 80 FEET
0 5 10 15 20 25 METERS

1 METER = 3.2808333 U.S. SURVEY FEET
1 U.S. ACRE = 0.4047 HECTARES



					Designed: TSS	Approved:	Scale: AS_NOTED	
					Drawn: TSS	Date: 2/8/2024	Project: 222321.02	
					Checked: TSS	DO NOT SCALE FROM THESE PLANS – USE DIMENSIONS ONLY		
Date	No.	Description		By				
		Revision						R&M ENGINEERING–KETCHIKAN, INC. 7180 REVILLA ROAD, SUITE 300 KETCHIKAN, ALASKA 99901 AELC 576

R&M

R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901 AELC 576


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER

Sheet Description: EXISTING CONDITIONS

Sheet No. C100



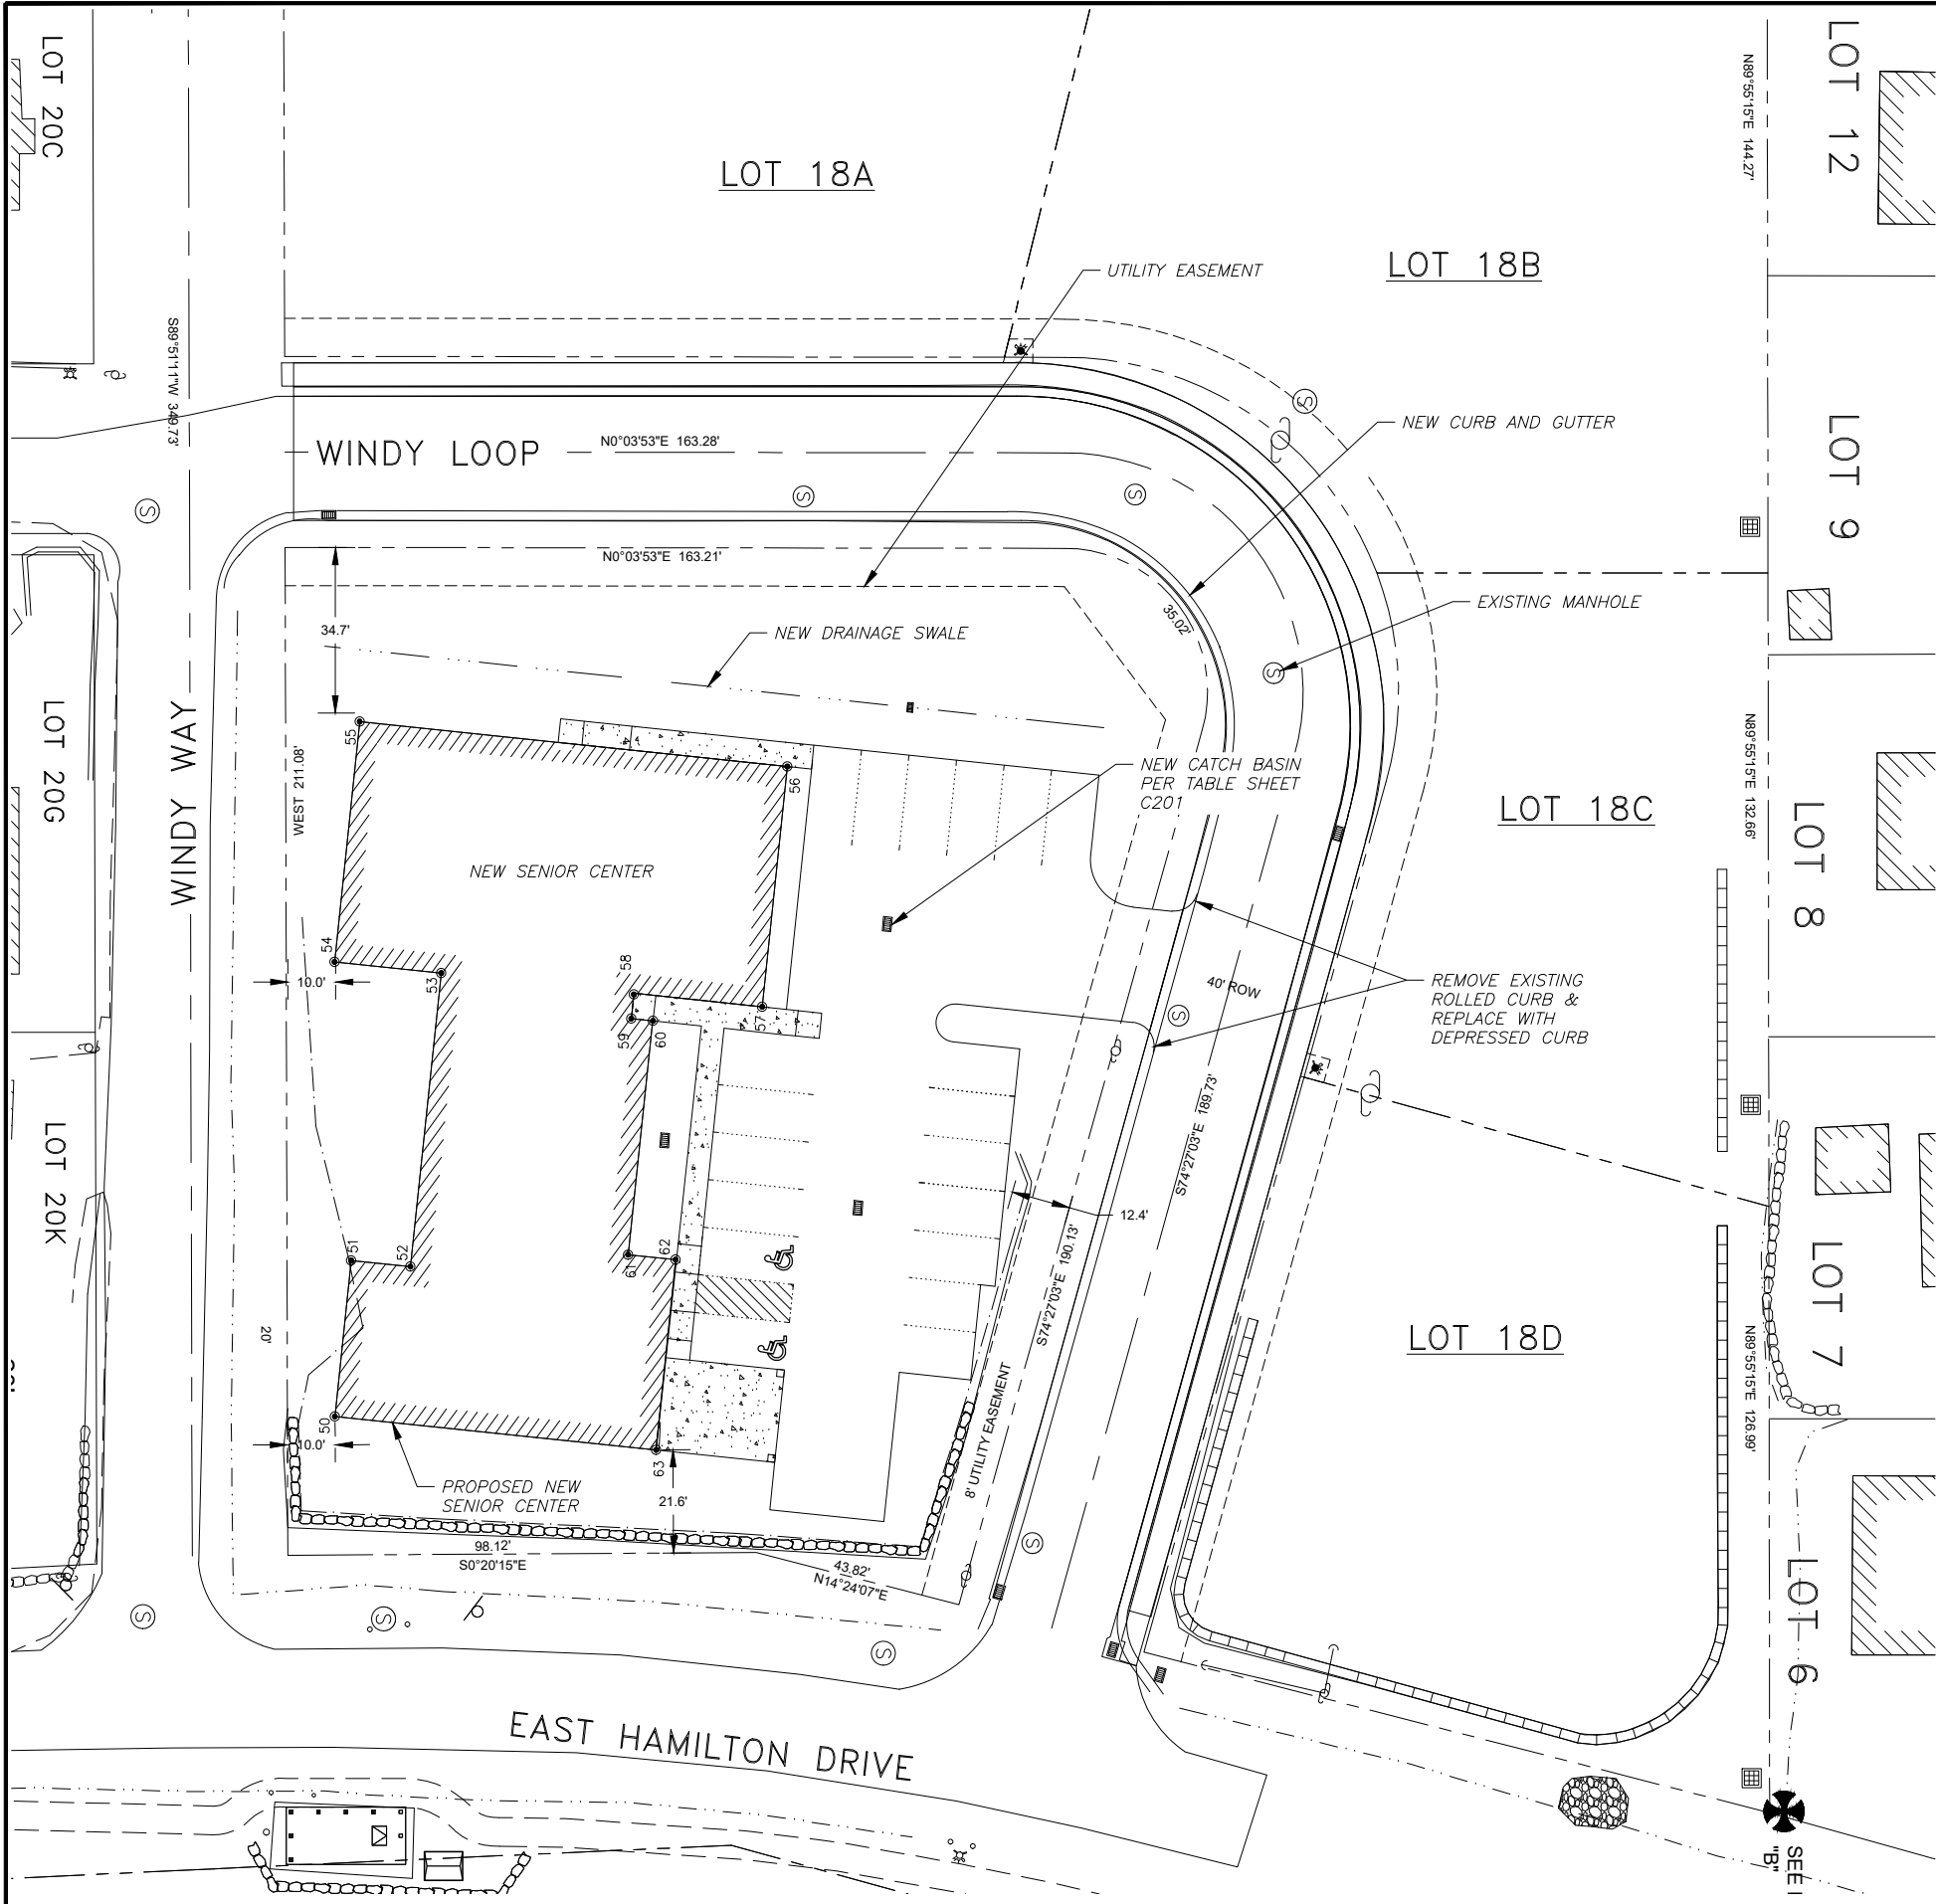

SCALE 1"=20'

THIS DRAWING MAY BE REDUCED, VERIFY SCALE BEFORE USING


0 10 20 40 60 80 FEET

0 5 10 15 20 25 METERS

1 METER = 3.2808333 U.S. SURVEY FEET
1 U.S. ACRE = 0.4047 HECTARES



BUILDING LAYOUT TABLE				
Point #	Northing	Easting	Elevation	Description
50	49382.17	11902.29	35.93	BUILDING CORNER
51	49385.59	11869.63	35.93	BUILDING LAYOUT
52	49398.02	11870.93	35.93	BUILDING LAYOUT
53	49404.46	11809.44	35.93	BUILDING LAYOUT
54	49382.10	11807.10	35.93	BUILDING LAYOUT
55	49387.36	11756.79	35.93	BUILDING LAYOUT
56	49476.94	11766.17	35.93	BUILDING LAYOUT
57	49471.67	11816.47	35.93	BUILDING LAYOUT
58	49444.79	11813.93	35.93	BUILDING LAYOUT
59	49444.26	11818.94	35.93	BUILDING LAYOUT
60	49448.82	11819.45	35.93	BUILDING LAYOUT
61	49443.61	11868.42	35.93	BUILDING LAYOUT
62	49453.56	11869.46	35.93	BUILDING LAYOUT
63	49449.47	11909.29	35.93	BUILDING LAYOUT

				Designed: TSS	Approved:	Scale: AS_NOTED	
				Drawn: TSS	Date: 2/8/2024	Project: 222321.02	
Date	No.	Description	By	Checked: TSS	DO NOT SCALE FROM THESE PLANS – USE DIMENSIONS ONLY		R&M ENGINEERING–KETCHIKAN, INC. 7180 REVILLA ROAD, SUITE 300 KETCHIKAN, ALASKA 99901 AELC 576
		Revision					

R&M

R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901 AELC 576


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER

Sheet Description: SITE PLAN

Sheet No. C200



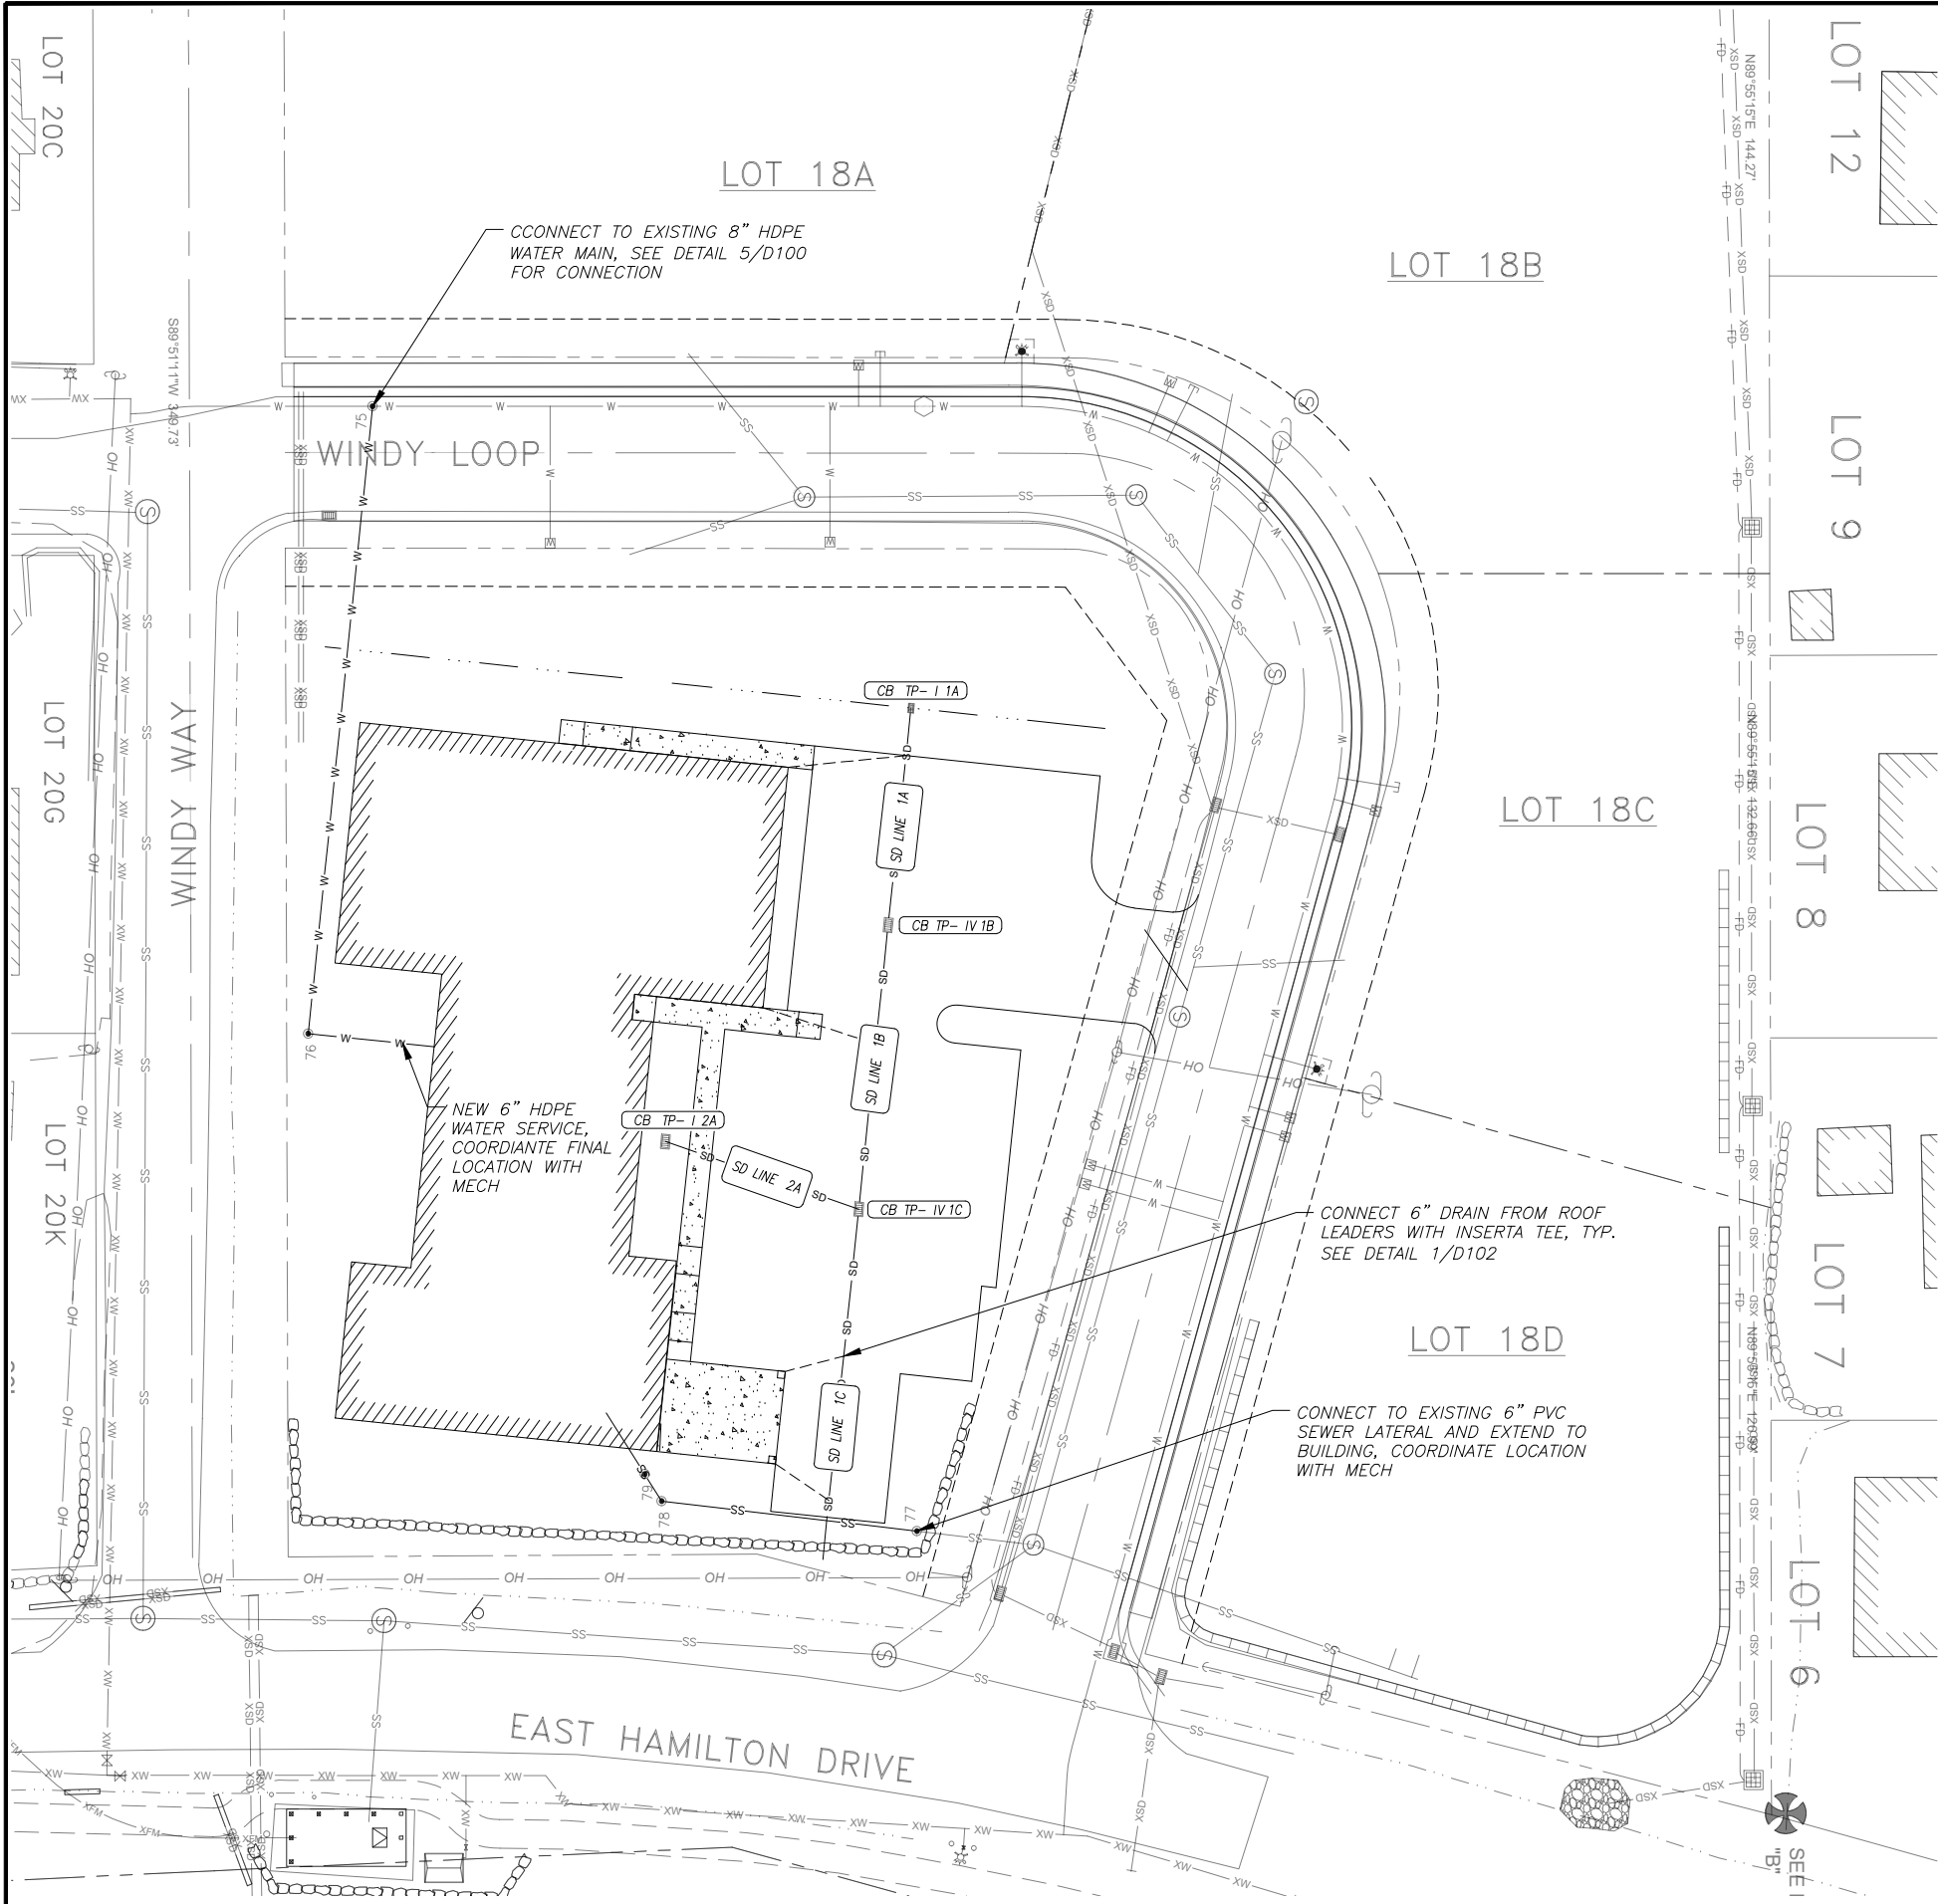

SCALE 1"=20'

THIS DRAWING MAY BE REDUCED, VERIFY SCALE BEFORE USING

0 10 20 40 60 80 FEET
0 5 10 15 20 25 METERS

1 METER = 3.2808333 U.S. SURVEY FEET
1 U.S. ACRE = 0.4047 HECTARES




STORM DRAIN TABLE

	CONNECT TO EXISTING CB IE = MATCH EXISTING
SD LINE 1A INSTALL: 44 LF 8" CPP S=0.01±	CB TP- 1 1A INSTALL TYPE IV CB RIM=34.5 IE =33.5
SD LINE 1B INSTALL: 57 LF 12" CPP S=0.01±	CB TP- IV 1B INSTALL TYPE IV CB RIM=34.5 IE =32.9
SD LINE 2A INSTALL: 43 LF 12" CPP S=0.01±	CB TP- IV 1C INSTALL TYPE IV CB RIM=34.5 IE =32
SD LINE 1C INSTALL: 73 LF 8" CPP S=0.08±	CB TP- 1 2A INSTALL TYPE IV CB RIM=35.0 IE =33.9

UTILITY LAYOUT TABLE

Point #	Northing	Easting	Elevation	Description
75	49390.00	11690.64	29.50	CONNECT TO EXISTING
76	49376.54	11821.88	0.00	6" DIA. 90° BEND
77	49503.89	11925.97	0.00	CONNECT TO EXISTING
78	49450.48	11919.68	0.00	45° BEND
79	49446.93	11914.05	0.00	CLEANOUT 5' FROM BUILDING WALL

					Designed: TSS	Approved:	Scale: AS_NOTED	
					Drawn: TSS	Date: 2/8/2024	Project: 222321.02	
					Checked: TSS	DO NOT SCALE FROM THESE PLANS – USE DIMENSIONS ONLY		
Date	No.	Description Revision		By	R&M ENGINEERING–KETCHIKAN, INC. 7180 REVILLA ROAD, SUITE 300 KETCHIKAN, ALASKA 99901 AELC 576			


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER

Sheet Description: UTILITY PLAN

Sheet No. C201



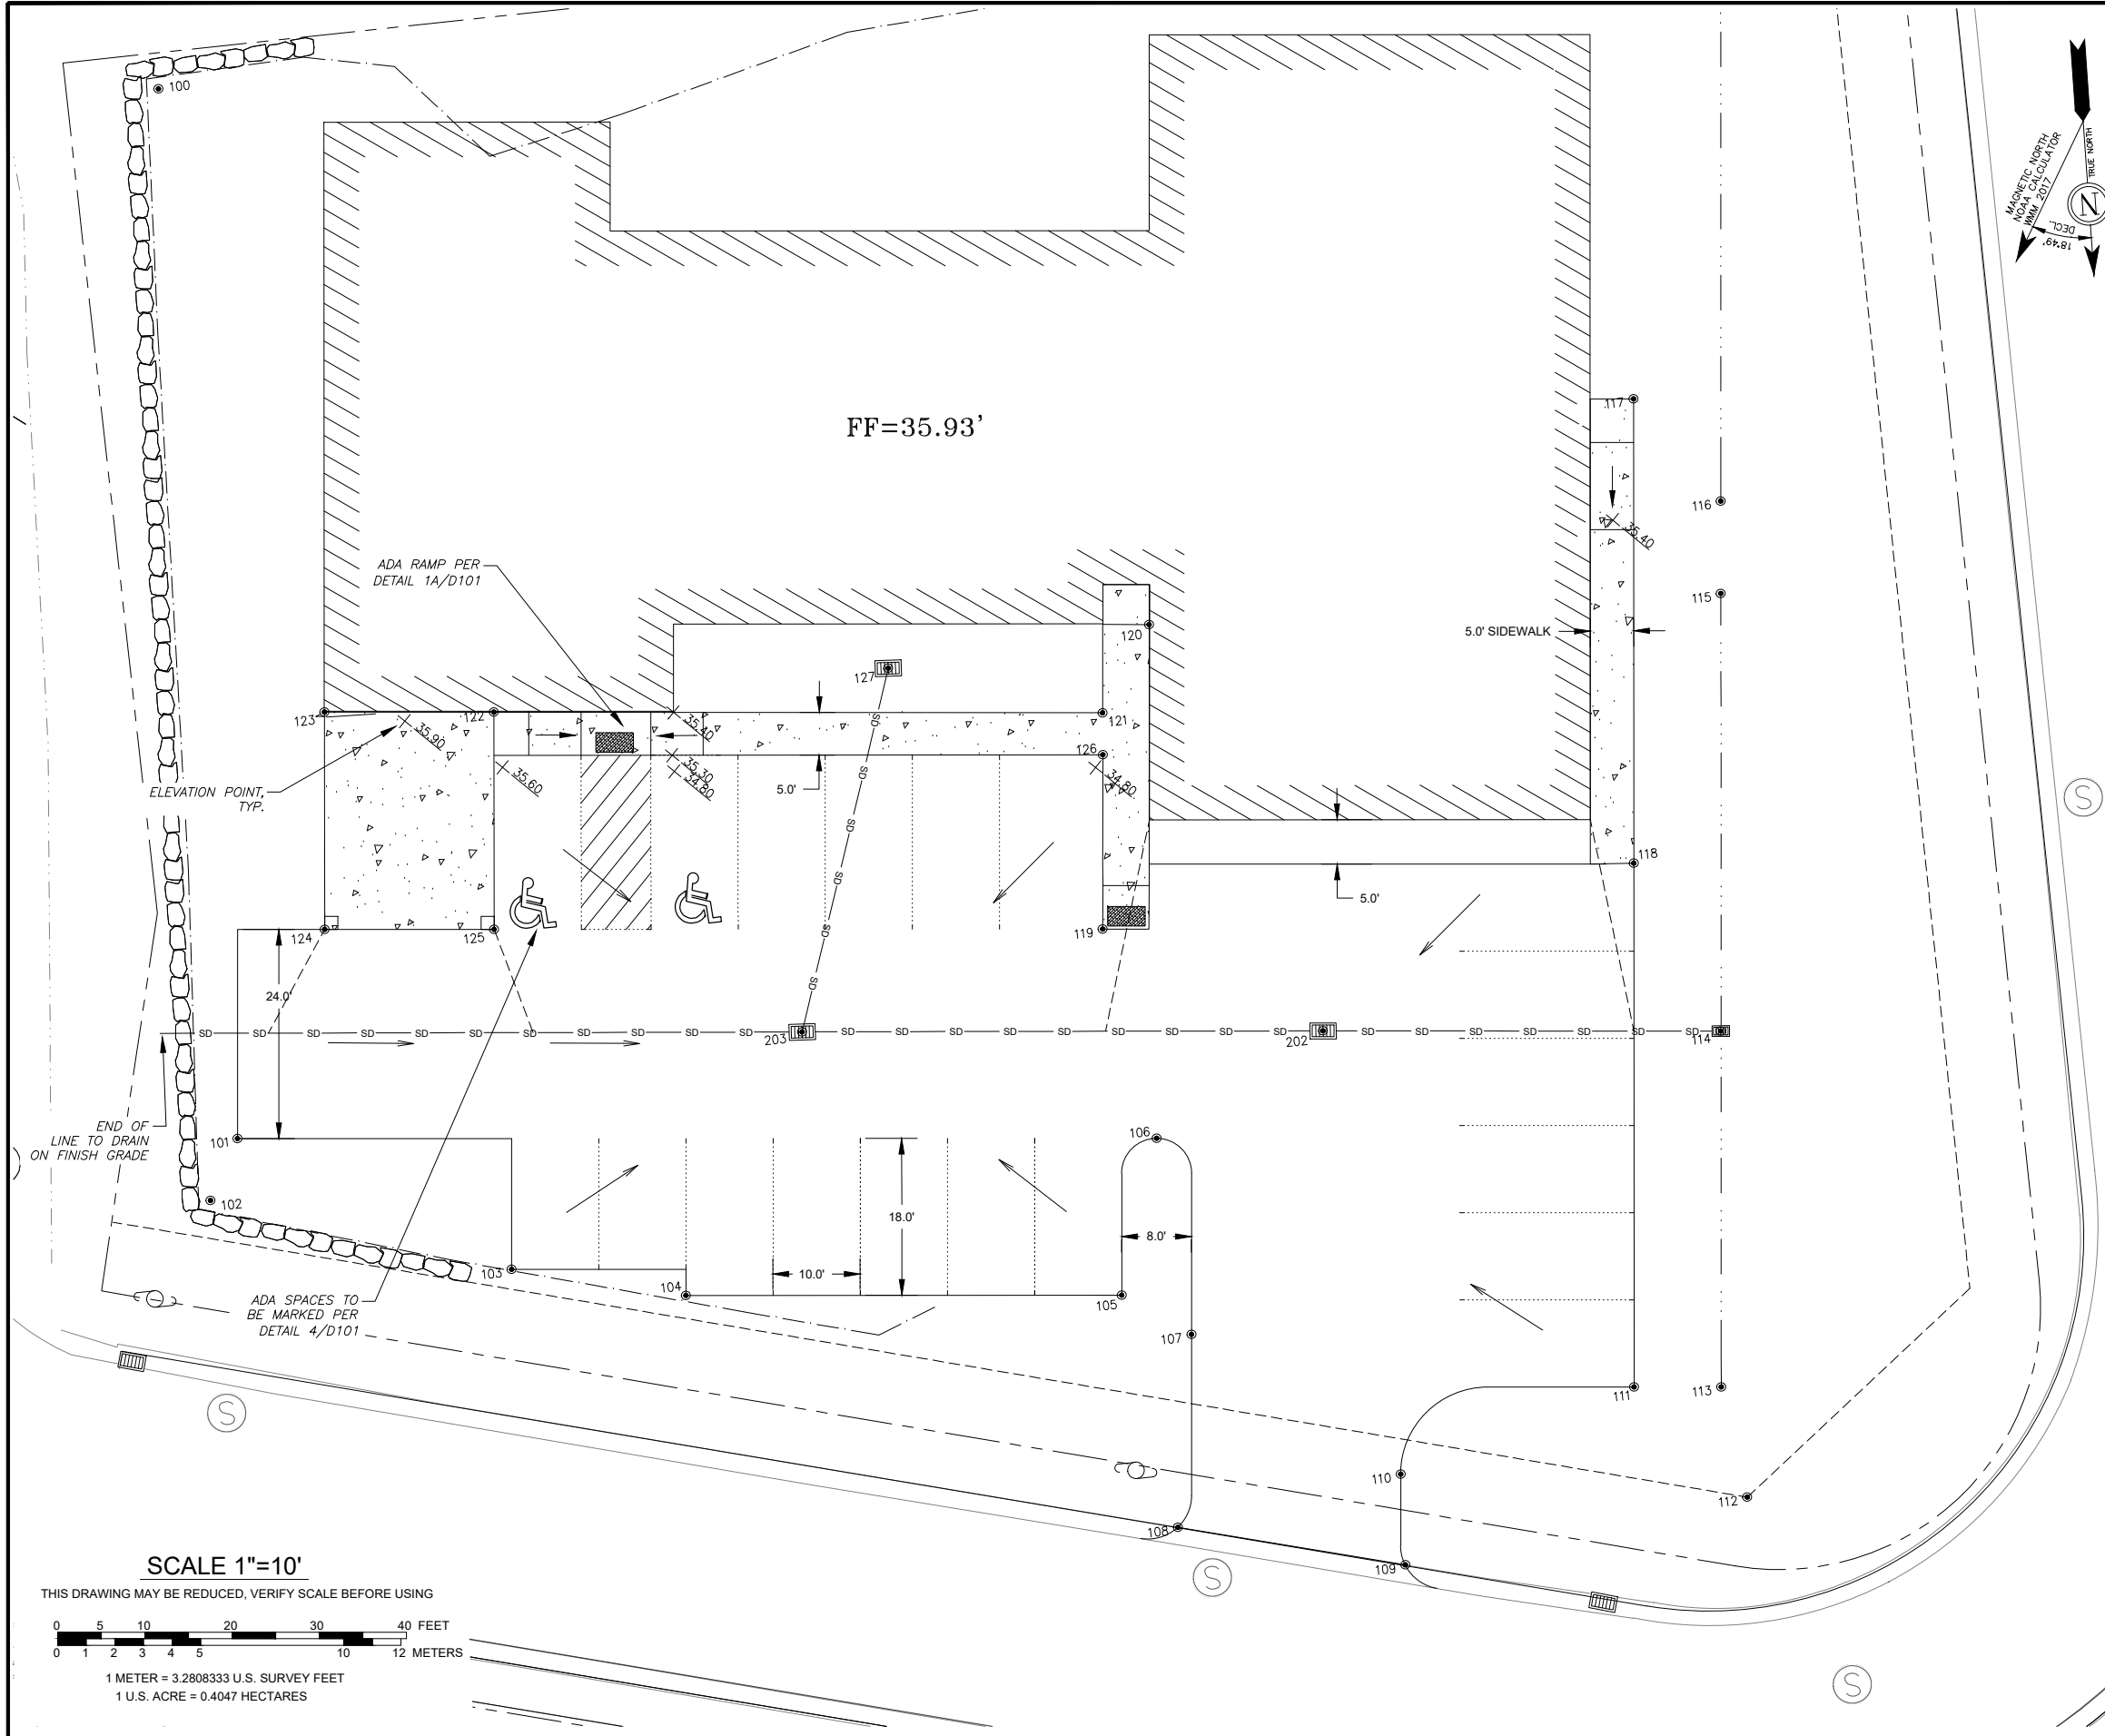

SCALE 1"=10'


THIS DRAWING MAY BE REDUCED, VERIFY SCALE BEFORE USING

0 5 10 20 30 40 FEET

0 1 2 3 4 5 10 12 METERS

1 METER = 3.2808333 U.S. SURVEY FEET


1 U.S. ACRE = 0.4047 HECTARES

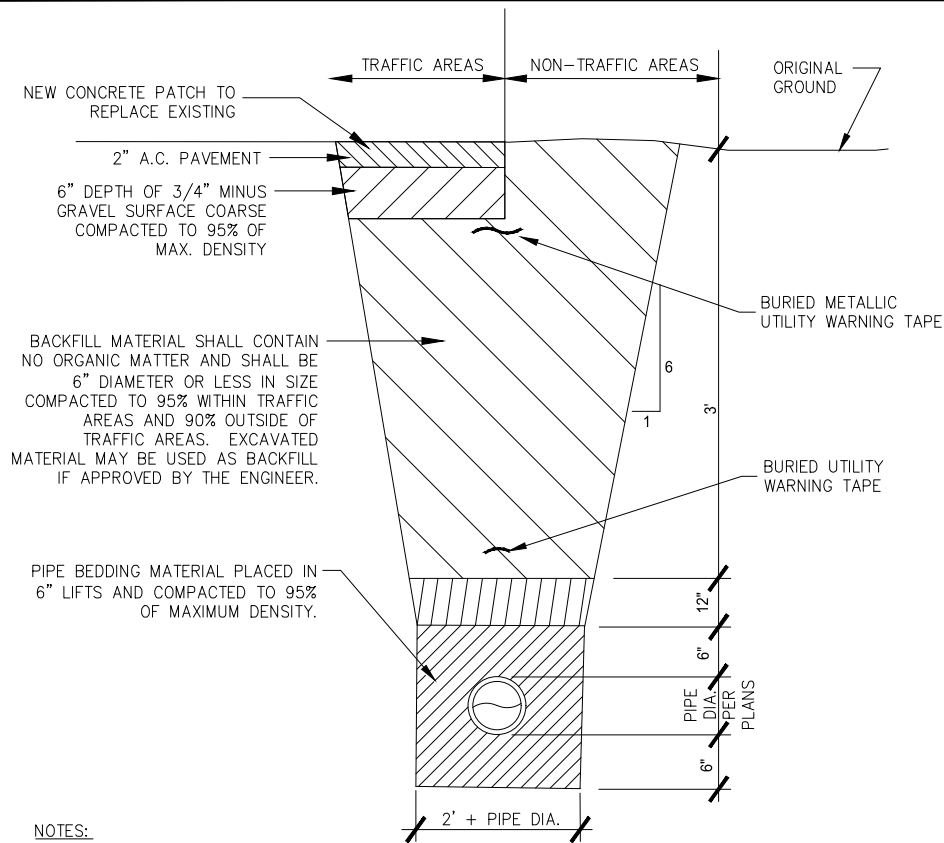


NOTES:

1. BACKFILL MATERIAL SHALL BE PLACED IN 8" MAXIMUM LIFTS.
2. TRENCH EXCAVATION AND SHORING SHALL COMPLY WITH LOCAL, STATE, AND OSHA REGULATIONS AND REQUIREMENTS.
3. INDICATED SLOPE IS FOR PAY QUANTITY DETERMINATION ONLY FOR IMPORTED BACKFILL GRAVEL AND RESURFACING REQUIREMENTS.
4. IF UNSUITABLE PIPE FOUNDATION MATERIAL IS ENCOUNTERED DURING EXCAVATION, ENGINEER MAY DIRECT THE CONTRACTOR TO OVER-EXCAVATE AND BACKFILL WITH SUITABLE MATERIAL.
5. THE DITCH LINE, IF ONE EXISTS, SHALL BE RESHAPED IN SUCH A MANNER TO ALLOW POSITIVE DRAINAGE TO MATCH PRE-CONSTRUCTION CONDITIONS.


1 TYPICAL TRENCH DETAIL
D100 NOT TO SCALE

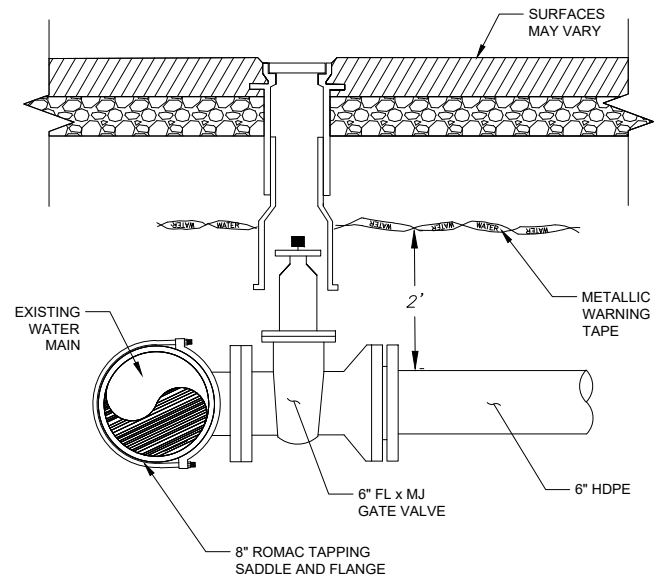


5 WATER MAIN CONNECTION
D100 NOT TO SCALE

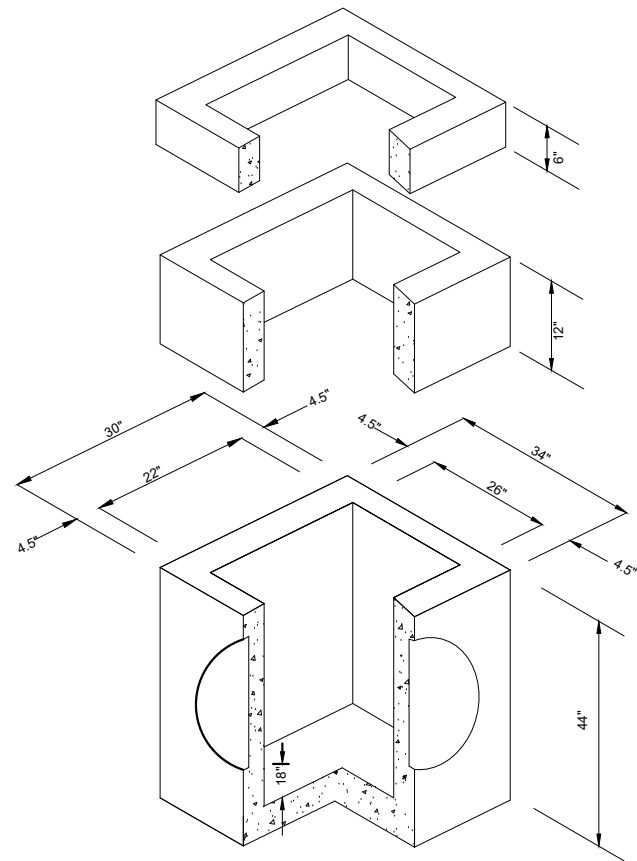

2 TYPE II CATCH BASIN DETAIL
D100 NOT TO SCALE

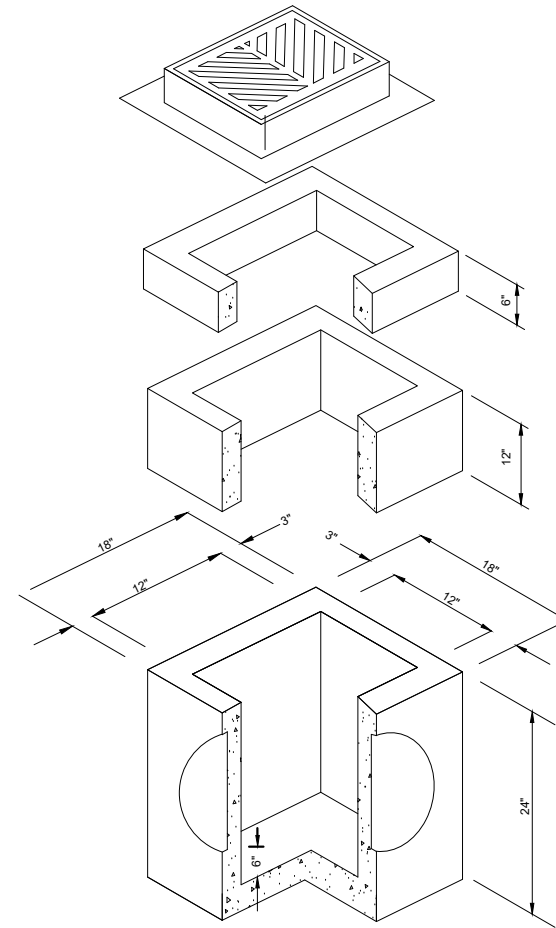


3 TYPE I AREA DRAIN DETAIL
D100 NOT TO SCALE

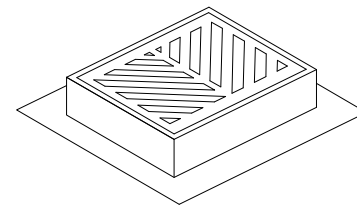

NOTES:

- 1) CATCH BASINS SCHEDULED TO HAVE FIELD INLETS SHALL HAVE OLYMPIC FOUNDRY 18"x22"x4" REVERSIBLE, PART NO. SM60 OR EQUAL.
- 2) CATCH BASINS SCHEDULED TO HAVE CURB INLETS SHALL HAVE NEENAH FOUNDRY TYPE R-3501-N INLET FOR ROLL TYPE CURB OR EQUAL.

4 FIELD INLET DETAIL
D100 NOT TO SCALE

				Designed: TSS	Approved:	Scale: AS_NOTED		
				Drawn: TSS	Date: 2/8/2024	Project: 222321.02		
Date	No.	Description	By	Checked: TSS	DO NOT SCALE FROM THESE PLANS – USE DIMENSIONS ONLY			R&M ENGINEERING–KETCHIKAN, INC. 7180 REVILLA ROAD, SUITE 300 KETCHIKAN, ALASKA 99901 AELC 576
Revision								


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER


Sheet Description: DETAILS

Sheet No. D100




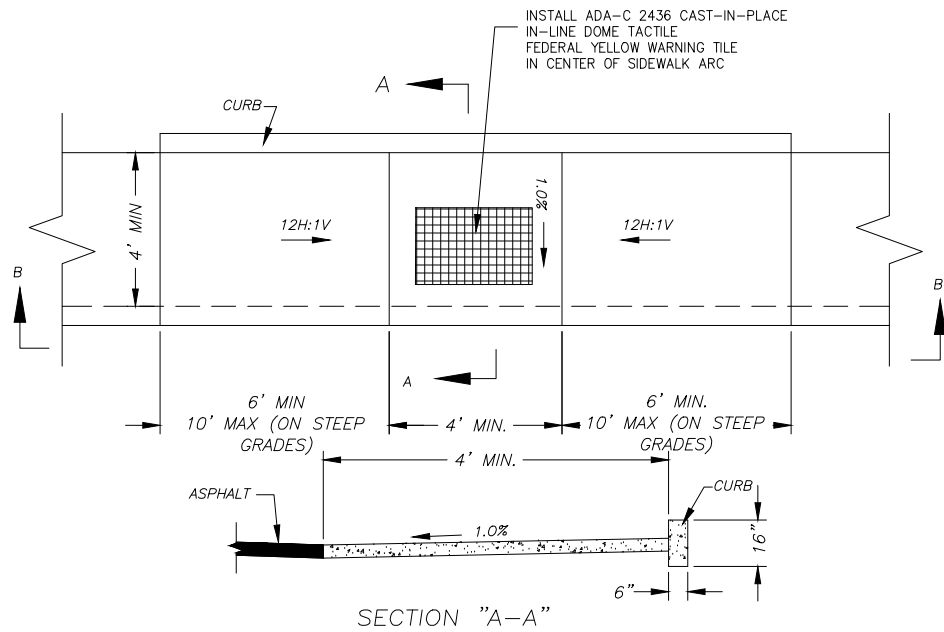


1A STANDARD ADA RAMP DETAIL
D101 NOT TO SCALE

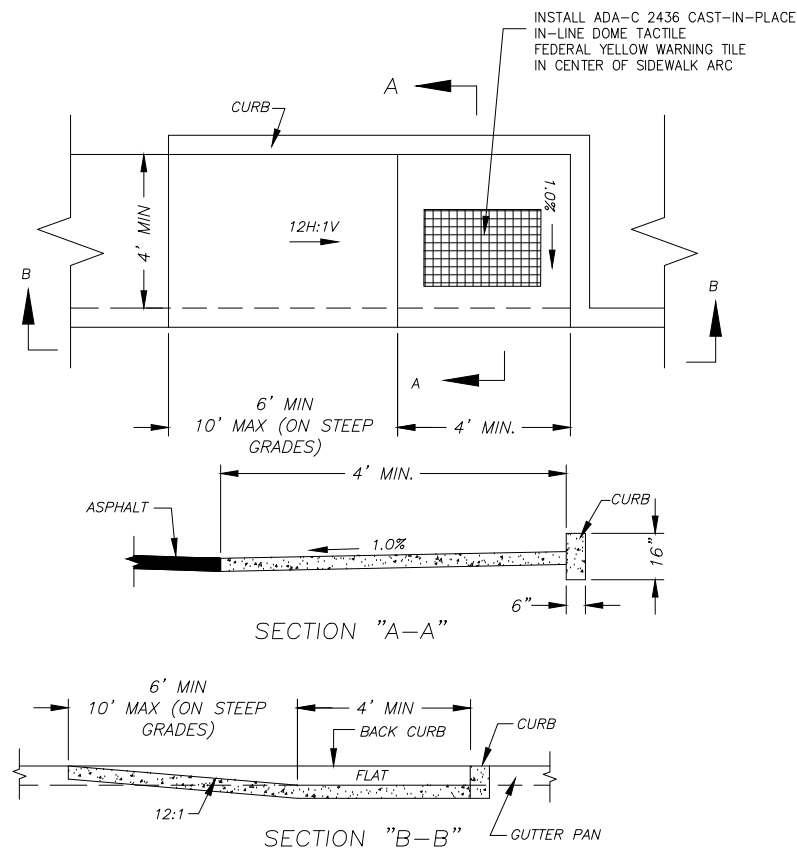


1B HALF ADA RAMP DETAIL
D101 NOT TO SCALE

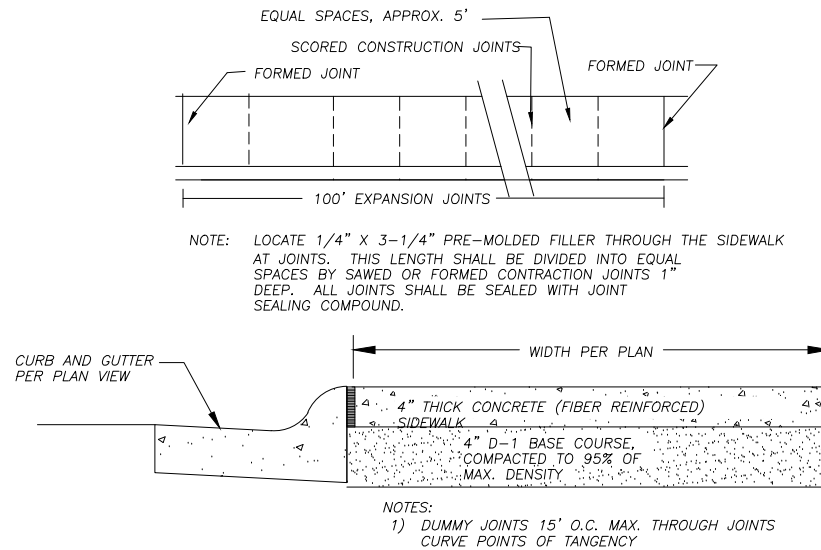


2 SIDEWALK SECTION & DETAIL
D101 NOT TO SCALE

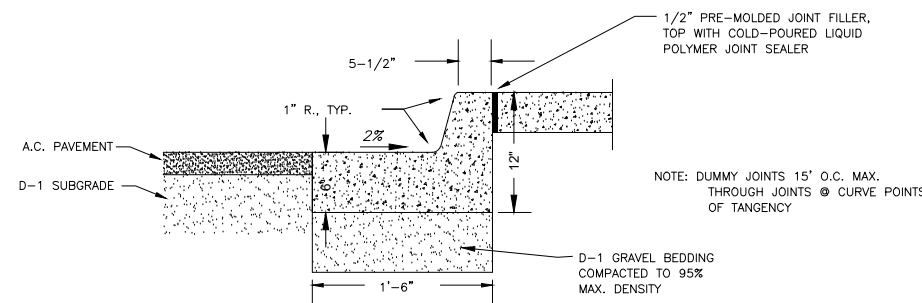


3 STANDARD CURB AND GUTTER
D101 NOT TO SCALE

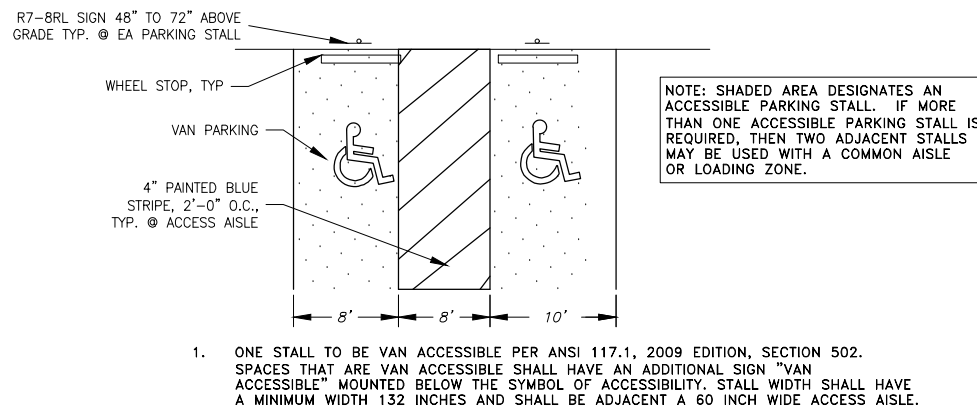

4 HANDICAP PARKING
D101 NOT TO SCALE

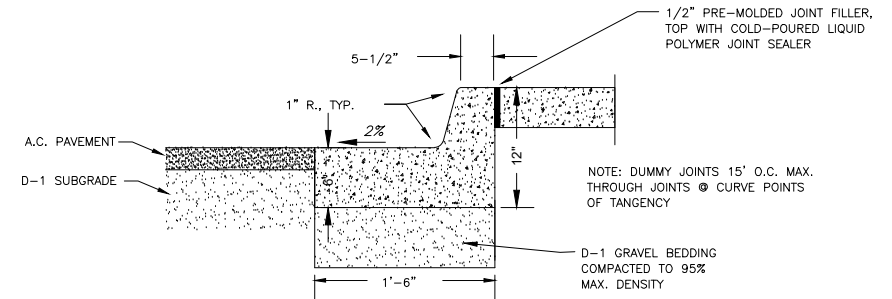


4 SHED CURB AND GUTTER
D101 NOT TO SCALE

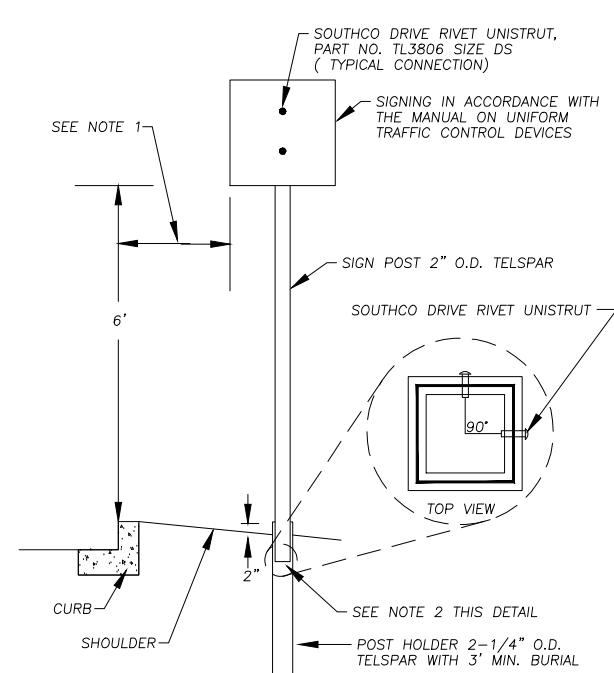

- NOTES:
- 1) MAXIMUM & MINIMUM DIMENSIONS PER MANUAL ON UNIFORM TRAFFIC CONTROL DEVICE, PER PART II SIGNS.
 - 2) SIGN POST MUST BE INSERTED INTO HOLDER A MAXIMUM OF 12" AND A MINIMUM OF 6".
 - 3) NUMBERS IN SCHEDULE REFER TO MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES

SIGN SCHEDULE		
SIGN	No.	DESCRIPTION
S1	R7-8RL	RESERVED PARKING
S2	R7-8	RESERVED PARKING "VAN ACCESSIBLE"
S3	R1-1	STOP
S4		AUTHORIZED PERSONNEL PARKING ONLY
S5	R7-9	NO PARKING LOADING ZONE
S6		

5 SIGN DETAIL
D101 NOT TO SCALE

				Designed: TSS	Approved:	Scale: AS_NOTED	
				Drawn: TSS	Date: 2/8/2024	Project: 222321.02	
Date	No.	Description	By	Checked: TSS	DO NOT SCALE FROM THESE PLANS - USE DIMENSIONS ONLY.		
		Revision					


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER

Sheet Description: DETAILS

Sheet No. D101



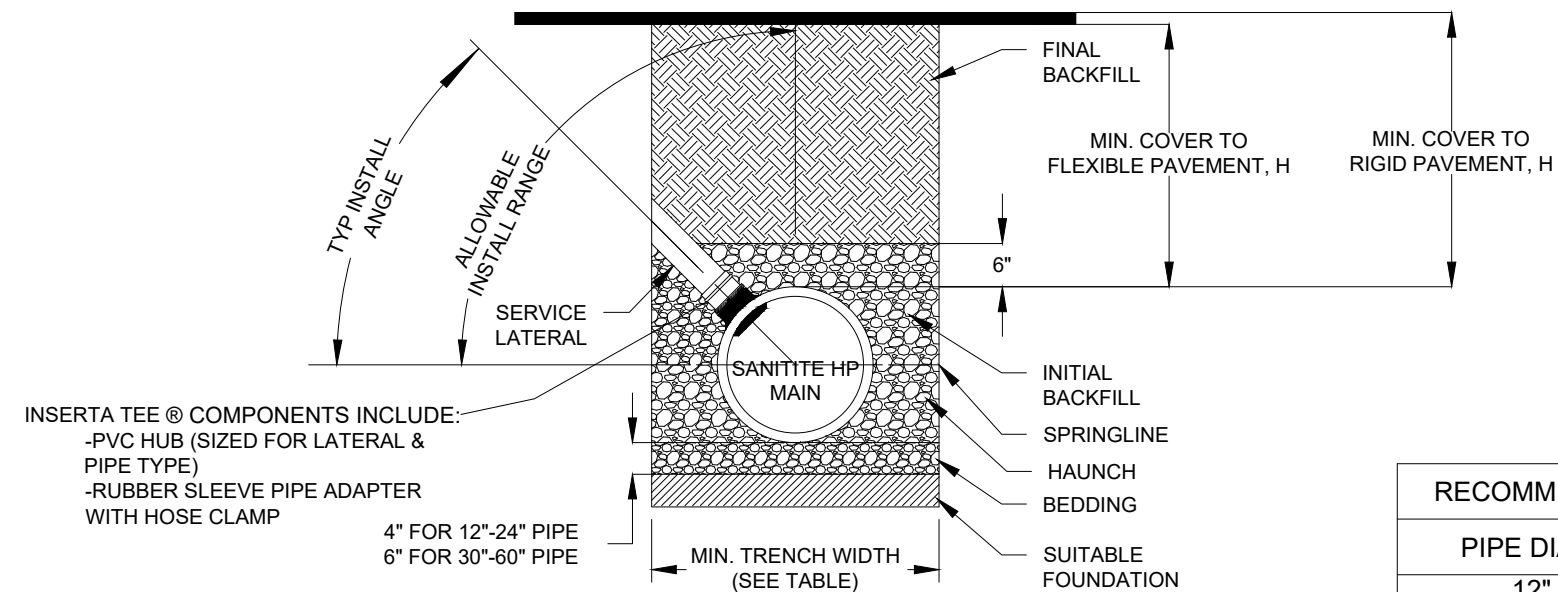


NOTES:

1. ALL PIPE SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321, "STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF THERMOPLASTIC PIPE FOR SEWERS AND OTHER GRAVITY FLOW APPLICATIONS", LATEST ADDITION
2. MEASURES SHOULD BE TAKEN TO PREVENT MIGRATION OF NATIVE FINES INTO BACKFILL MATERIAL, WHEN REQUIRED.
3. THE INSERTA TEE CONNECTION CAN BE INSTALLED UP TO A VERTICAL ORIENTATION, BUT A 45° INSTALL ANGLE IS MOST COMMON. GREATER ANGLES ARE SUBJECT TO DESIGN ENGINEER APPROVAL AND MAY REQUIRE PREMIUM BACKFILL.
4. FOUNDATION: WHERE THE TRENCH BOTTOM IS UNSTABLE, THE CONTRACTOR SHALL EXCAVATE TO A DEPTH REQUIRED BY THE ENGINEER AND REPLACE WITH SUITABLE MATERIAL AS SPECIFIED BY THE ENGINEER. AS AN ALTERNATIVE AND AT THE DISCRETION OF THE DESIGN ENGINEER, THE TRENCH BOTTOM MAY BE STABILIZED USING A GEOTEXTILE MATERIAL.
5. BEDDING: SUITABLE MATERIAL SHALL BE CLASS I, II OR III. THE CONTRACTOR SHALL PROVIDE DOCUMENTATION FOR MATERIAL SPECIFICATION TO ENGINEER. UNLESS OTHERWISE NOTED BY THE ENGINEER, MINIMUM BEDDING THICKNESS SHALL BE 4" (100mm) FOR 4"-24" (100mm-600mm); 6" (150mm) FOR 30"-60" (750mm-1500mm).
6. INITIAL BACKFILL: SUITABLE MATERIAL SHALL BE CLASS I, II OR III IN THE PIPE ZONE EXTENDING NOT LESS THAN 6" ABOVE CROWN OF PIPE. THE CONTRACTOR SHALL PROVIDE DOCUMENTATION FOR MATERIAL SPECIFICATION TO ENGINEER. MATERIAL SHALL BE INSTALLED AS REQUIRED IN ASTM D2321, LATEST EDITION.
7. MINIMUM COVER: MINIMUM COVER, H, IN NON-TRAFFIC APPLICATIONS (GRASS OR LANDSCAPE AREAS) IS 12" FROM THE TOP OF PIPE TO GROUND SURFACE. ADDITIONAL COVER MAY BE REQUIRED TO PREVENT FLOTATION. FOR TRAFFIC APPLICATIONS, MINIMUM COVER, H, IS 12" UP TO 48" DIAMETER PIPE AND 24" OF COVER FOR 54"-60" DIAMETER PIPE, MEASURED FROM TOP OF PIPE TO BOTTOM OF FLEXIBLE PAVEMENT OR TO TOP OF RIGID PAVEMENT.

RECOMMENDED MINIMUM TRENCH WIDTHS	
PIPE DIAM.	MIN. TRENCH WIDTH
12" (300mm)	30" (762mm)
15" (375mm)	34" (864mm)
18" (450mm)	39" (991mm)
24" (600mm)	48" (1219mm)
30" (750mm)	56" (1422mm)
36" (900mm)	64" (1626mm)
42" (1050mm)	72" (1829mm)
48" (1200mm)	80" (2032mm)
60" (1500mm)	96" (2438mm)

1
D102 INSERTA TEE CONNECTION DETAIL
NOT TO SCALE


				Designed: TSS	Approved:	Scale: AS NOTED	 R&M ENGINEERING-KETCHIKAN, INC. 7180 REVILLA ROAD, SUITE 300 KETCHIKAN, ALASKA 99901 AELC 576
				Drawn: TSS	Date: 2/8/2024	Project: 222321.02	
				By	DO NOT SCALE FROM THESE PLANS – USE DIMENSIONS ONLY		
Date	No.	Description		Checked: TSS			
		Revision					


Client: TLINGIT HAIDA REGIONAL HOUSING AUTHORITY
5446 JENKINS DRIVE
JUNEAU, AK 99801

Project: CRAIG TRACT 18 SENIOR CENTER

Sheet Description: DETAILS

Sheet No. D102



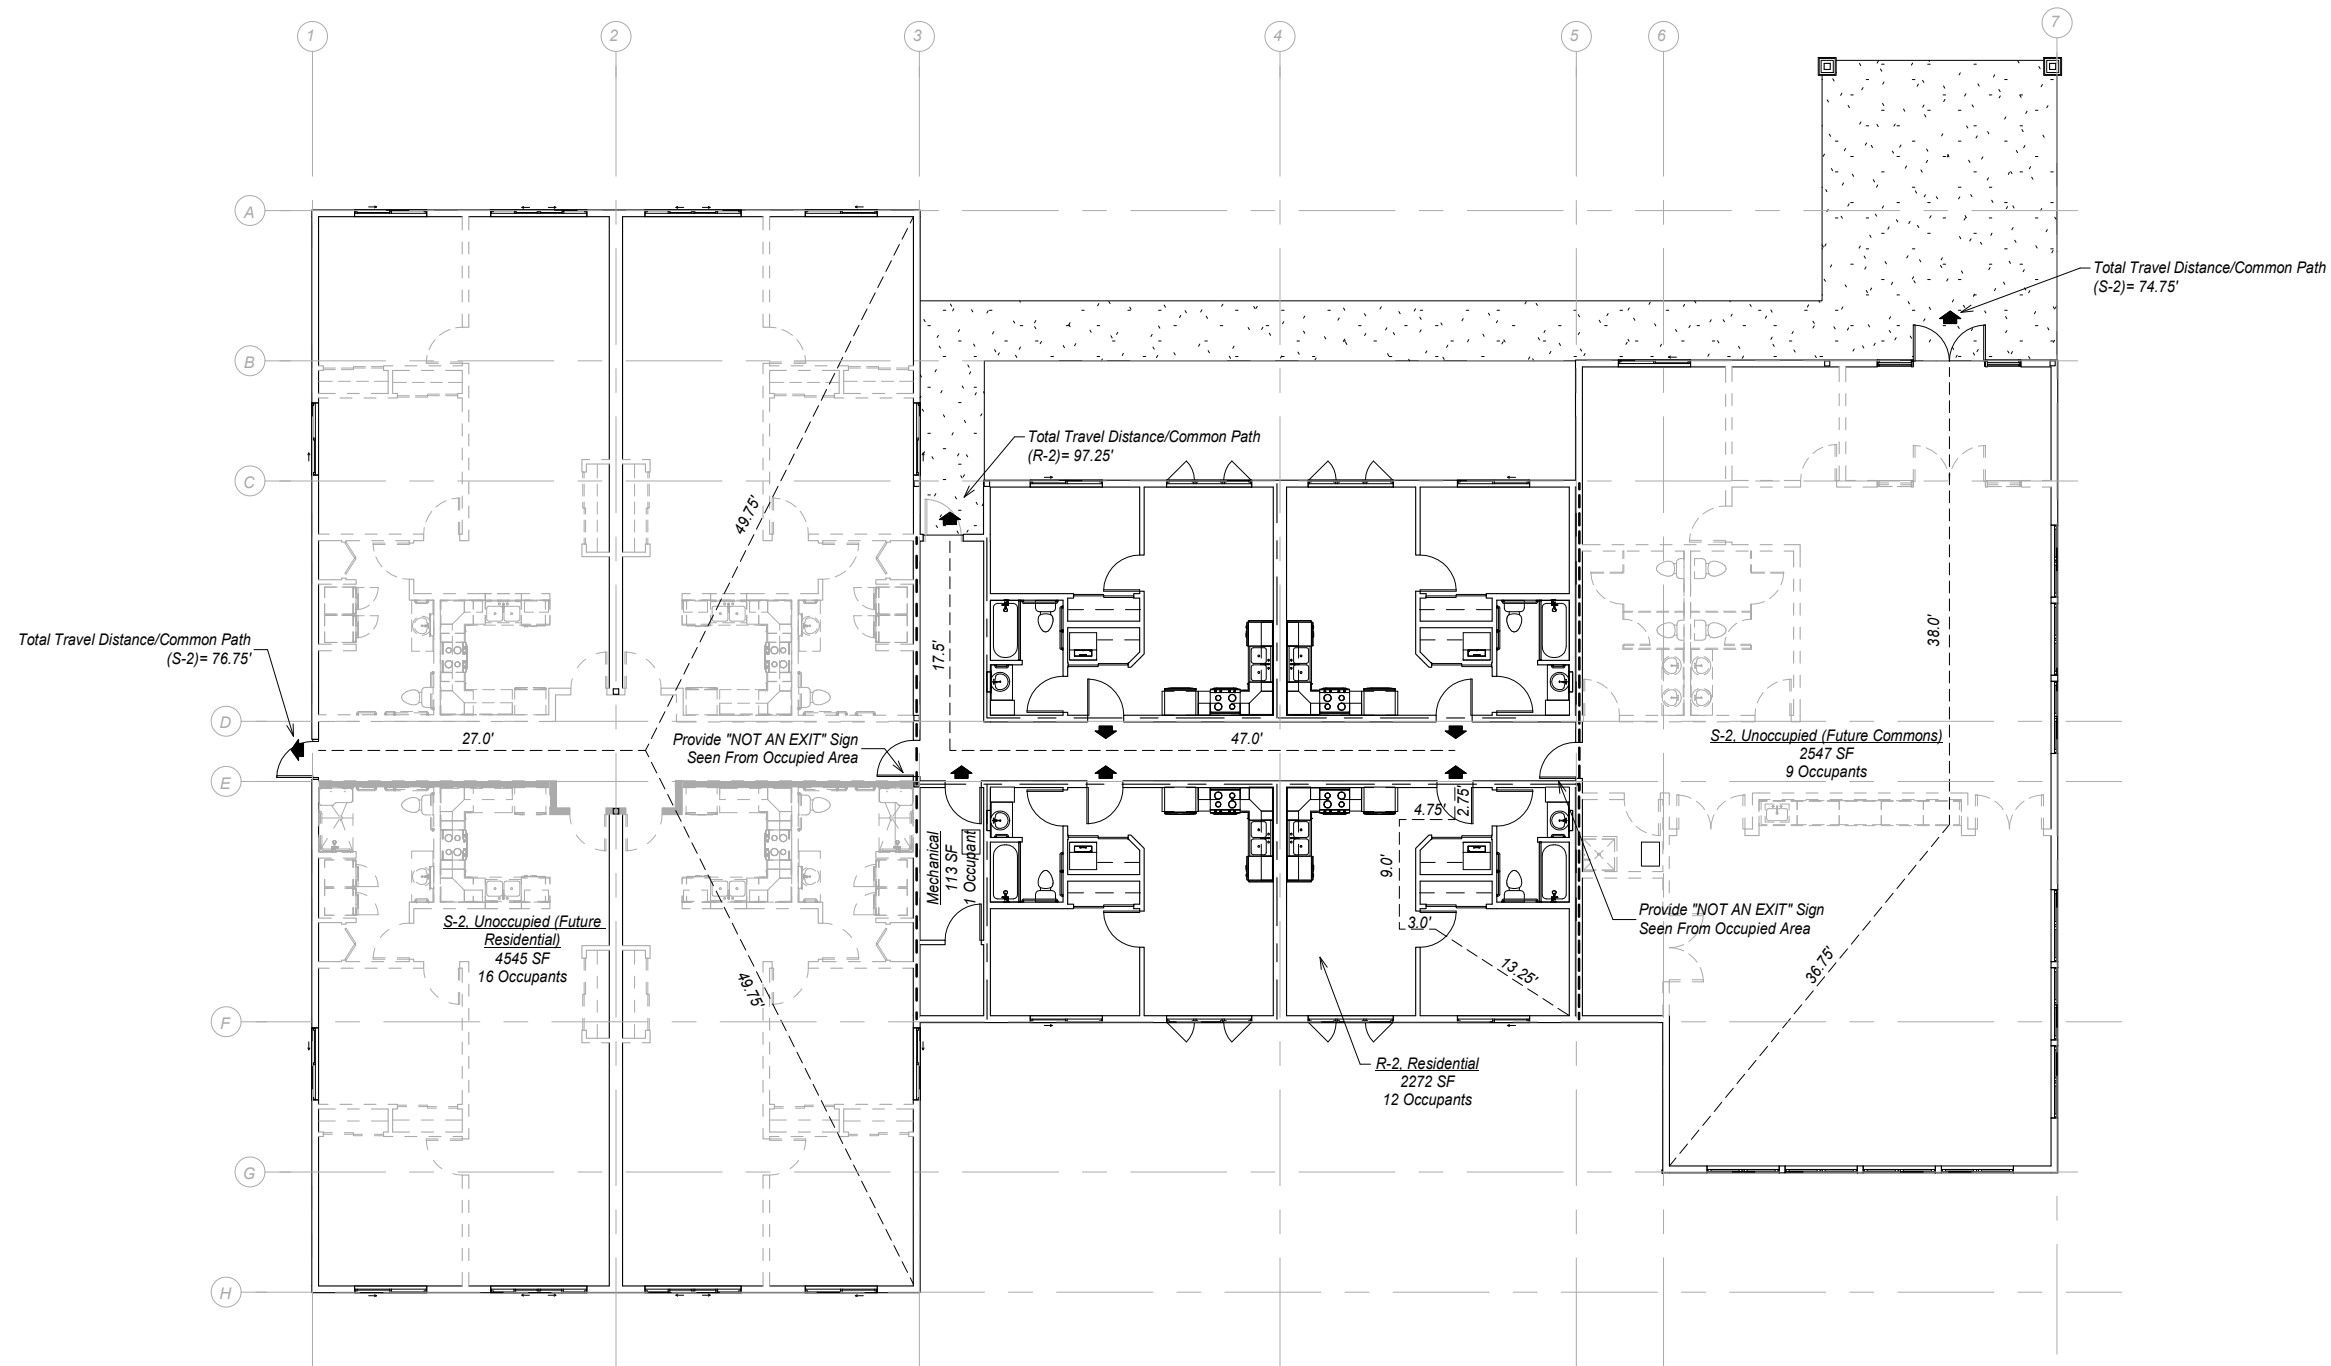

1 Egress Plan
1/16" = 1'-0"

FIRE RATING LEGEND

- 1-Hr Rated Wall Construction
- 1/2 Hr Rated Wall Construction

REVISIONS:


**THRHA - Craig Senior Center
PHASE 1**

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M

R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:

Egress Plan

A001

SHEET:
03 of xx

GENERAL NOTES

COMPLY WITH ALL PROVISIONS OF THE INTERNATIONAL CODES AS ADOPTED BY THE CITY OF CRAIG AND THE STATE OF ALASKA.

1.
- ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, INCLUDING THE LATEST ADOPTED EDITIONS OF THE IBC, IFC, IMC, IPC, IRC, UFC, UMC, UPC, NEC, AND ADA ACCESSIBILITY GUIDELINES.
2.
- THE ARCHITECTURAL DRAWINGS ARE A PART OF LARGER SET OF DRAWINGS WHICH, WHEN COMPLETE, CONSISTS OF ALL DRAWINGS LISTED BY THE INDEX OF DRAWINGS. THE WORD DESCRIBED BY THE DRAWINGS OF ANY ONE DISCIPLINE MAY BE AFFECTED BY THE WORK DESCRIBE ON DRAWINGS OF ANOTHER DISCIPLINE AND MAY REQUIRE REFERENCE TO THE DRAWINGS OF ANOTHER DISCIPLINE. PARTIAL SETS OF DRAWINGS ARE INCOMPLETE AND SHOULD NOT BE DISTRIBUTED OR UTILIZED BY THE CONTRACTOR. IT IS THE CONTRACTOR'S RESPONSIBILITY TO REVIEW AND COORDINATE THE WORK OF ALL SUBCONTRACTORS, TRADES, AND SUPPLIERS WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS BEFORE COMMENCING CONSTRUCTION, AND TO ASSURE THAT ALL PARTIES ARE AWARE OF ALL REQUIREMENTS, REGARDLESS OF WHERE THE REQUIREMENTS OCCUR IN THE CONTRACT DOCUMENTS., WHICH MIGHT AFFECT THE WORK OF THAT PARTY.
3.
- CONTRACTOR SHALL VERIFY ALL SITE CONDITIONS AND BUILDING DIMENSIONS PRIOR TO PROCEEDING WITH THE WORK. ANY VARIATION FROM THE CONDITIONS AND DIMENSIONS SHOWN ON THE DRAWINGS SHALL BE REPORTED TO THE OWNER OR ARCHITECT FOR RESOLUTION PRIOR TO CONSTRUCTION.
4.
- CONTRACTOR-INITIATED CHANGES SHALL BE SUBMITTED IN WRITING TO THE OWNER'S REPRESENTATIVE FOR APPROVAL PRIOR TO FABRICATION OR CONSTRUCTION. CHANGES SHOWN ON SHOP DRAWINGS ONLY WILL NOT SATISFY THIS REQUIREMENT.
5.
- WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS. DIMENSIONS ARE TO CENTERLINE OF COLUMNS OR TO FACE OF FRAMING, UNLESS OTHERWISE NOTED. DIMENSIONS NOTED AS "CLEAR" ARE TO FACE OF FINISH MATERIALS.
6.
- REFER TO THE STRUCTURAL, MECHANICAL, ELECTRICAL, CIVIL, LANDSCAPE AD PLUMBING DRAWINGS FOR THE DETAILED DESIGN OF STRUCTURAL, MECHANICAL, ELECTRICAL, CIVIL, LANDSCAPE AND PLUMBING SYSTEMS, OF WHICH PORTIONS MAY BE SHOWN ON THE ARCHITECTURAL DRAWINGS.
7.
- FINISH FLOOR ELEVATIONS ARE TO TOP OF CONCRETE FLOOR SLAB OR WOOD SUB-FLOOR, UNLESS OTHERWISE NOTED.
8.
- CEILING HEIGHT DIMENSIONS ARE TO FINISHED SURFACES, UNLESS OTHERWISE NOTED.
9.
- PROVIDE FIRE BLOCKING, DRAFT STOPS, AND FIRE STOPS PER IBC SECTION 717.
10.
- PROVIDE AN 2A 10BC FIRE EXTINGUISHER PER PLANS.
11.
- WINDOWS IN OCCUPIED, HEATED AREAS OF BUILDING TO BE DOUBLE PANE, INSULATED GLAZING.
12.
- SAFETY GLAZING: WIRED, TEMPERED, AND LAMINATED SAFETY GLASS MUST MEET UBC STANDARDS. GLAZING IN OR ADJACENT TO DOORS (12") AND GLAZING LESS THAN 18" ABOVE FLOOR, AND OTHER HAZARDOUS LOCATIONS PER UBC SEC. 2406.
13.
- MINIMUM INSULATION REQUIREMENTS IN OCCUPIED, HEATED AREAS OF BUILDING, UON:


ROOF/CEILING	R49
EXT. WALLS	R21
FLOORS & SOFFITS	R30
HOT WATER PIPES	1/2"

ALLOW 2' MIN. AIR SPACE OVER INSULATION WHEN BATTS ARE USED BETWEEN RAFTERS & TRUSSES. SEAL ALL TEARS AND JOINTS WITH TAPE. ALL ROOF INSULATION APPLIED DIRECTLY TO EXTERIOR FRAMING MEMBERS SHALL BE PROVIDED WITH VAPOR BARRIER ON HEATED SIDE. ALL OPENINGS (DOORS, WINDOWS, ETC.) SHALL BE CAULKED, SEALED, OR WEATHERSTRIPPED.


SCOPE OF WORK

CONSTRUCTION OF 9613 SF, SINGLE STORY FULLY SPRINKLED INDEPENDANT SENIOR LIVING FACILITY. THE BUILDING'S SHELL AND (4) 1 BEDROOM UNITS WILL BE BUILT AS PHASE 1. UNOCCUPIED SPACES ARE TO BE SPRINKLED AND ARE TREATED AS S-2 STORAGE. THERE IS A 1-HR SEPARATION BETWEEN THE OCCUPIED PHASE 1 AND FUTURE PHASES OF CONSTRUCTION.


WALL TYPES

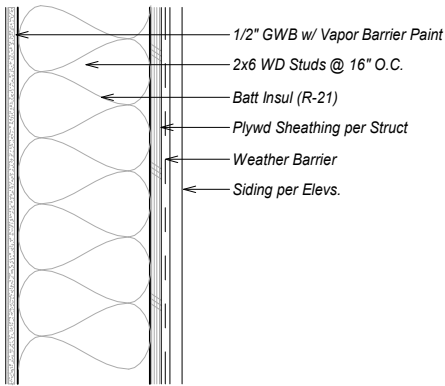


1 Exterior Wall

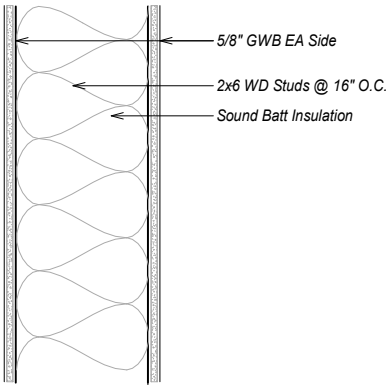


4 Typ. Corridor Wall (2x6) 30 Min-Rated

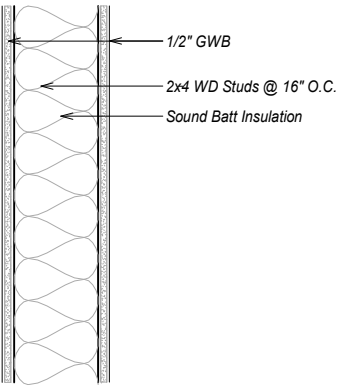


7 Typ. Interior Sound Wall (2x4)

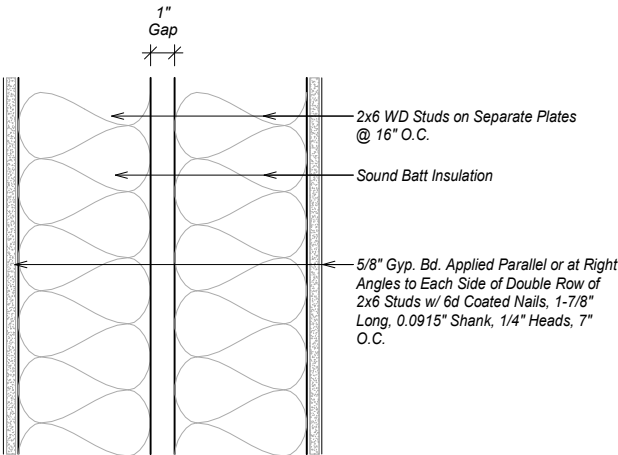


2 Typ. Interior Unit Separation Wall (2x6)
30 Min Rated, STC 50+

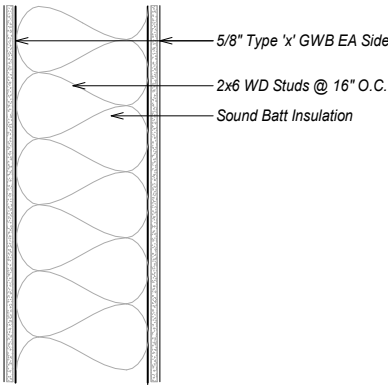

5 Typ. Interior Rated Wall (2x6) 1hr-Rated

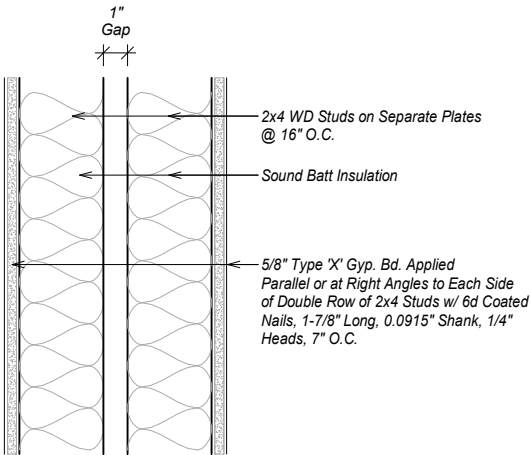

3 Interior Rated Double Wall (2x6)
1-hr Rated, STC 50+
Ga File No. WP 3370

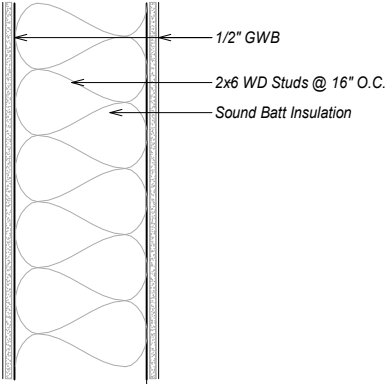

6 Typ. Interior Sound Wall (2x6)

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:

Notes & Wall Types

A002


SHEET:

04 of xx


Door Schedule									
Type Mark	Width	Height	Door Type	Operation	Thickness	Door Material	Frame Material	Fire Rating	Hardware
1	6' - 0"	7' - 0"	A	Swing	1 3/4"	Steel	Steel		
2	3' - 0"	7' - 0"	B	Swing	1 3/4"	Steel	Steel		
3	3' - 0"	6' - 8"	C	Swing	1 3/8"	HM	HM	60 Min.	
4	3' - 0"	6' - 8"	C	Swing	1 3/8"	HM	HM	30 Min	
5	3' - 0"	6' - 8"	C	Swing	1 3/8"	WD/SC			
6	5' - 0"	6' - 8"	D	Bi Pass	1 1/2"	WD/SC	Wood		
7	3' - 0"	6' - 8"	C	Swing	1 3/8"	HM	HM		

NOTE: ALL HARDWARE TO BE ADA COMPLIANT.

DOOR TYPES

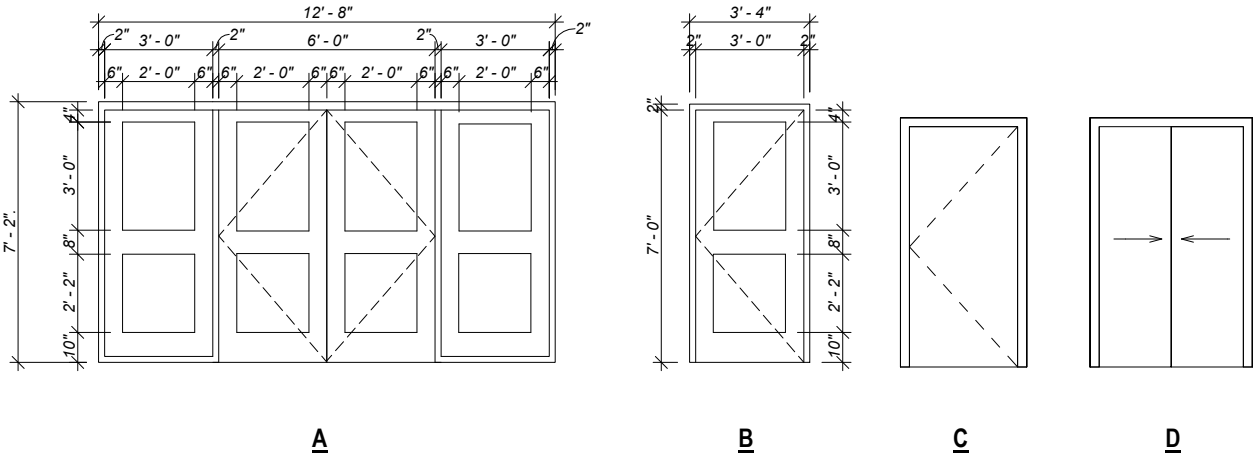

WINDOW TYPES

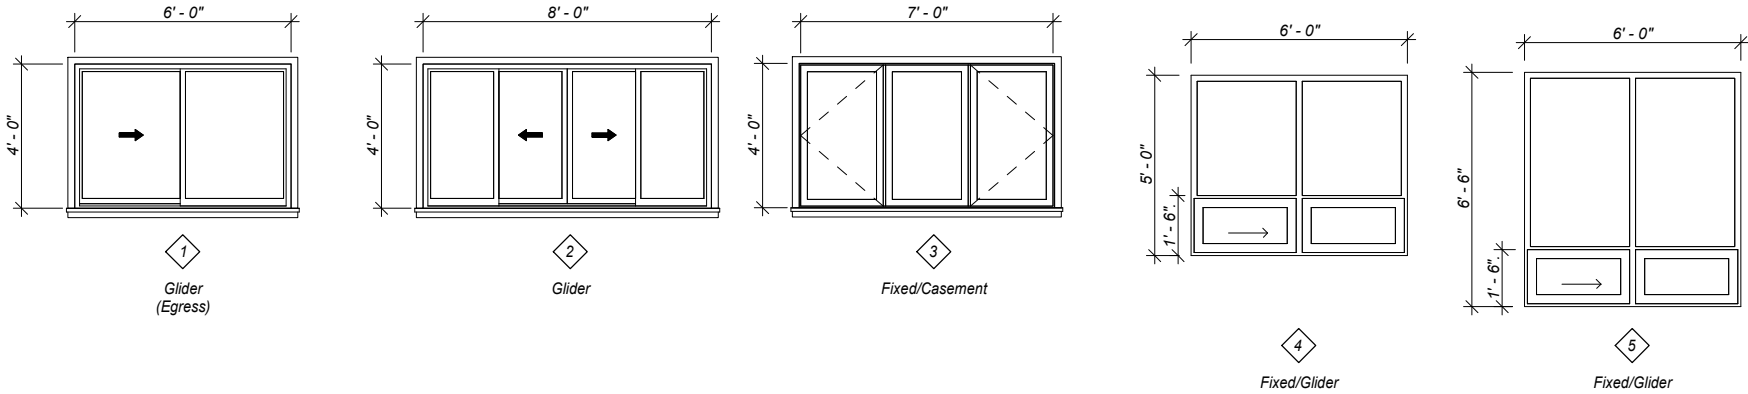

REVISIONS:


THRHA - Craig Senior Center
PHASE 1

STATUS:
PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M


R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:
Schedules

A003

SHEET:
05 of xx

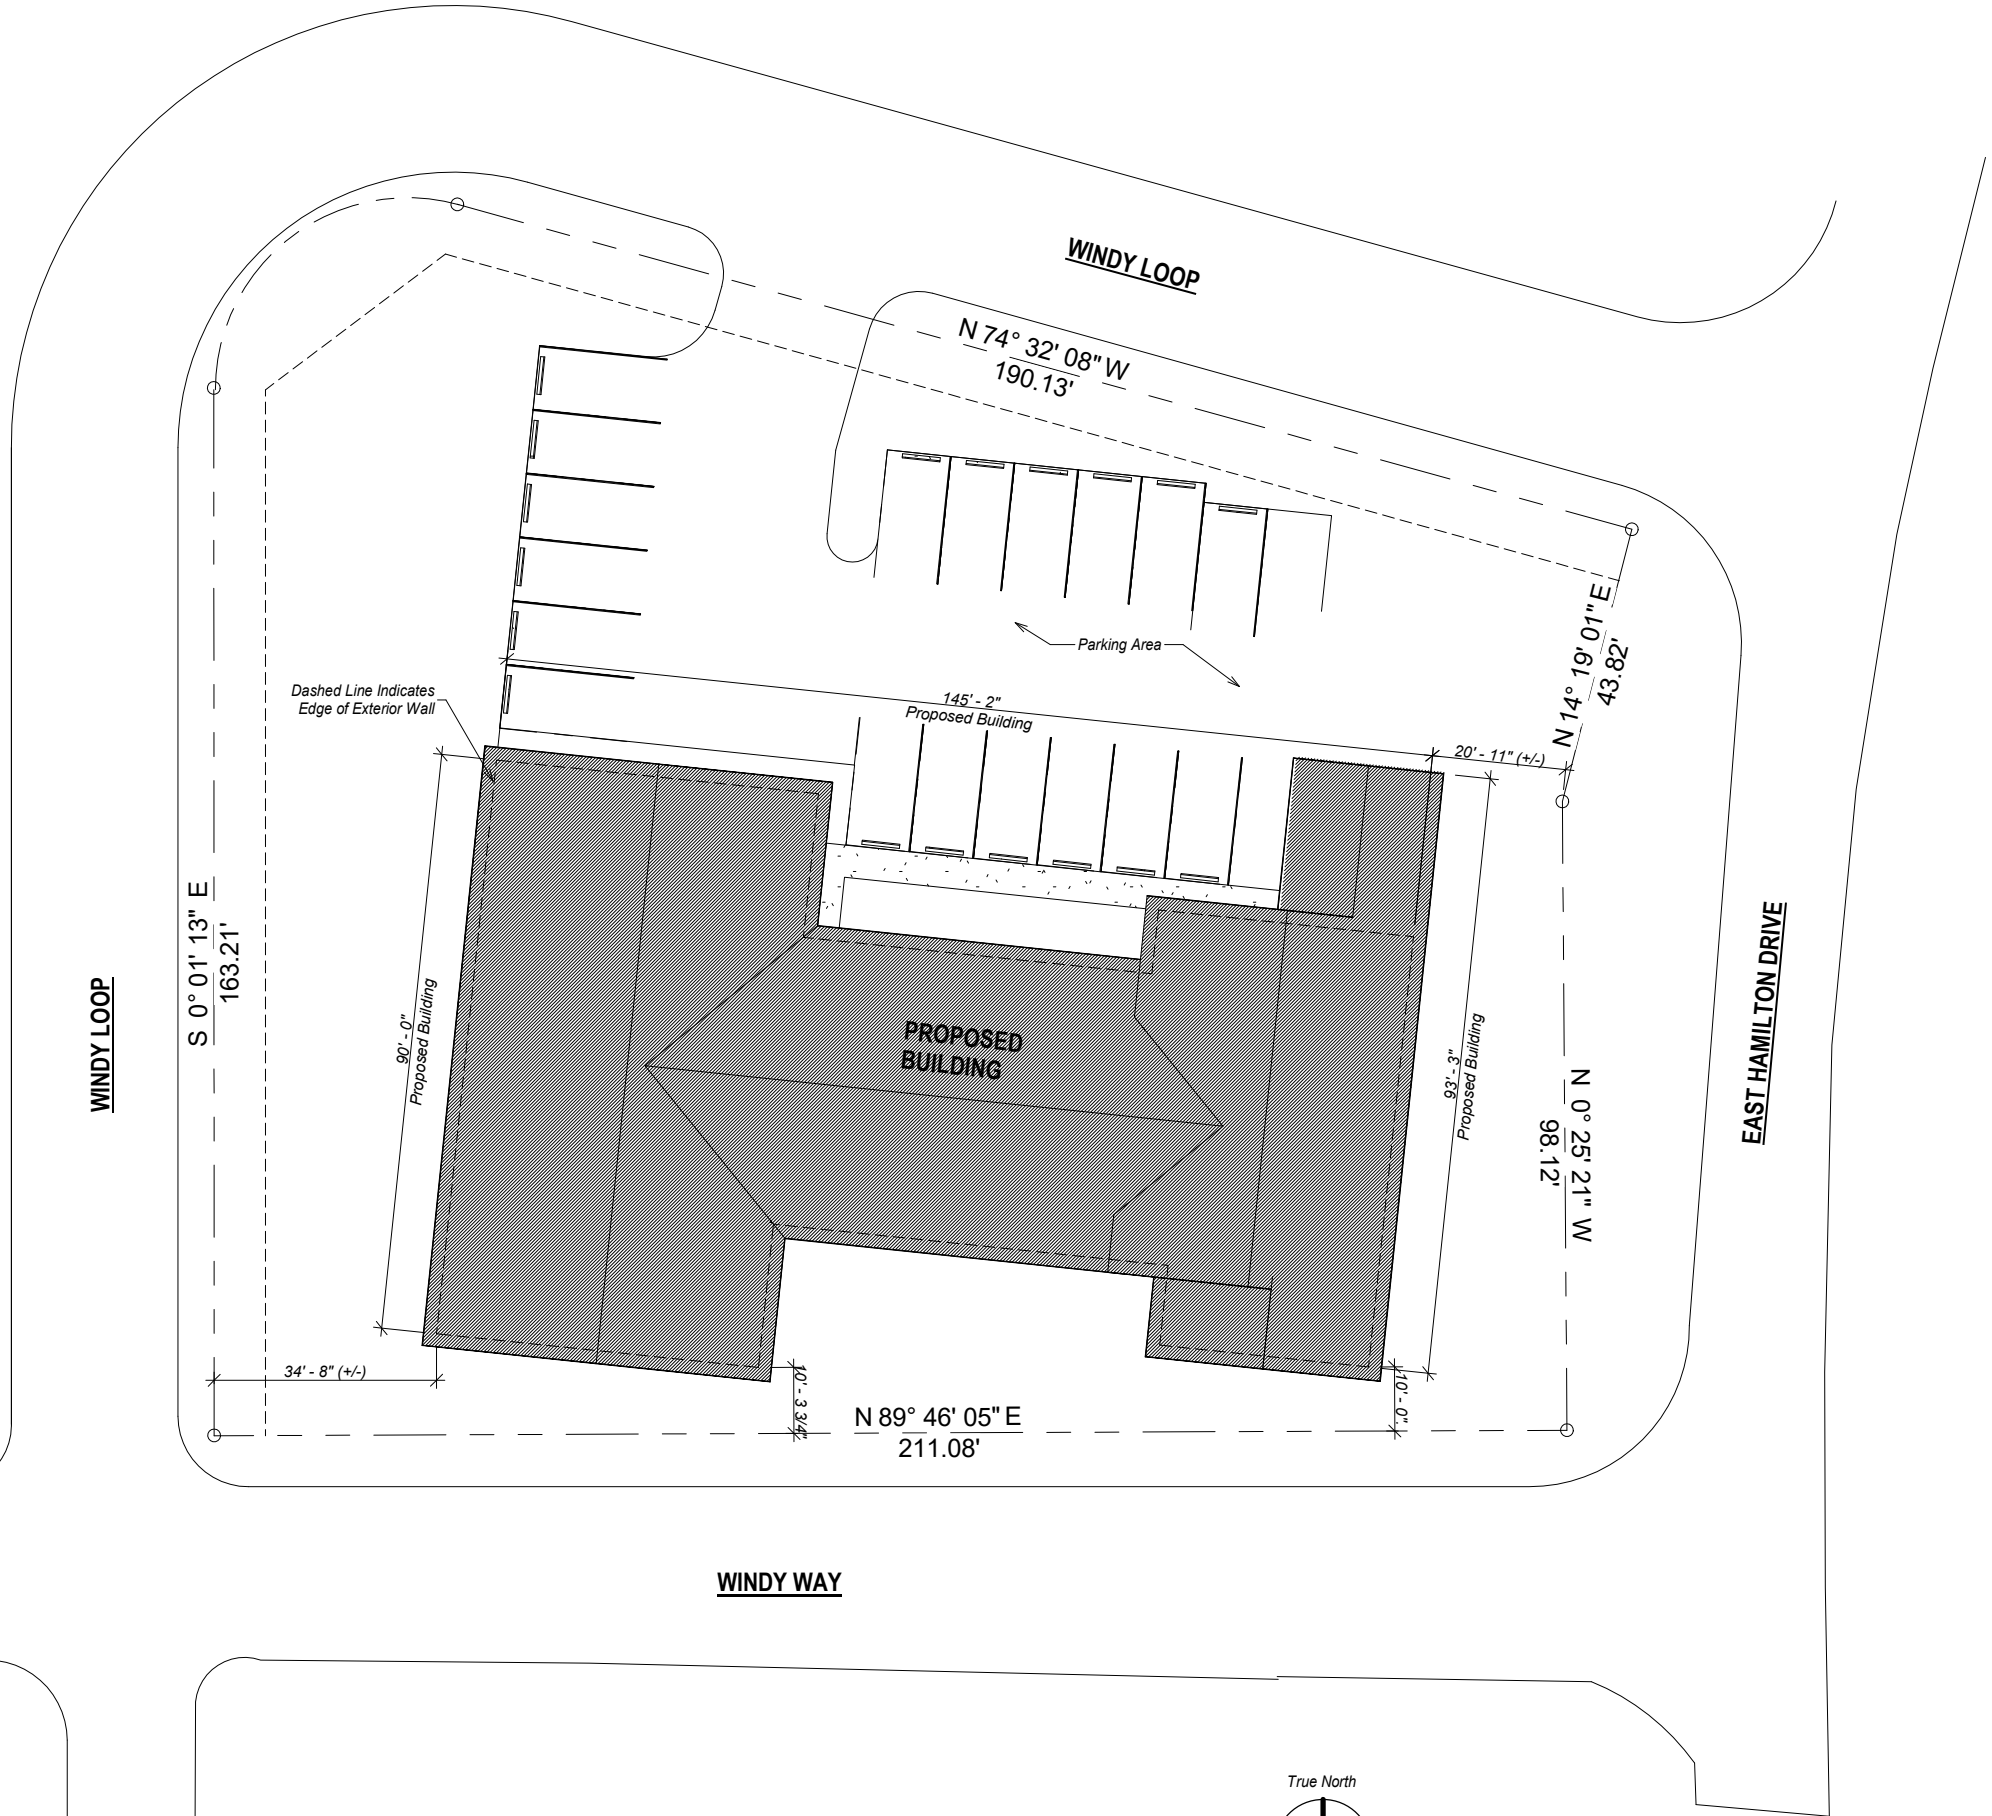

1 Site Plan
1" = 30'-0"



REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02




R&M
ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Site Plan

A100

SHEET:
06 of xx

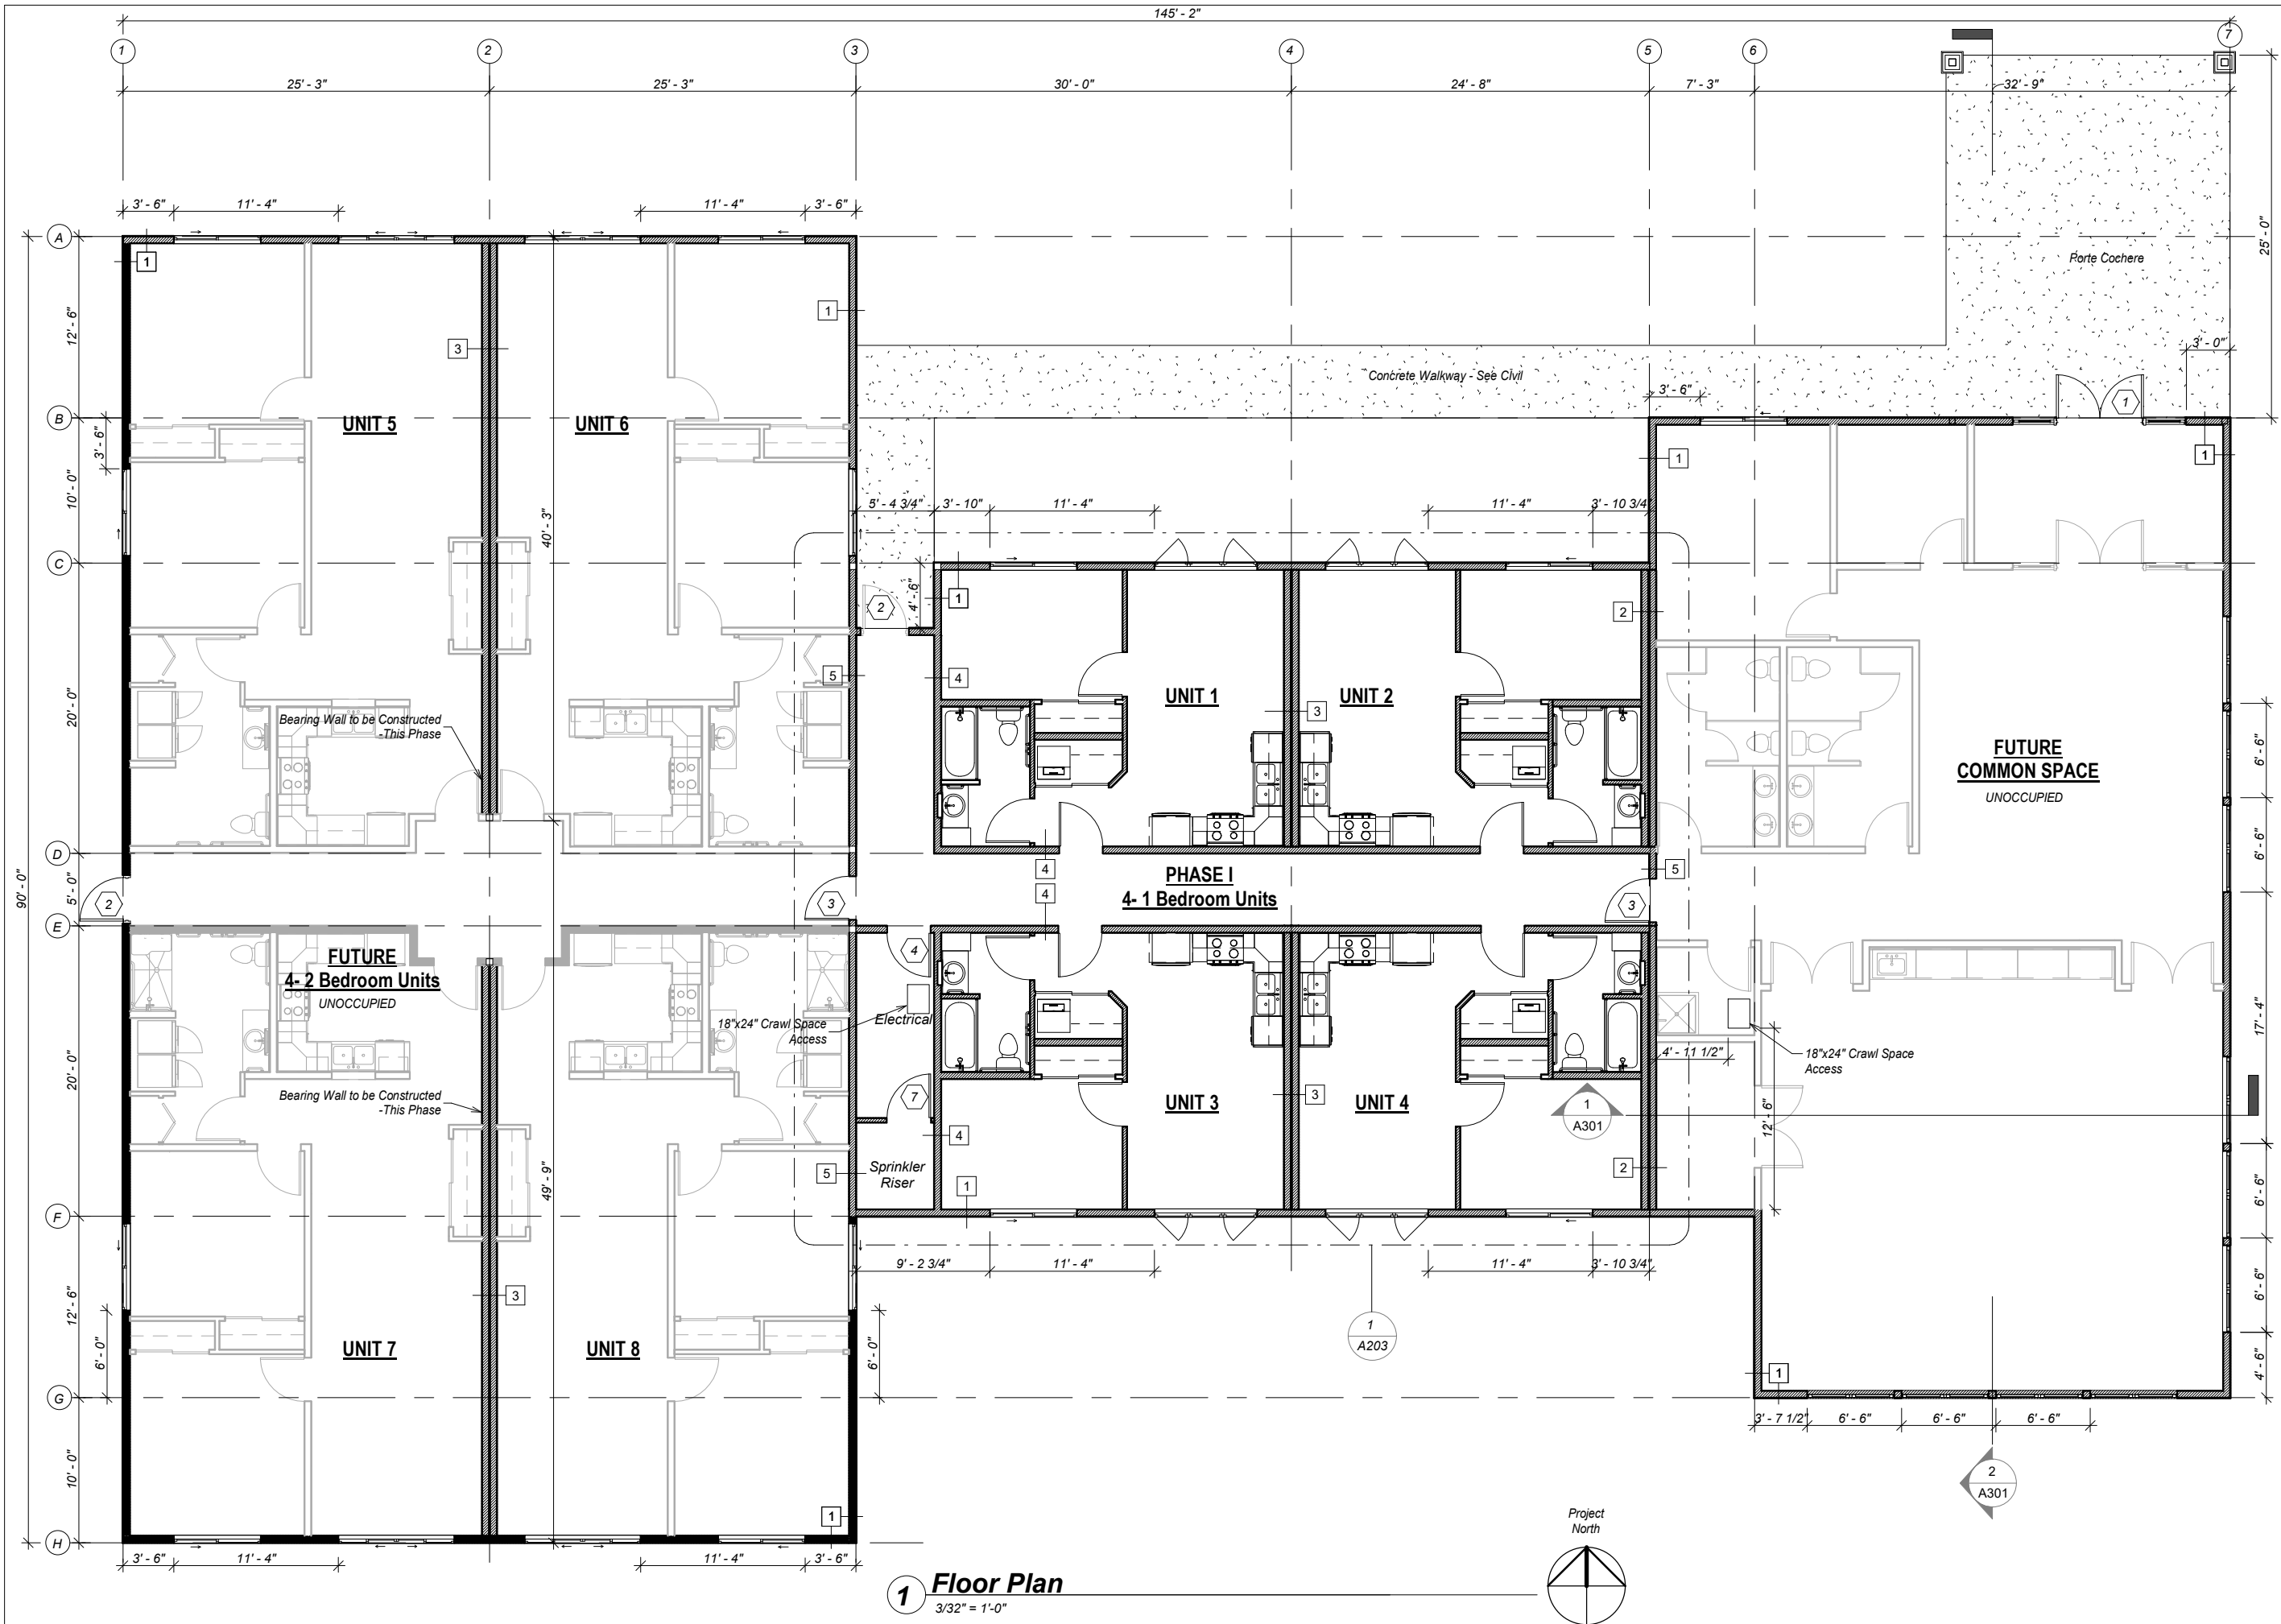

1 Floor Plan
3/32" = 1'-0"


REVISIONS:

**THRHA - Craig Senior Center
PHASE 1**

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Main Floor Plan

A200

SHEET:
07 of xx

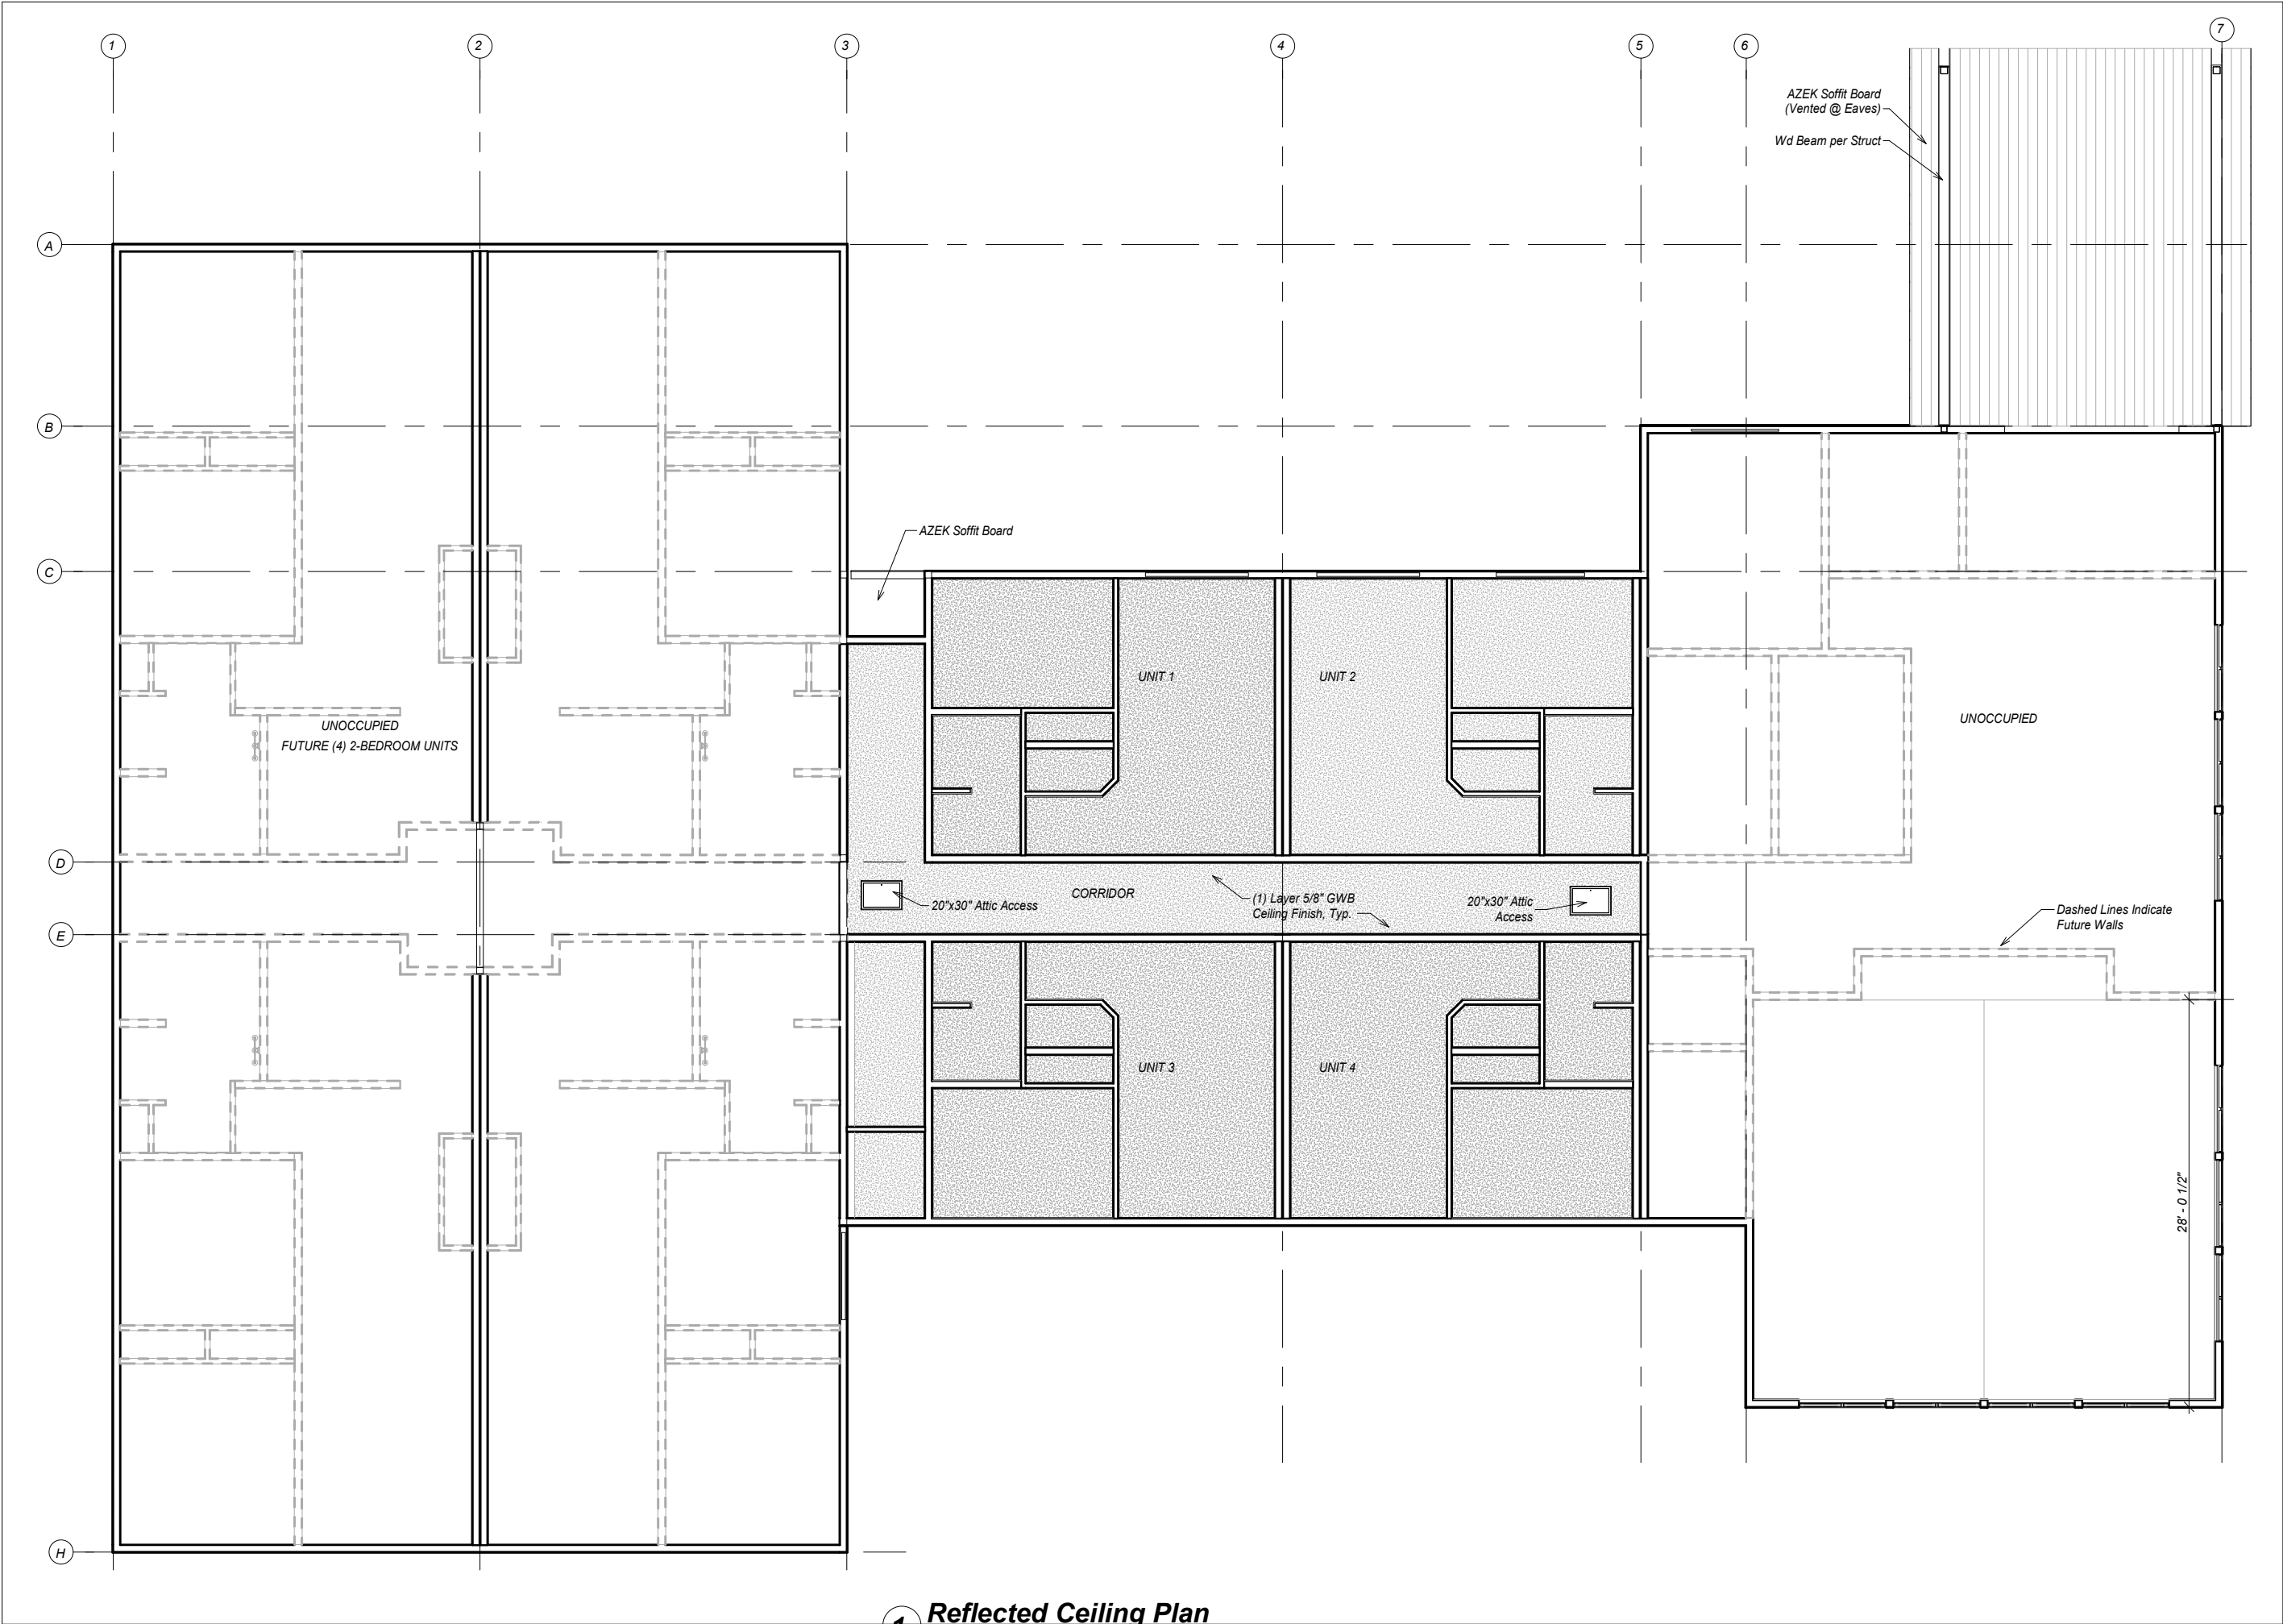

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Reflected Ceiling Plan

A201

SHEET:
08 of xx

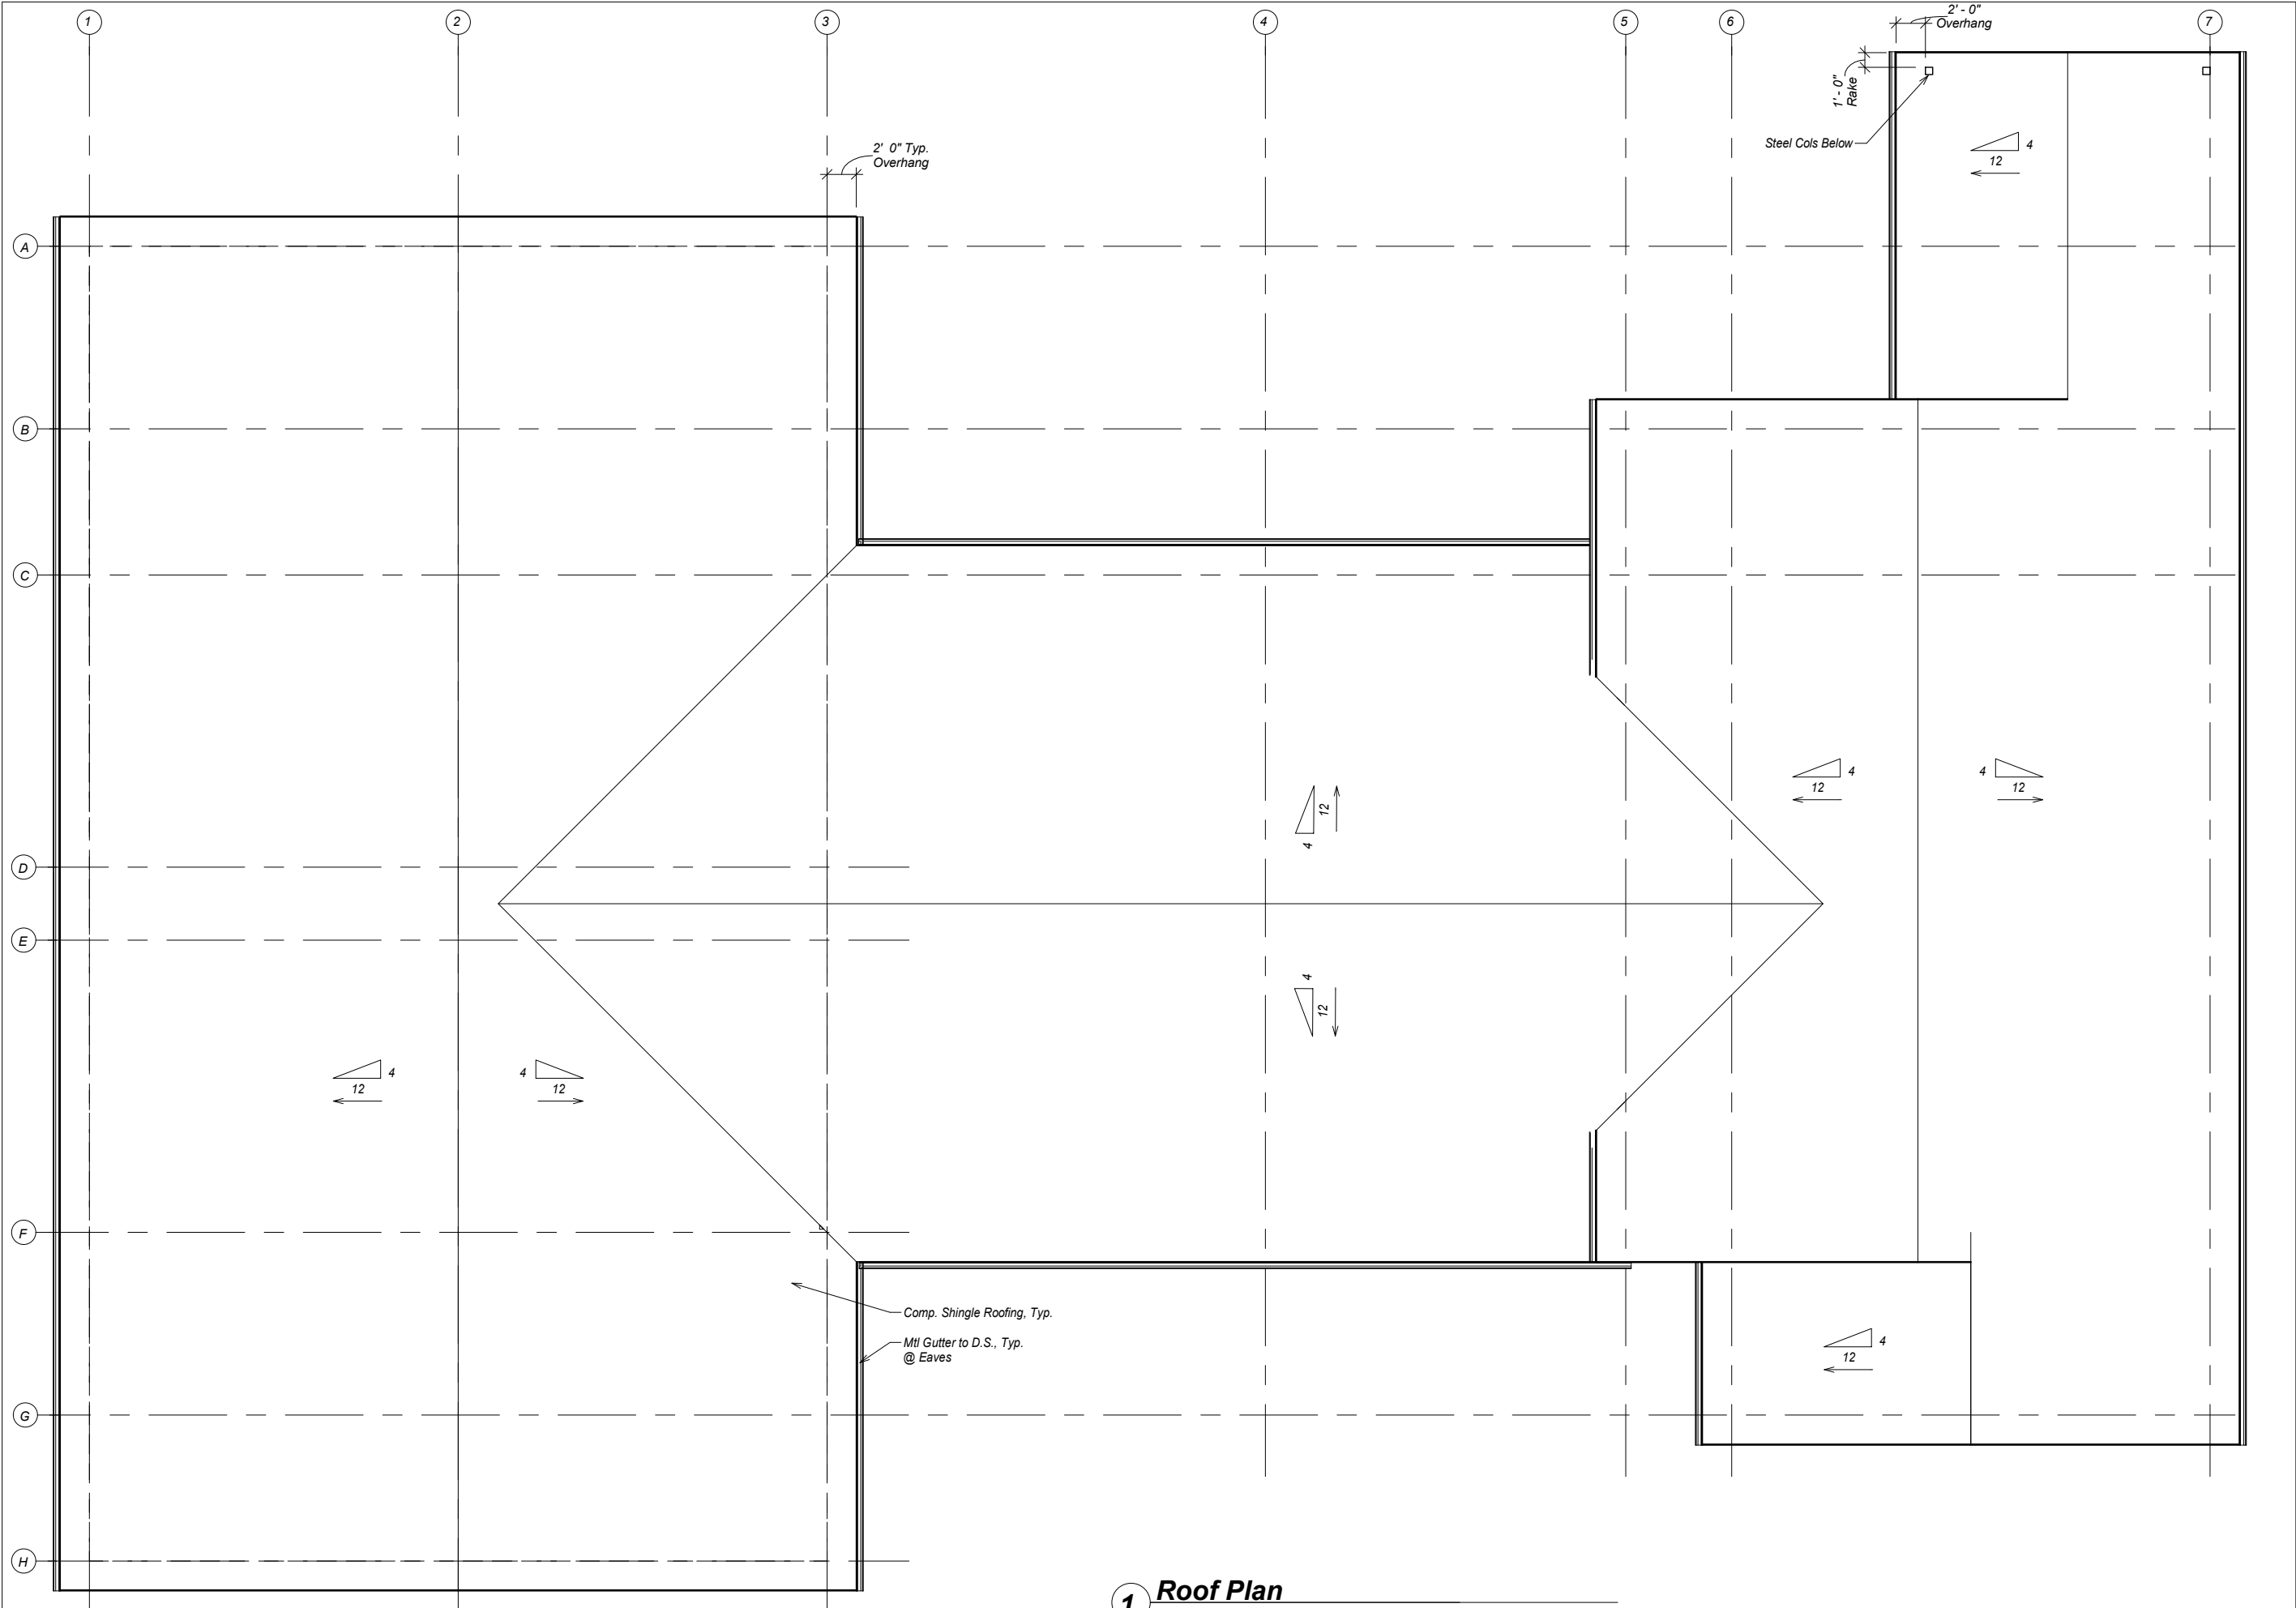

REVISIONS:


THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M


R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Roof Plan

A202

SHEET:
09 of xx

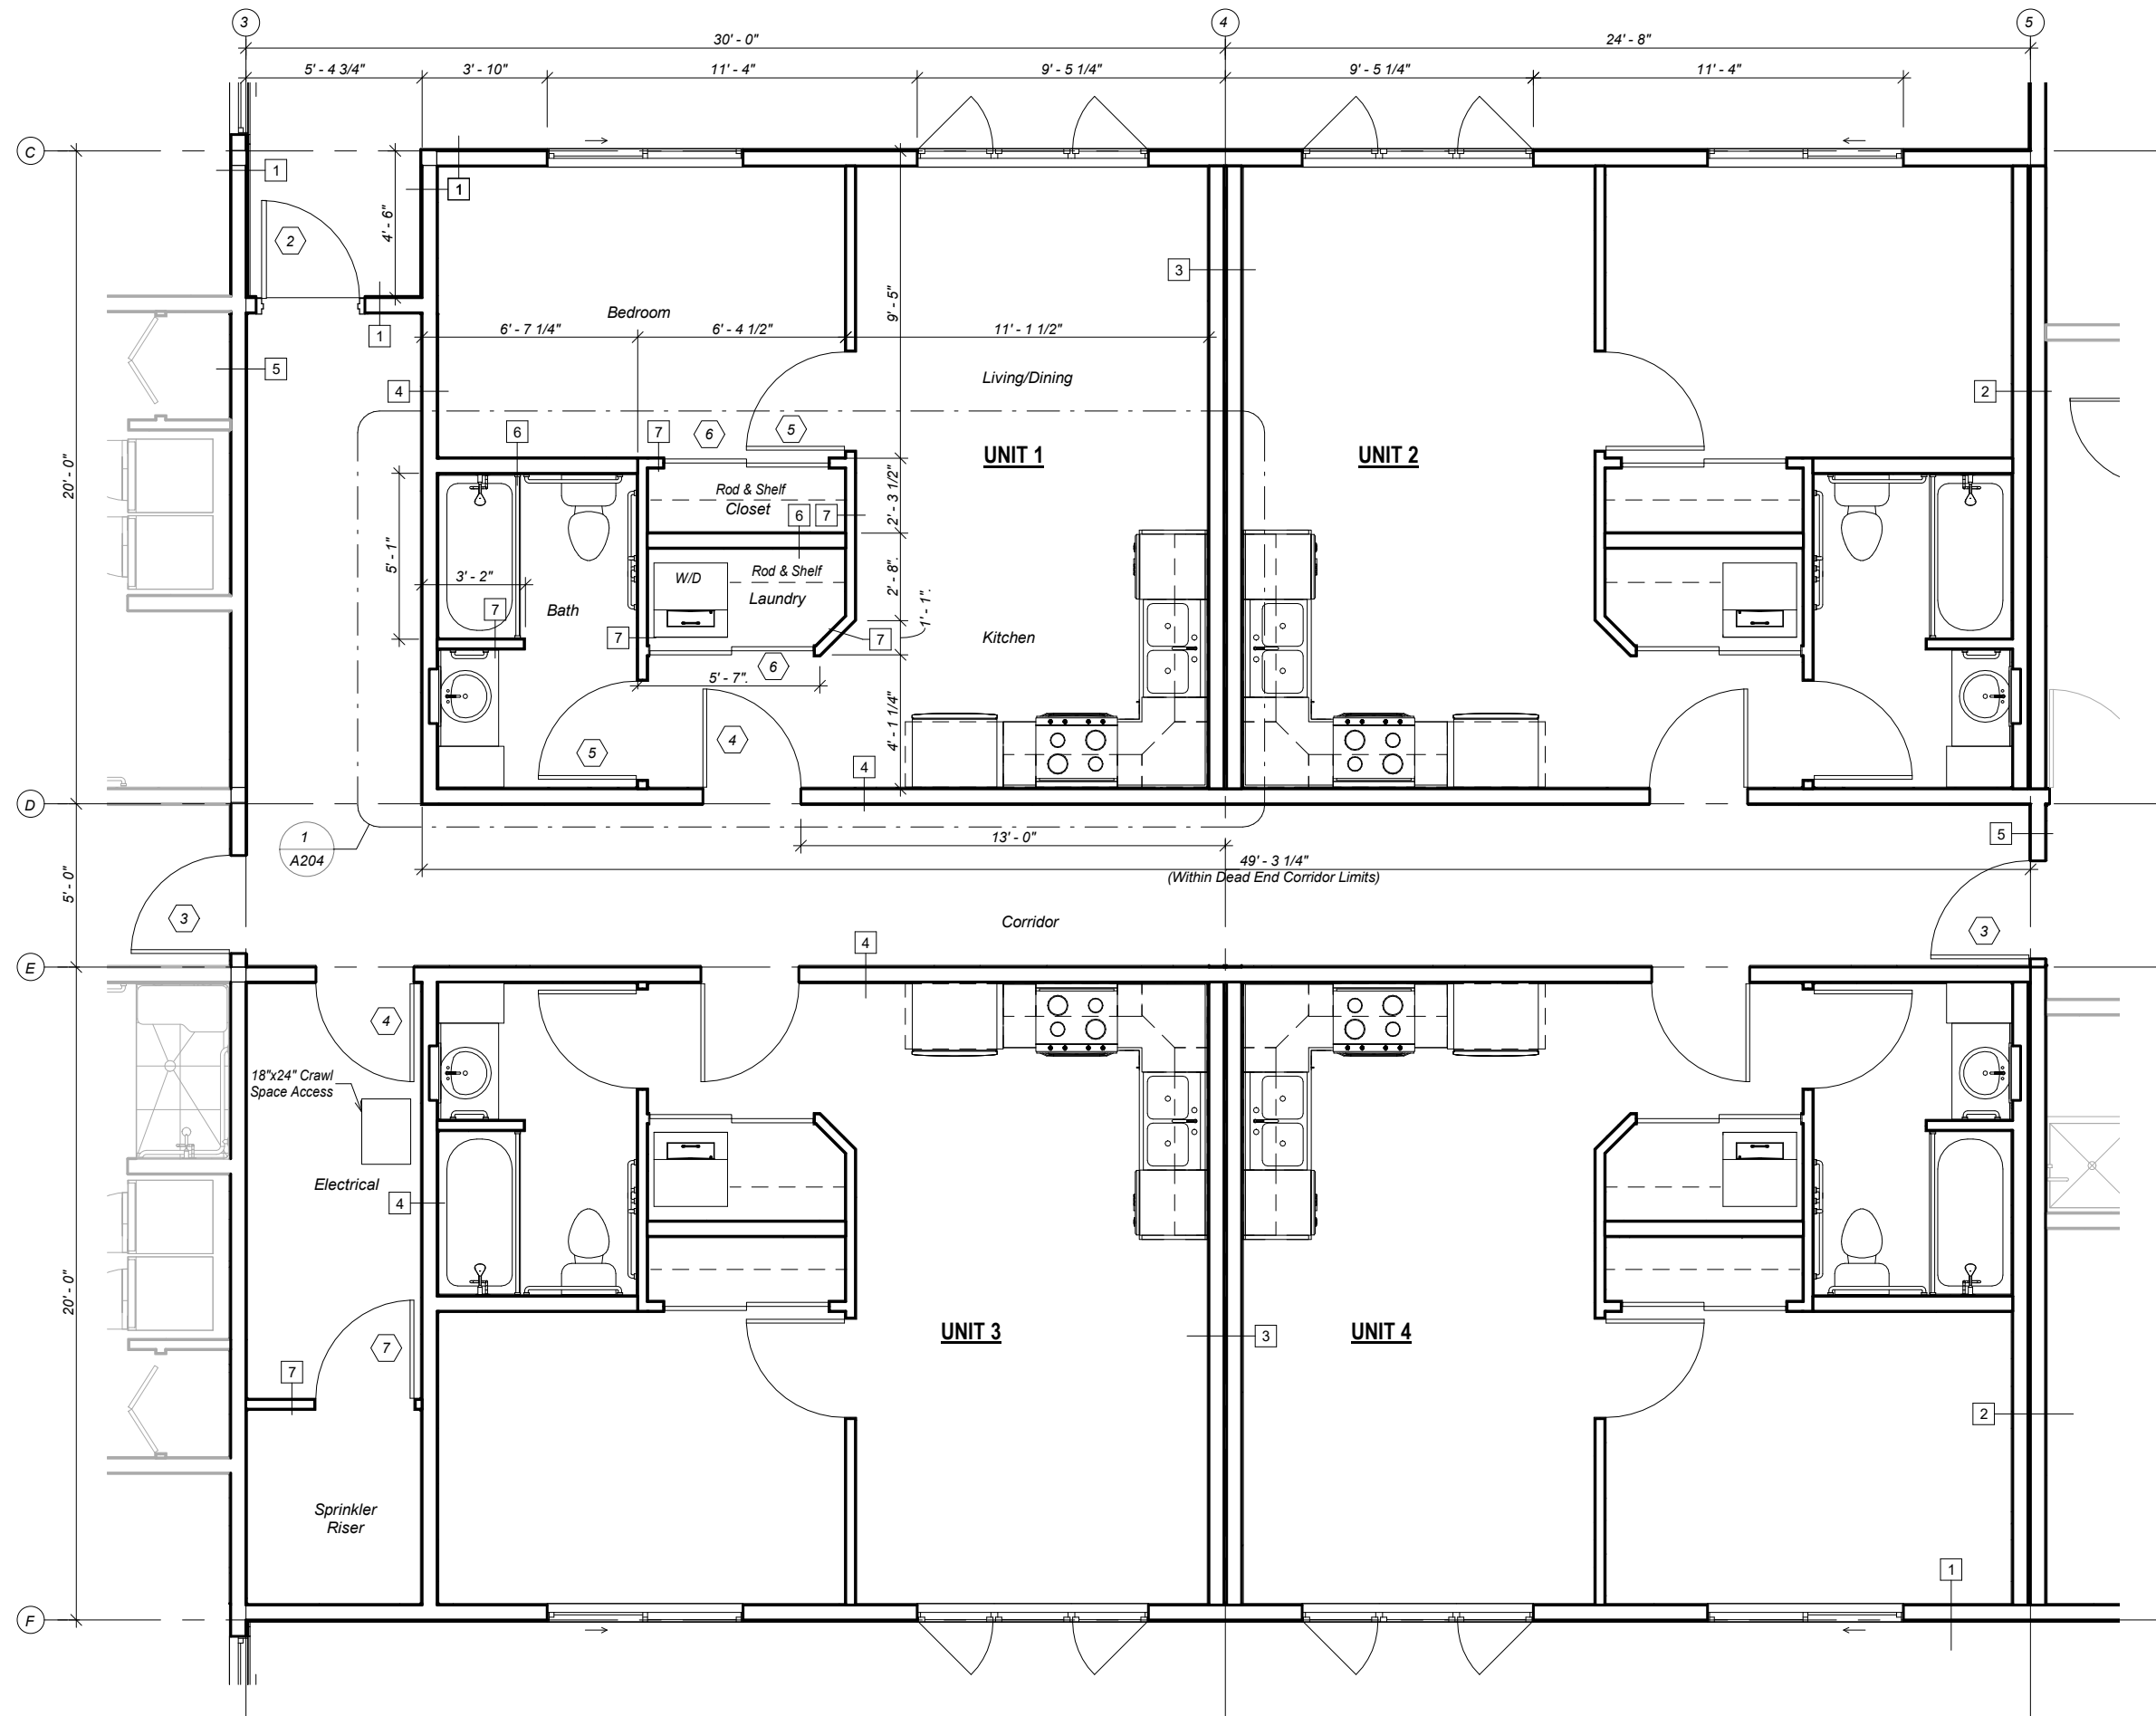

1 Partial Floor Plan - Phase 1
3/16" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:
Partial Floor Plans

A203


SHEET:
10 of xx

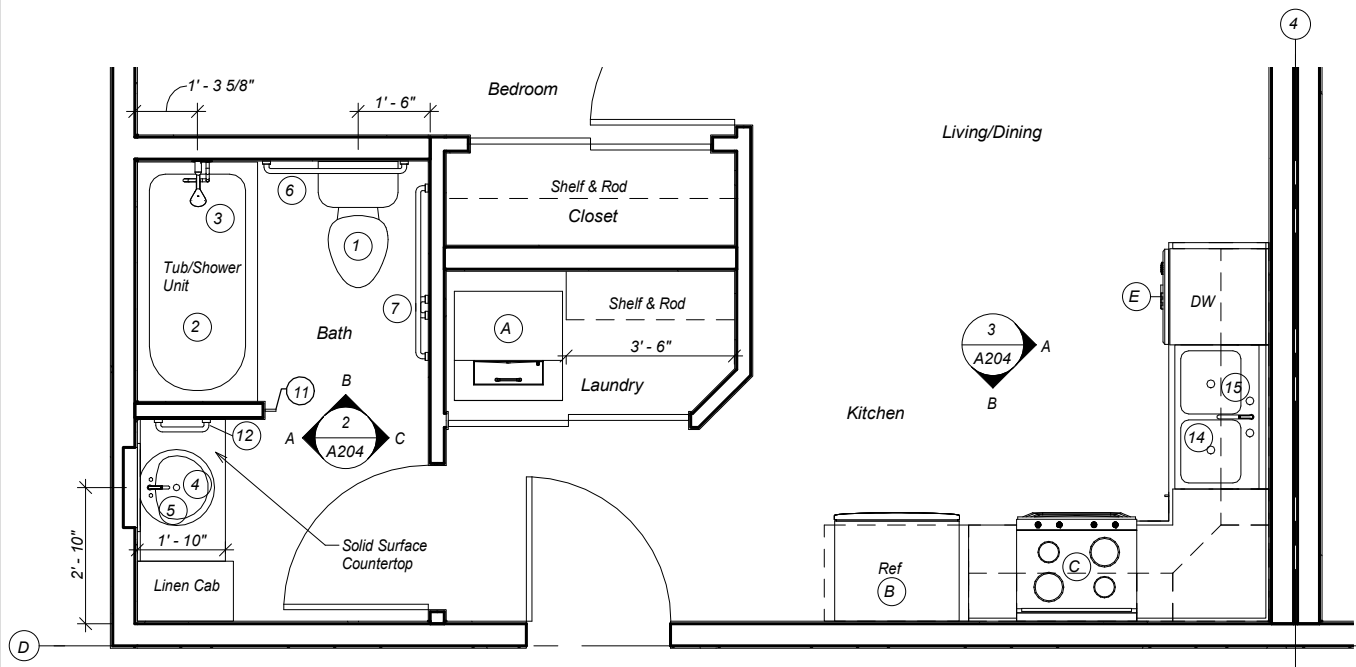

1 Kitchen & Bath - Plan
1/4" = 1'-0"

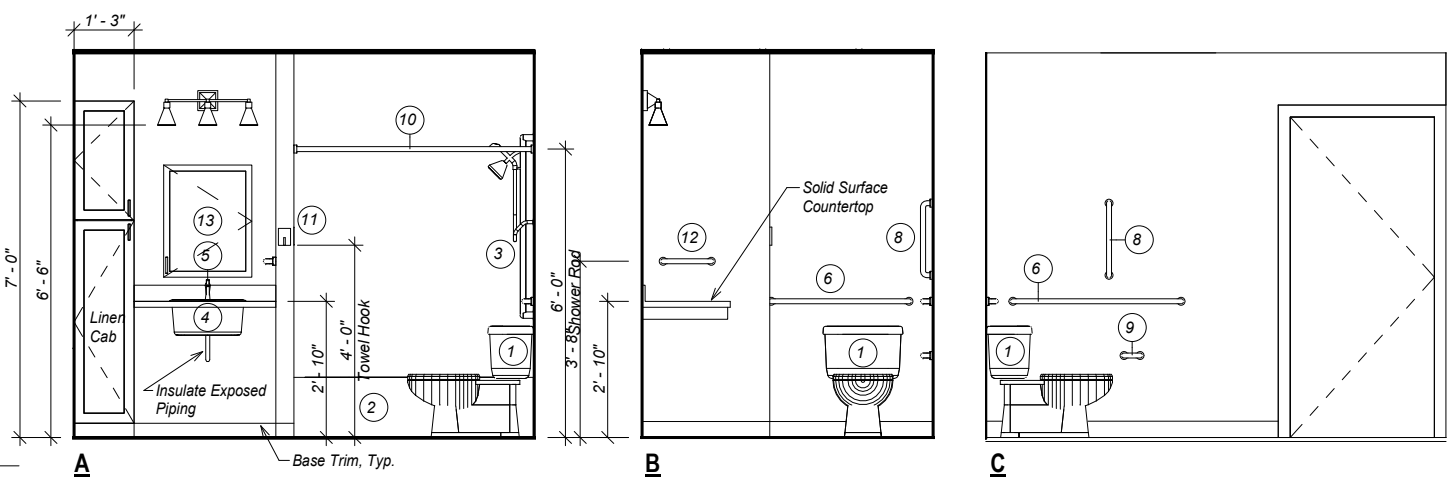


2 Interior Elevations-Bath
1/4" = 1'-0"

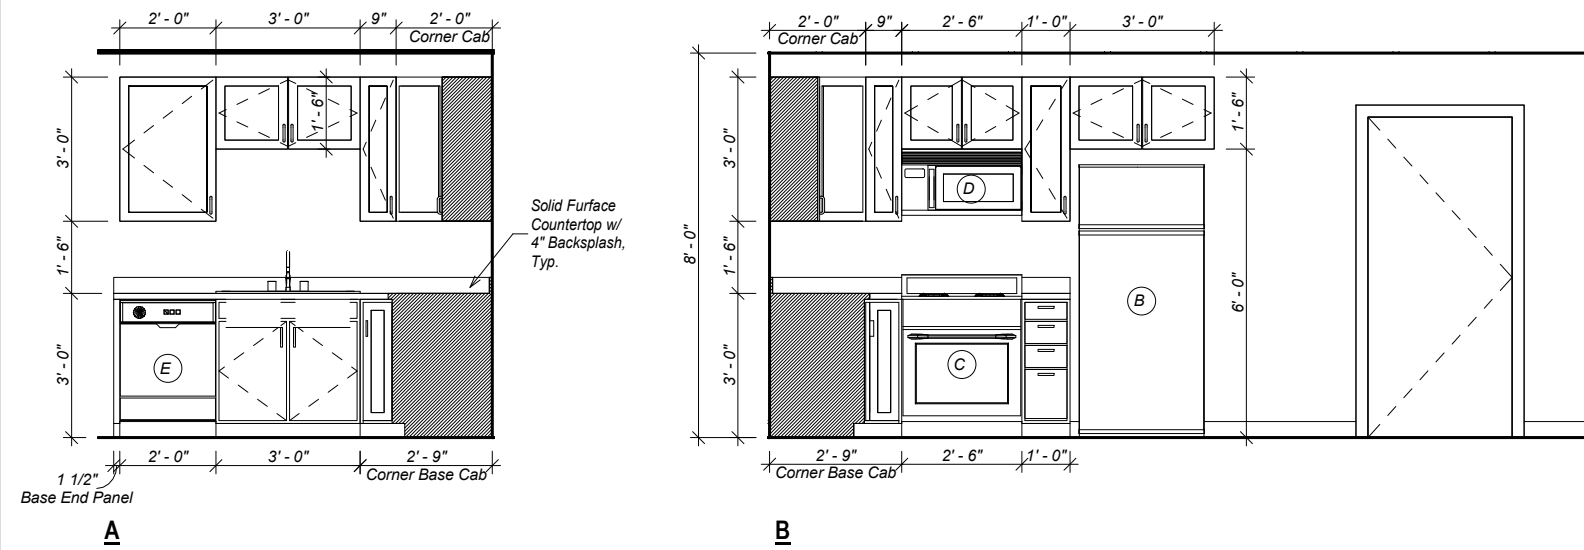


3 Interior Elevations-Kitchen
1/4" = 1'-0"

WATER CLOSET

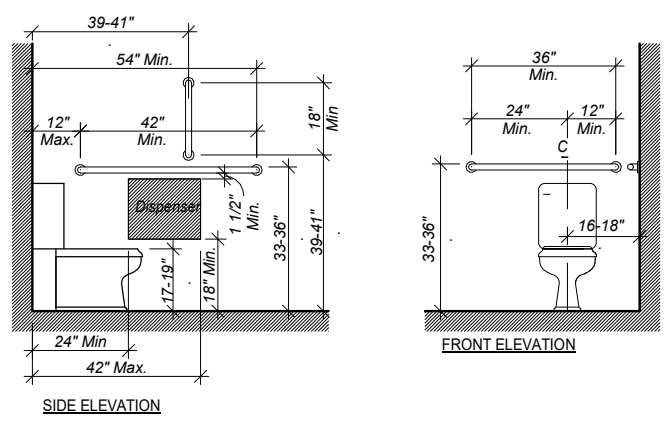

LAVATORY

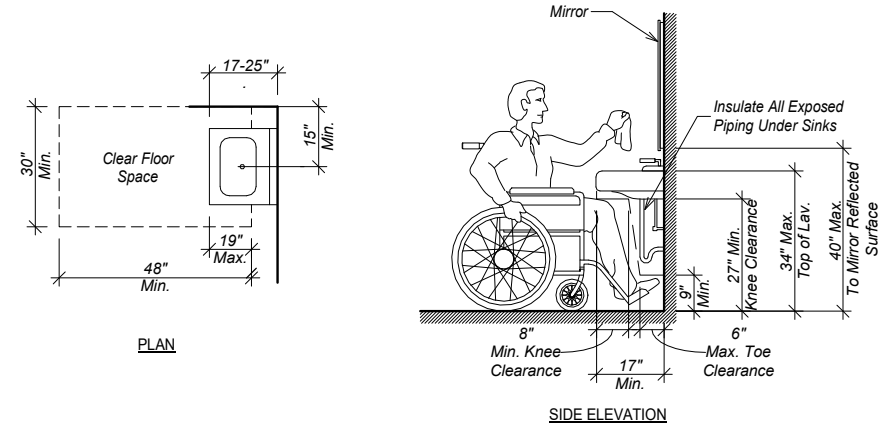

4 ADA Mounting Details.
1/4" = 1'-0"

Plumbing Fixture & Accessory Schedule

Type Mark	Description	Dimensions (WxDxH)	Manufacturer	Model	Remarks
1	Toilet, Insulated		Kohler	K-3999-U	
2	Tub	60"x30"x17-3/4"	American Standard	2973102.020	Include 5-Piece Bath Wall Set 2968BWT60
3	ADA Shower/Bath Faucet		American Standard	TU105508	
4	Lavatory		American Standard	0614.300	
5	Vanity Faucet		American Standard	7105857	
6	36" Grab Bar		Bobrick	5806x36	
7	42" Grab Bar		Bobrick	5806x42	
8	18" Grab Bar		Bobrick	5806x18	
9	Toilet Paper Holder		American Standard	7105230.002	
10	60" Shower Rod		Bobrick	B-6107x60	
11	Robe/Towel Hook		American Standard	7105210.002	
12	Towel Ring		American Standard	7105190	
13	Medicine Cabinet, Recessed	20"x26"x3-5/8"	Kohler	K-CB-CLW2026SS	
14	Kitchen Sink		Kohler	K-3145-4	
15	Kitchen Faucet		American Standard	4803300.002	

Appliance Schedule

Type Mark	Description	Dimensions (WxDxH)	Manufacturer	Model	Remarks
A	Stacked Washer/Dryer	23-7/8"x26-5/8"x74-1/4"	Whirlpool	WET4024HW	
B	Refrigerator	31-1/10"x27"x67-9/10"	GE	GBE17HYR	
C	30" Range, Electric	29 3/4"x36"x26 7/16"	GE	JS645SLSS	
D	Combo Microwave/Exhaust Hood	29 7/8"x15 1/4"x15 3/4"	GE	JVM3160RFSS	
E	Dishwasher	23 3/4"x23 1/2"x32 1/4"	GE	GDF460PTSS	


REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:
Enlarged Plans & Interior
Elevations

A204

SHEET:
11 of xx

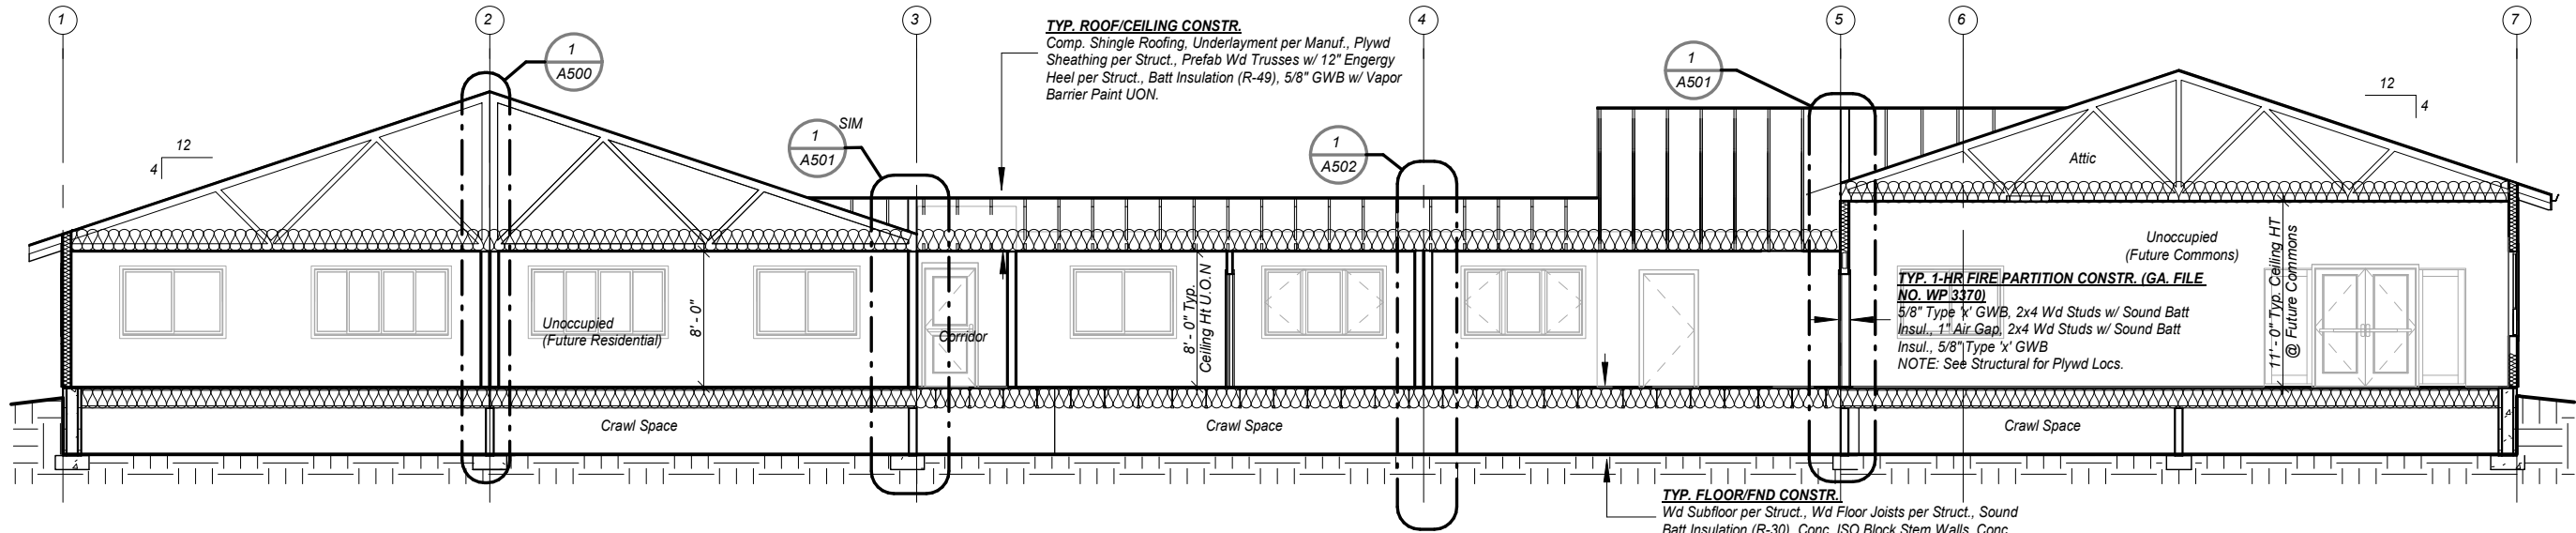

1 Section 1
3/32" = 1'-0"

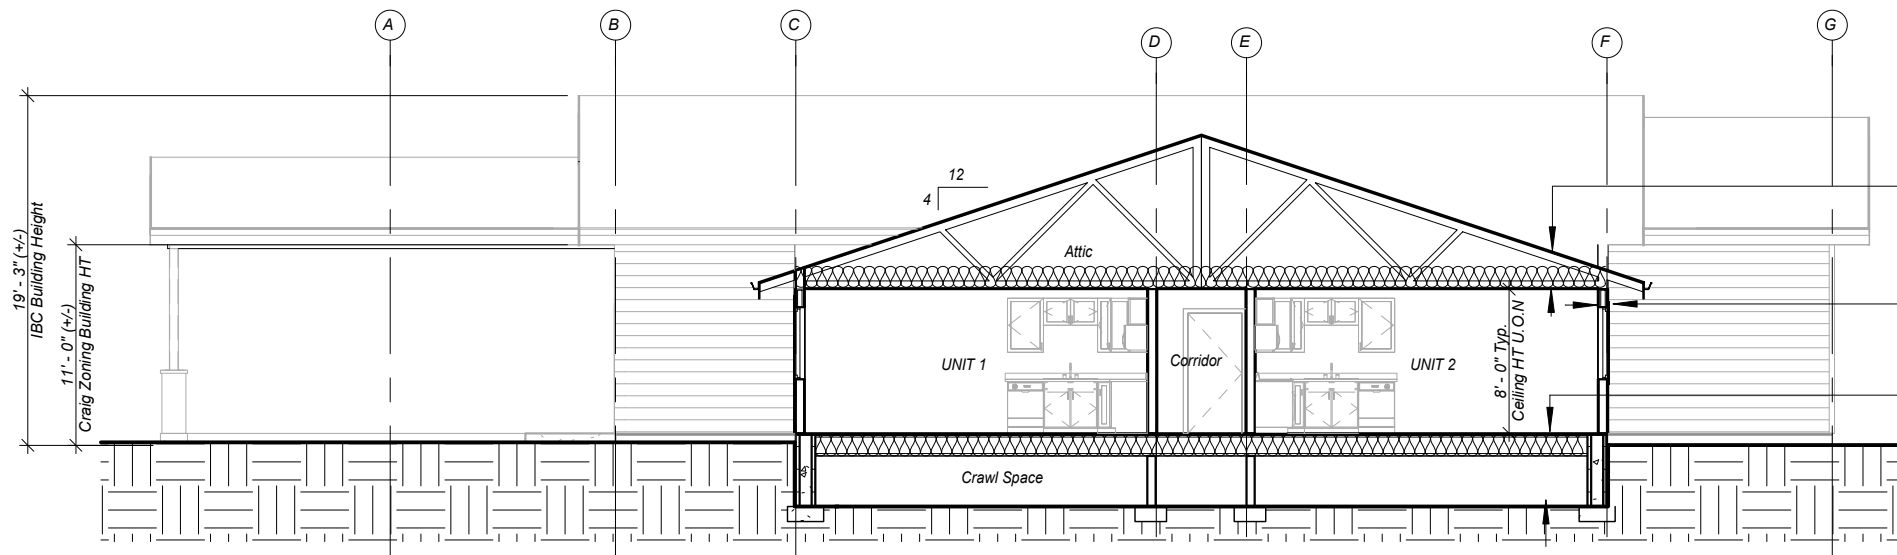

2 Section 2
3/32" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Sections

A300

SHEET:


12 of xx

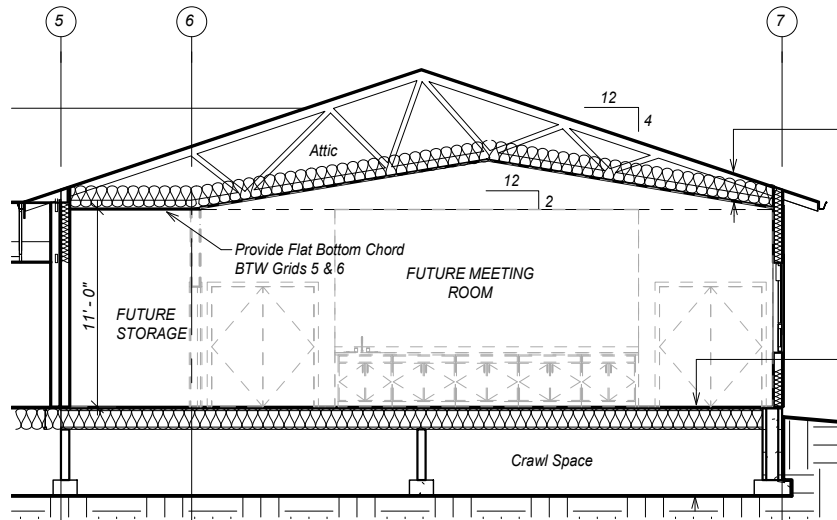

TYP. CEILING/ROOF CONSTR. @ FUTURE MEETING ROOM
Comp. Shingle Roofing, Underlayment per Manuf., Plywd Sheathing per Struct., Wd Scissor Trusses w/ 12" Energy Heel, Batt Insulation (R-49) 5/8" Gyp. Bd w/ Vapor Barrier Paint

TYP. FLOOR/FND CONSTR.
Wd Subfloor per Struct., Wd Floor Joists per Struct., Sound Batt Insulation (R-30), Conc. ISO Block Stem Walls, Conc. FTG's per Struct., 10 Mil Vapor Barrier

1 Section 3
3/32" = 1'-0"

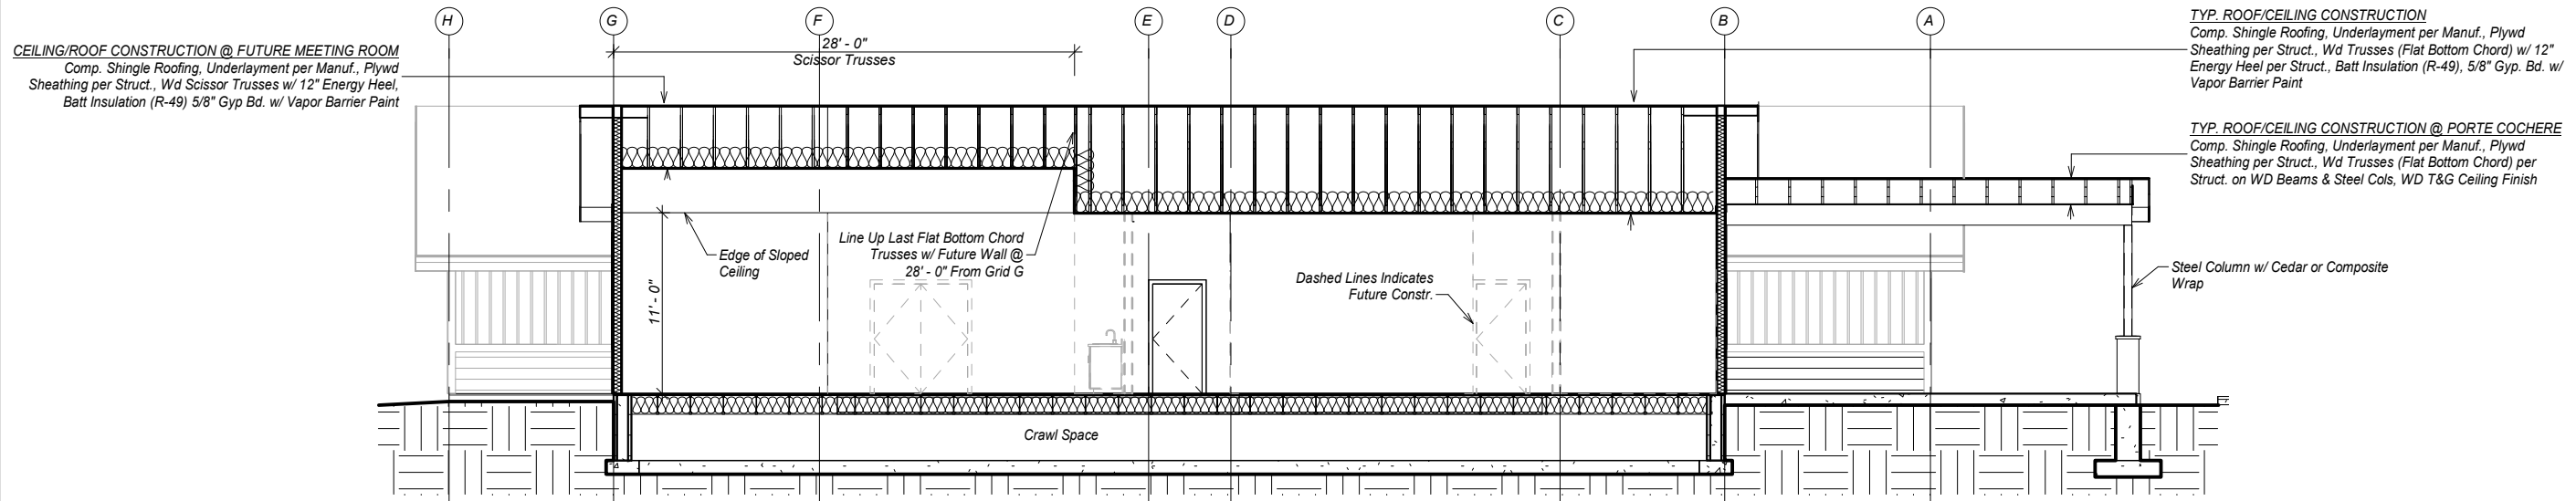

CEILING/ROOF CONSTRUCTION @ FUTURE MEETING ROOM
Comp. Shingle Roofing, Underlayment per Manuf., Plywd Sheathing per Struct., Wd Scissor Trusses w/ 12" Energy Heel, Batt Insulation (R-49) 5/8" Gyp. Bd. w/ Vapor Barrier Paint

TYP. ROOF/CEILING CONSTRUCTION
Comp. Shingle Roofing, Underlayment per Manuf., Plywd Sheathing per Struct., Wd Trusses (Flat Bottom Chord) w/ 12" Energy Heel per Struct., Batt Insulation (R-49), 5/8" Gyp. Bd. w/ Vapor Barrier Paint

TYP. ROOF/CEILING CONSTRUCTION @ PORTE COCHERE
Comp. Shingle Roofing, Underlayment per Manuf., Plywd Sheathing per Struct., Wd Trusses (Flat Bottom Chord) per Struct. on WD Beams & Steel Cols, WD T&G Ceiling Finish

2 Section 4
3/32" = 1'-0"

REVISIONS:


THRHA - Craig Senior Center
PHASE 1

STATUS:

**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Sections


A301

SHEET:


13 of xx

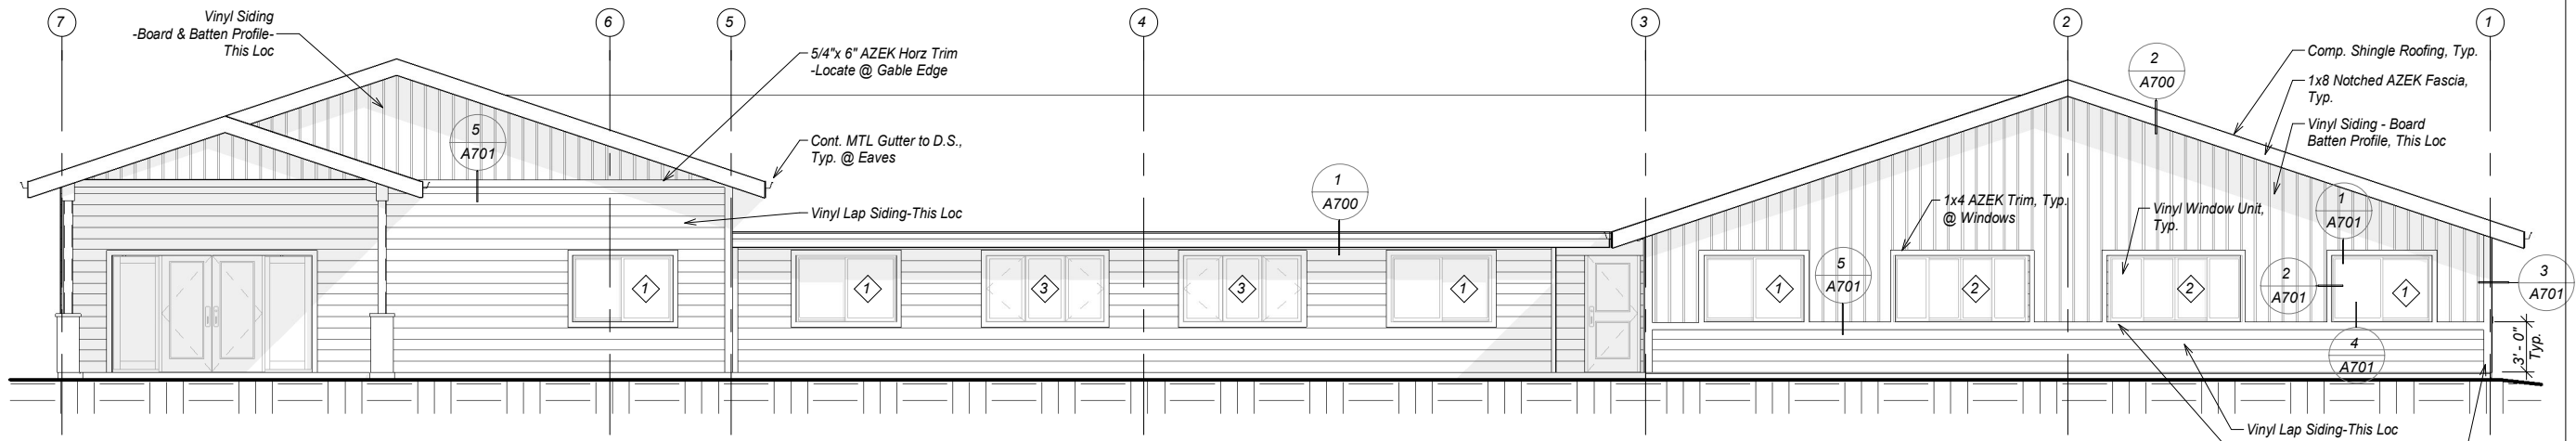

1 North Elevation
3/32" = 1'-0"

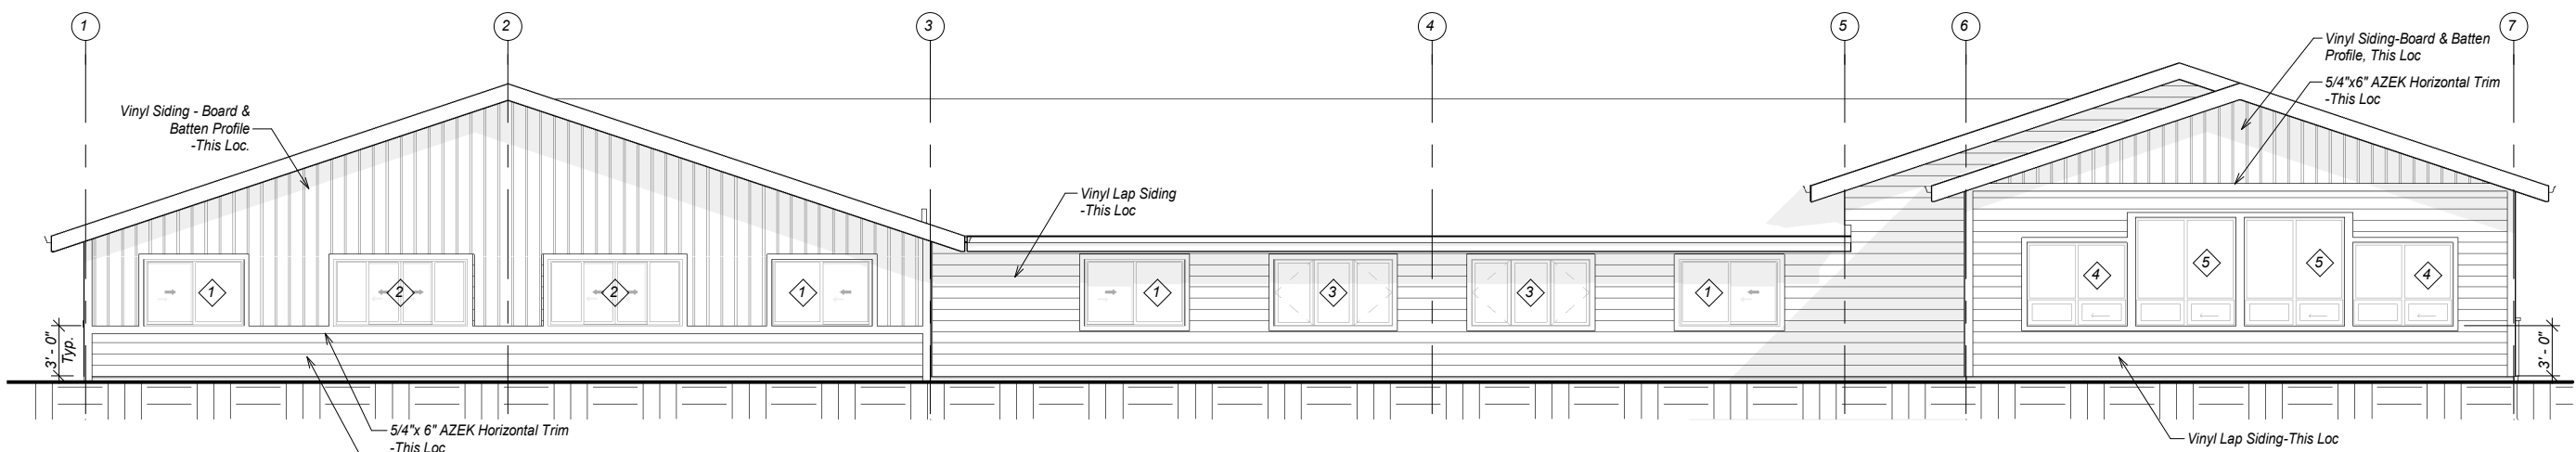

2 South Elevation
3/32" = 1'-0"

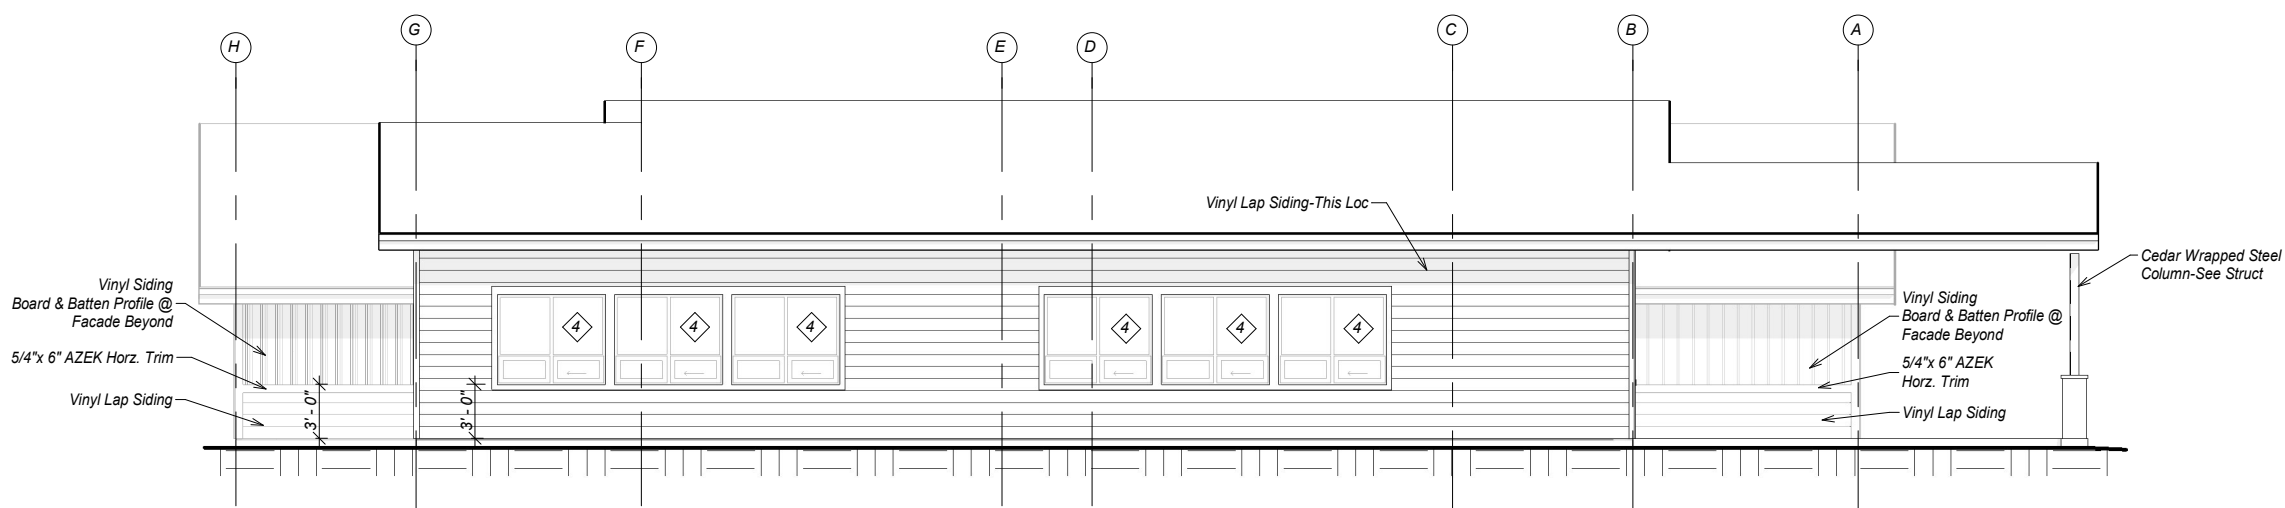

3 East Elevation
3/32" = 1'-0"


REVISIONS:

**THRHA - Craig Senior Center
PHASE 1**

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Elevations

A400

SHEET:
14 of xx

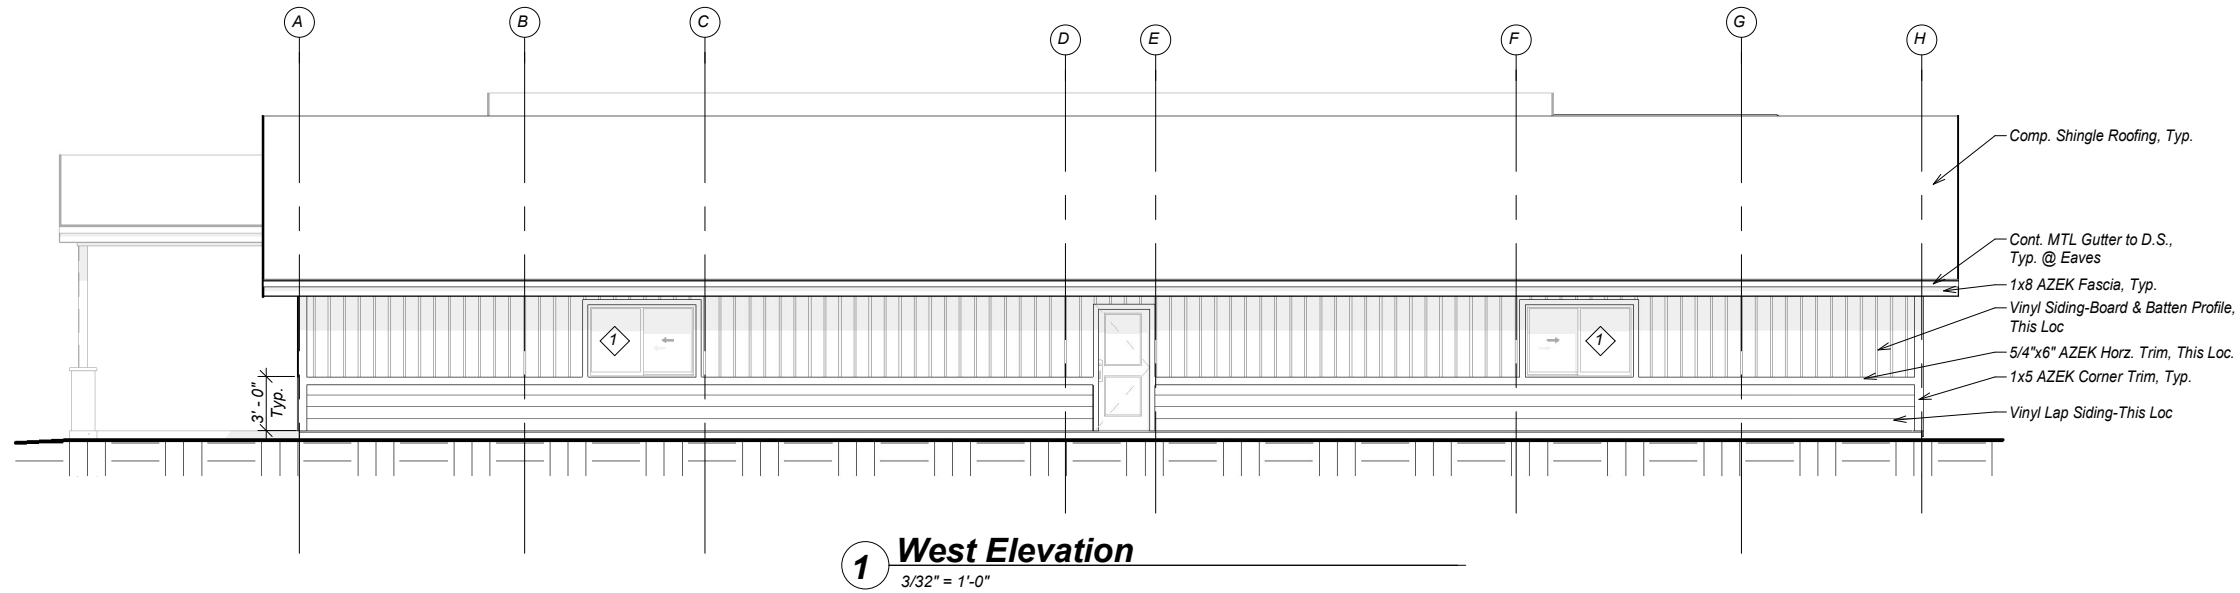

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:
Elevations

A401

SHEET:
15 of xx

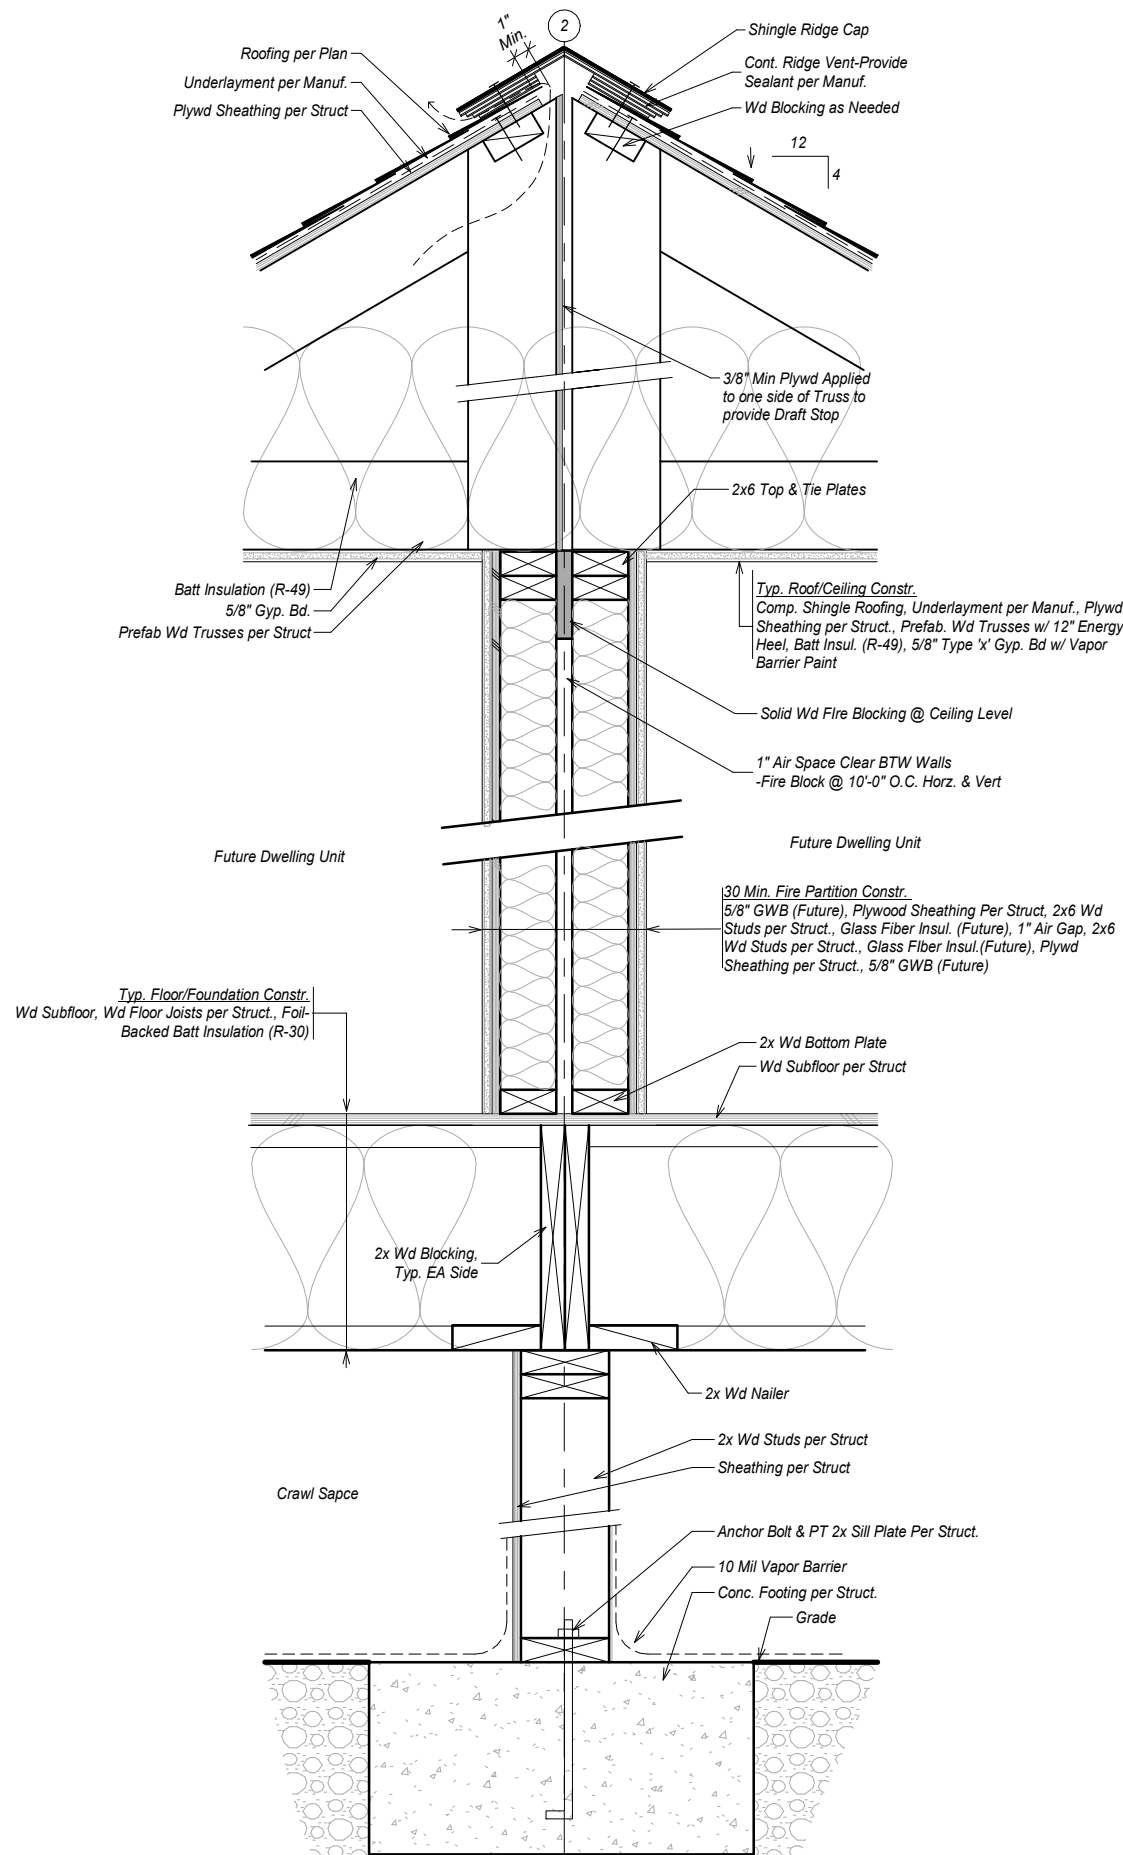

1 Fire Partition @ Grid 2
1" = 1'-0"

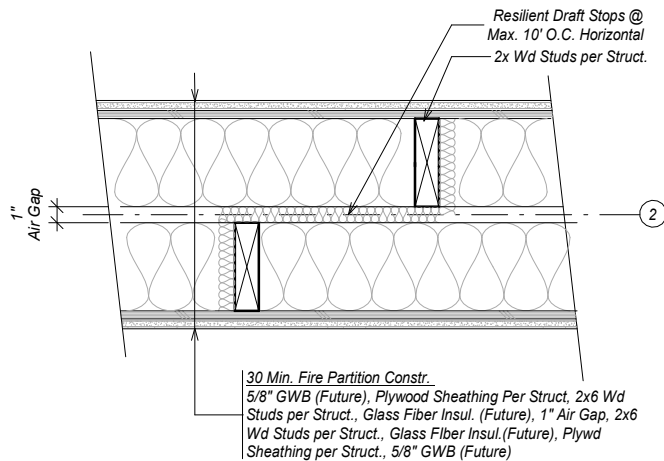

Draft Stop Detail

REVISIONS:

**THRHA - Craig Senior Center
PHASE 1**

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02


R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Wall Sections

A500

SHEET:
16 of xx

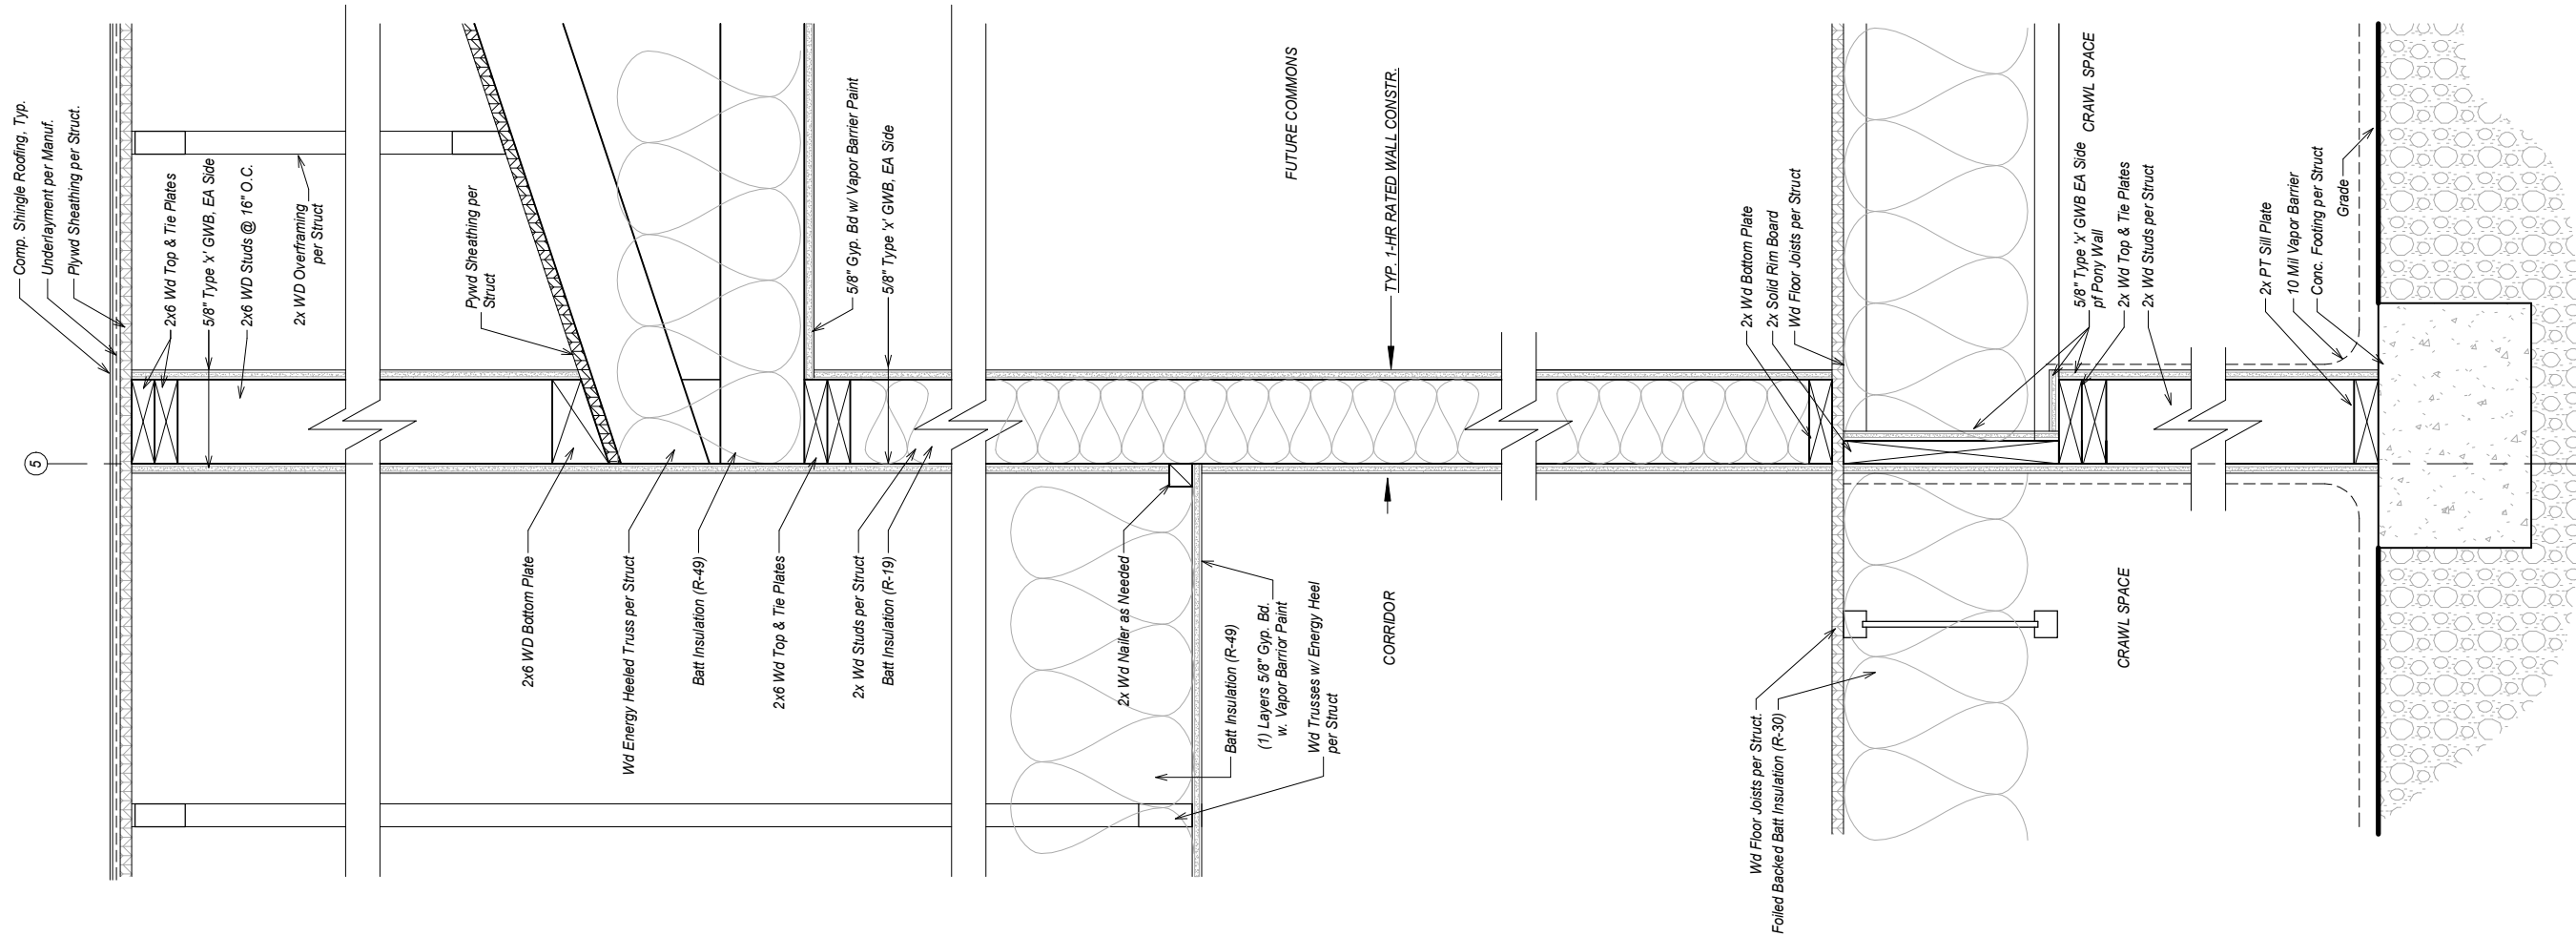

1 Wall Section @ Grid 5 (Grid 3 SIM)
1" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M

R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Wall Sections

A501

SHEET:
17 of xx

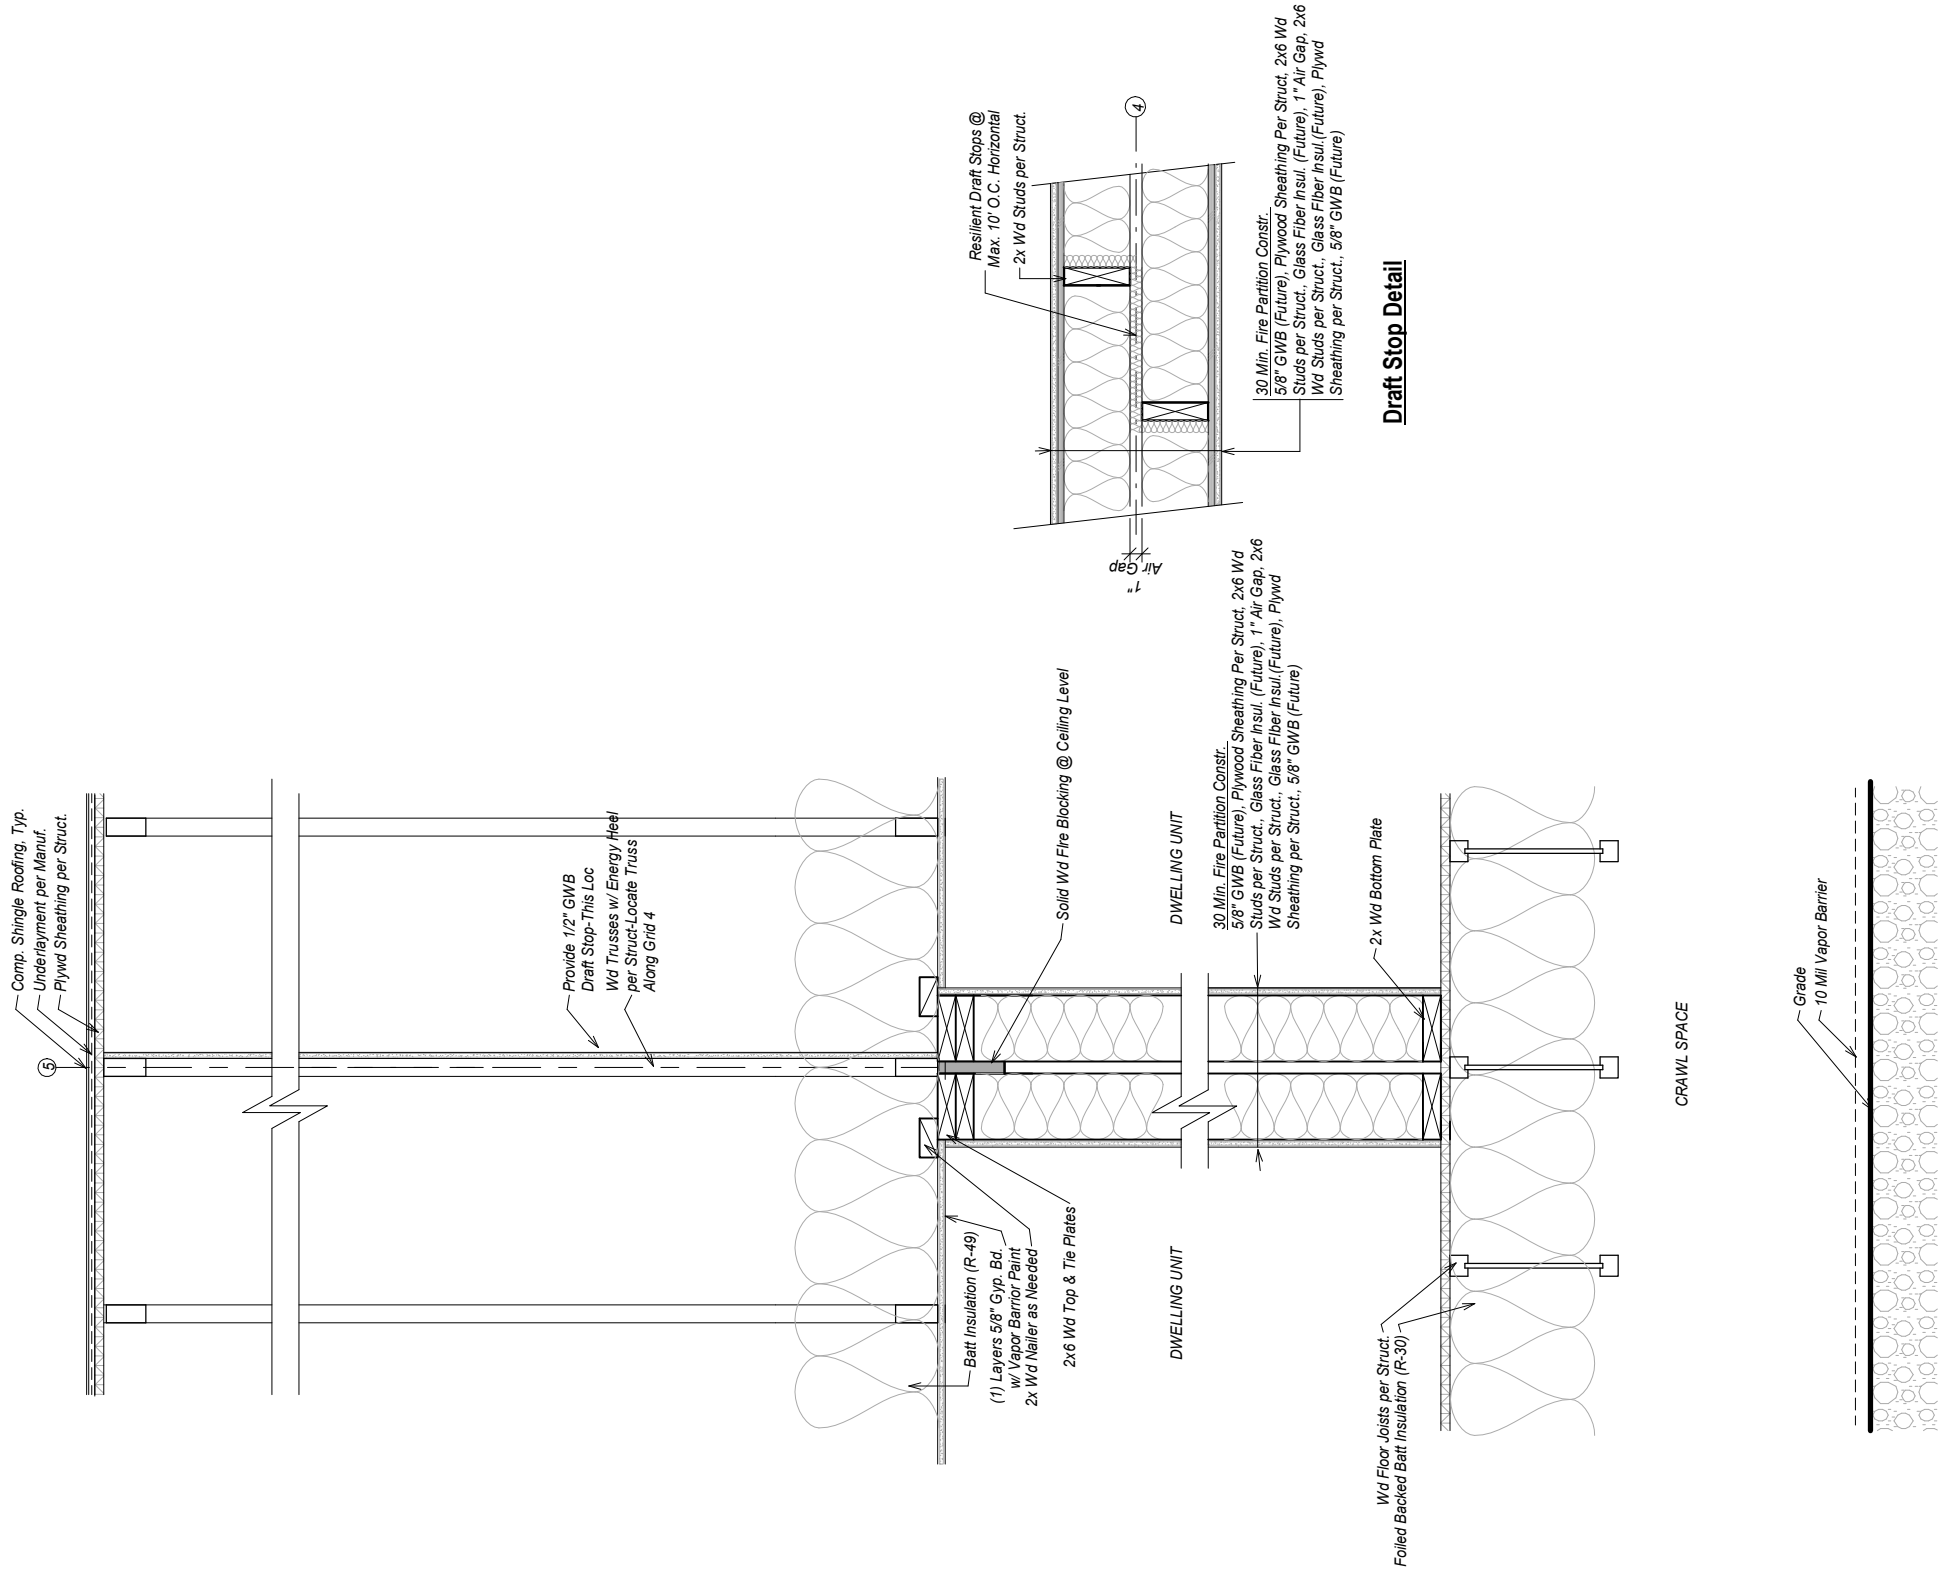

1 Wall Section @ Grid 4


3/4" = 1'-0"

REVISIONS:


THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02




R&M
ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:
Wall Sections

A502


SHEET:
18 of xx

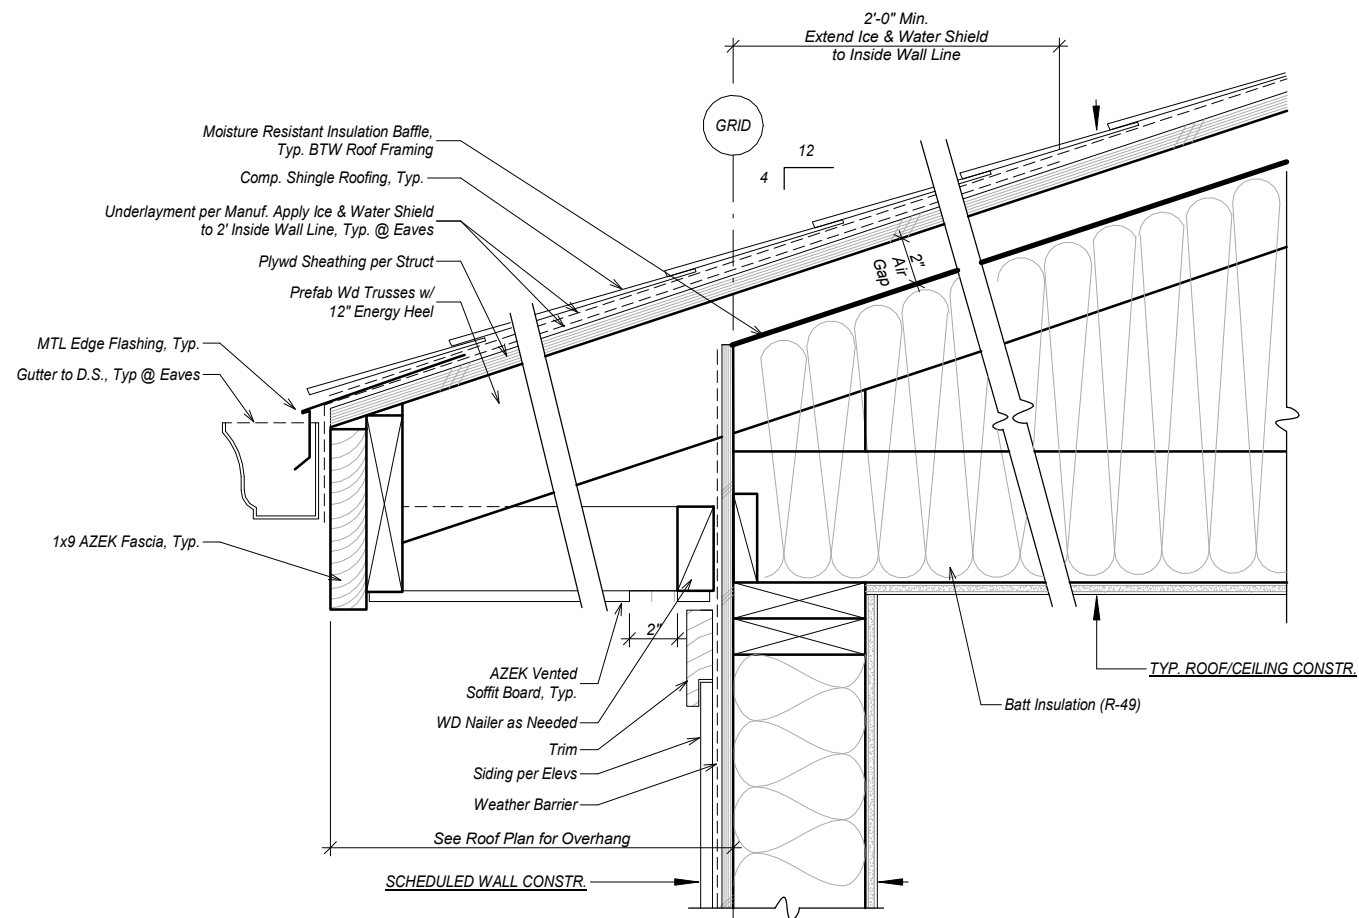


1 Typ. Eave Detail
1 1/2" = 1'-0"

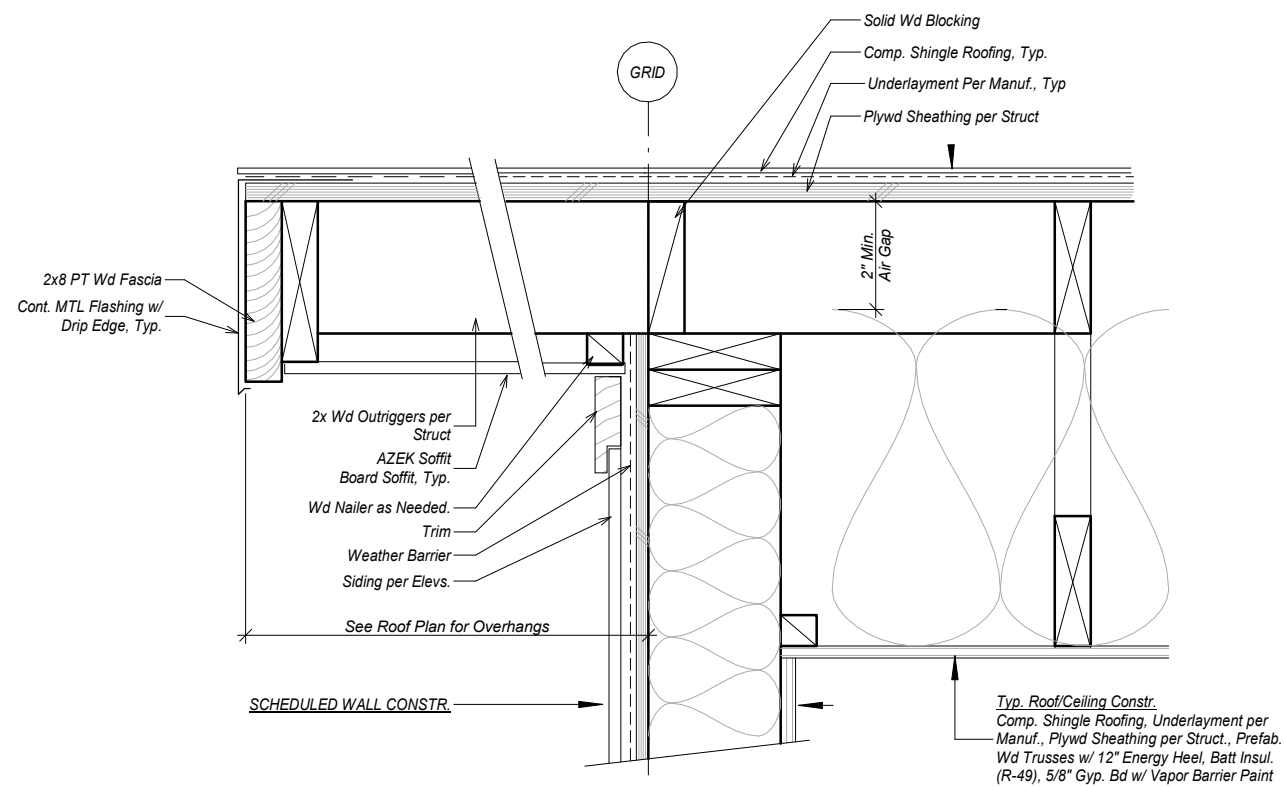

2 Typ. Rake Detail
1 1/2" = 1'-0"

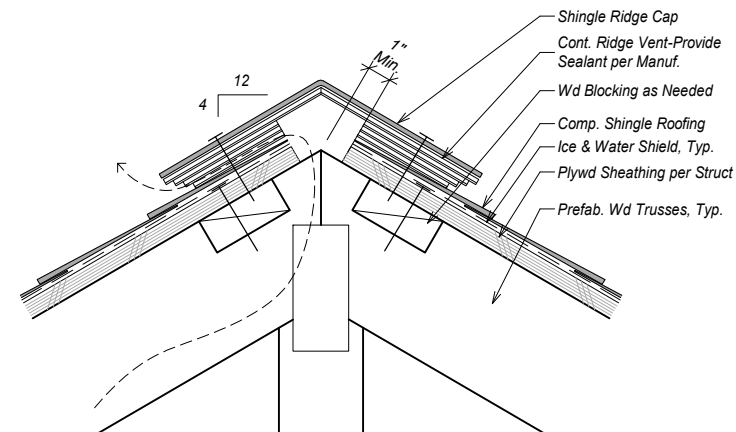

3 Typ. Ridge Detail
1 1/2" = 1'-0"

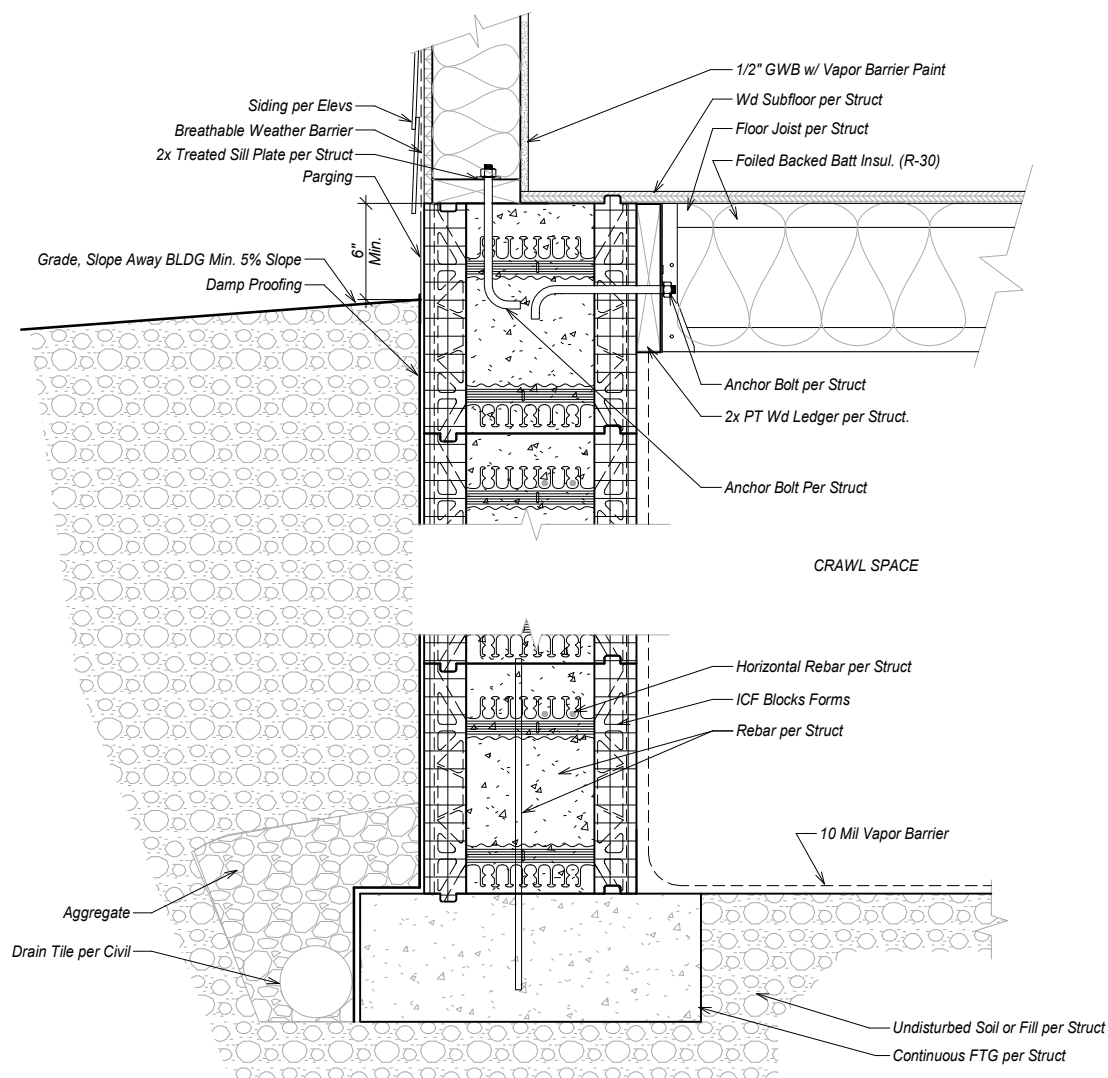

4 Typ. Foundation Detail
1" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Details


A700

SHEET:


19 of xx

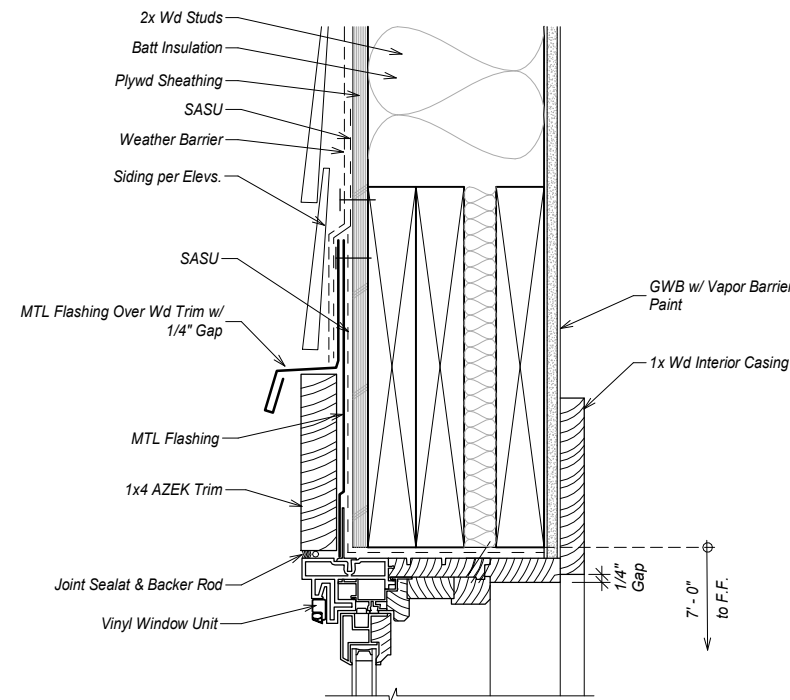


1 Typ. Window Head
1 : 6

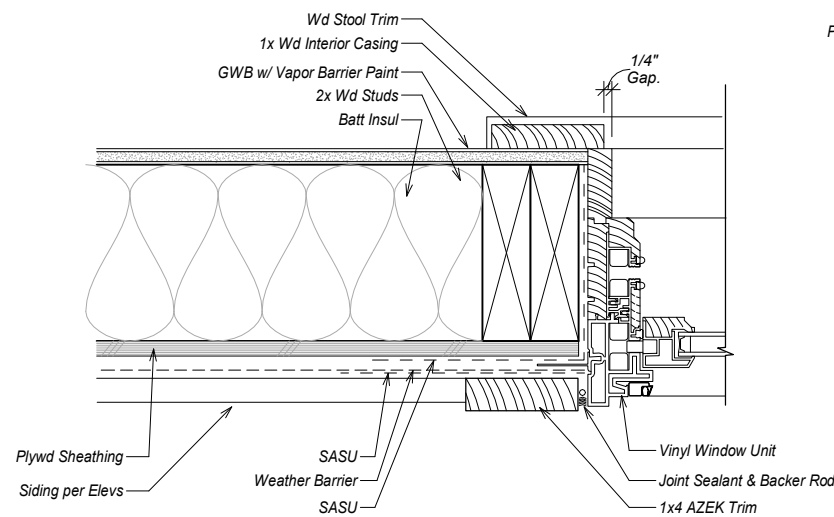


2 Typ. Window Jamb
1 : 6

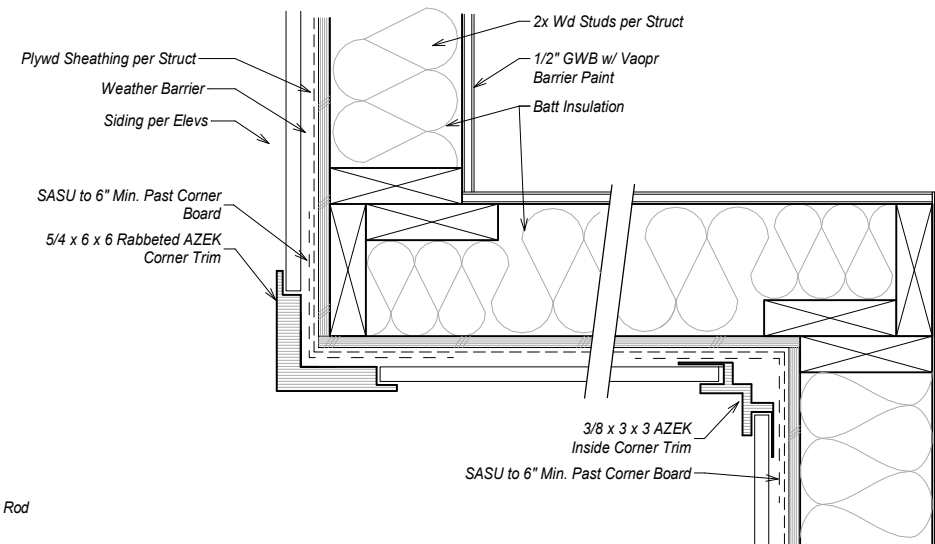

3 Typ. Corner Detail
1 1/2" = 1'-0"

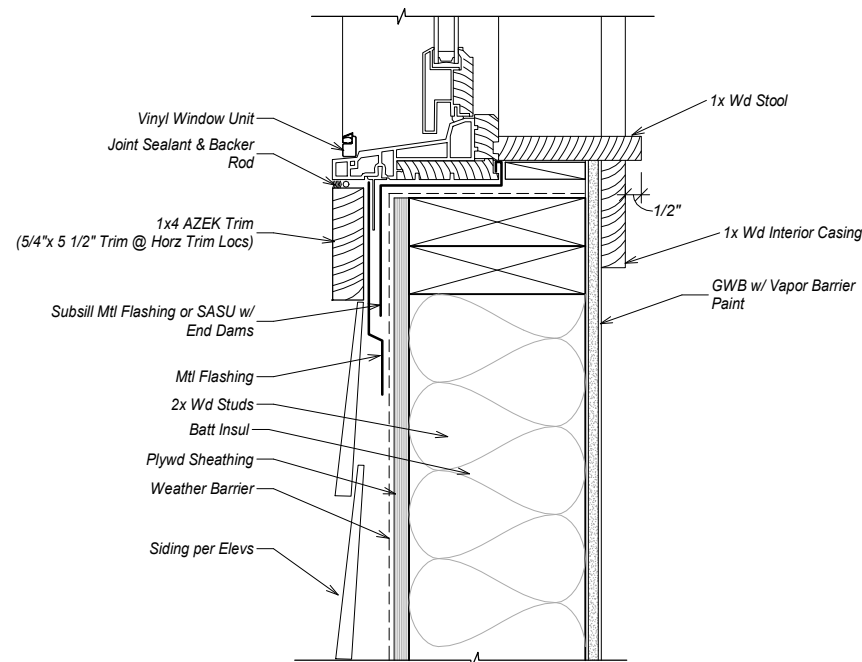

4 Typ. Window Sill
1 : 6

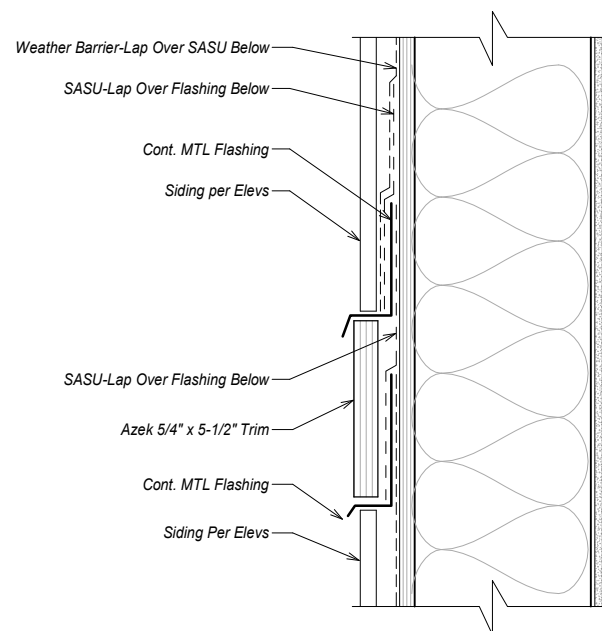

5 Typ. Siding Transition Detail
1 : 6

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Details


A701

SHEET:

20 of xx

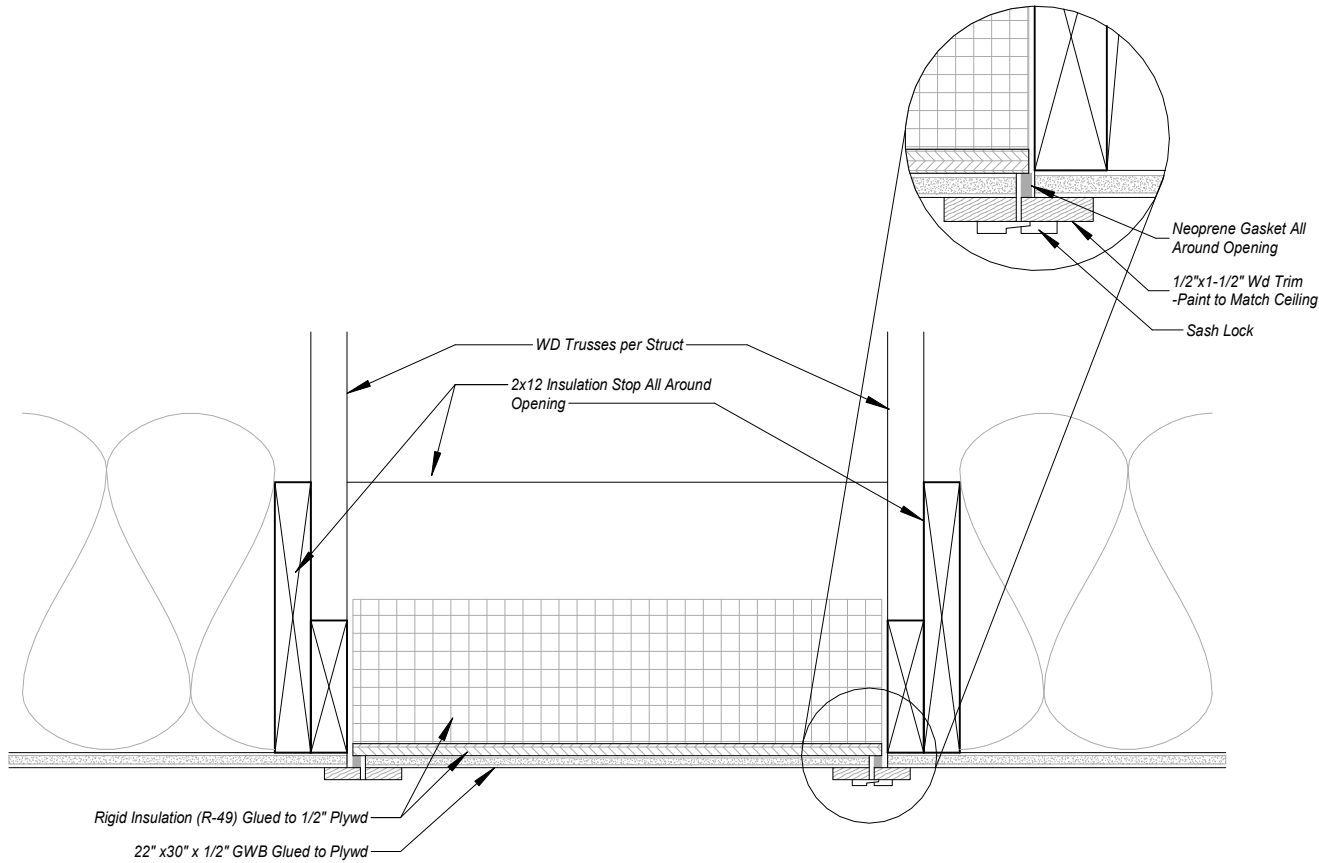


1 Attic Access Hatch
1 1/2" = 1'-0"

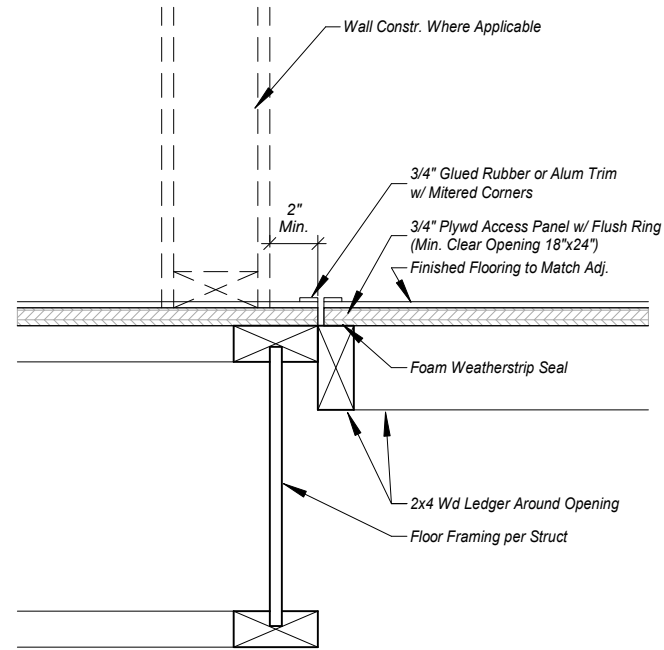

2 Crawl Space Access
1 1/2" = 1'-0"

NOTE: WOOD TRIM, JAMB, & STOPS TO BE PRE-FINISHED

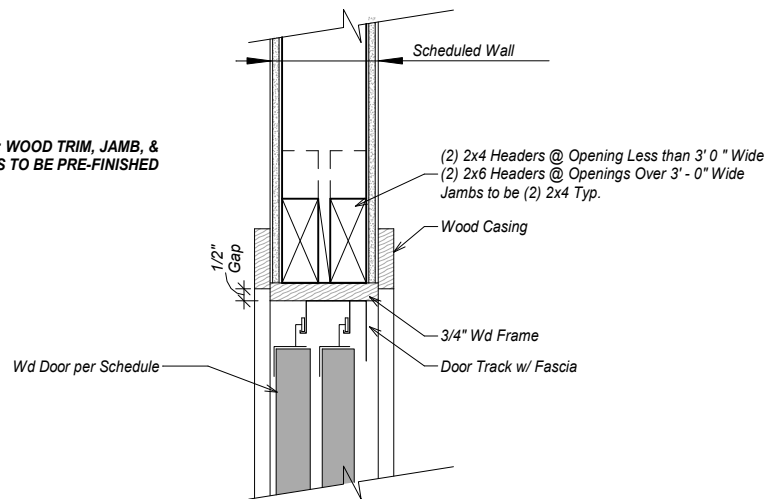

3 By-Pass Door Head
1 1/2" = 1'-0"

REVISIONS:


THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Interior Details


A702

SHEET:


21 of xx

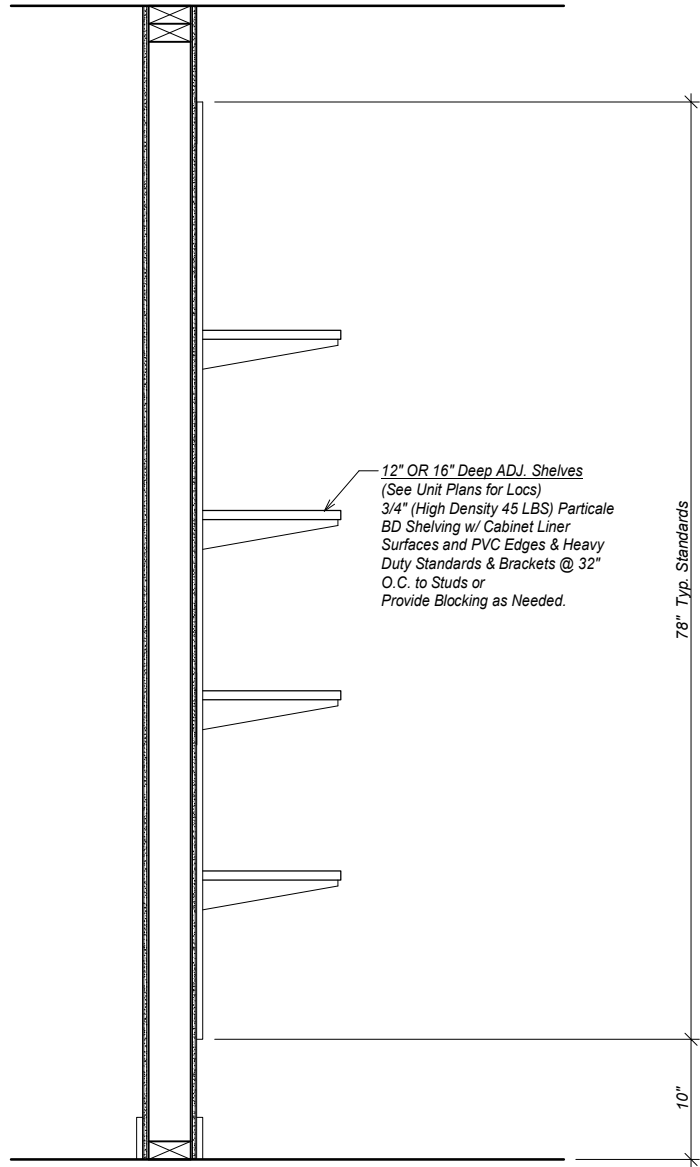

1 **Typ. Adj. Wood Shelving**
3/4" = 1'-0"

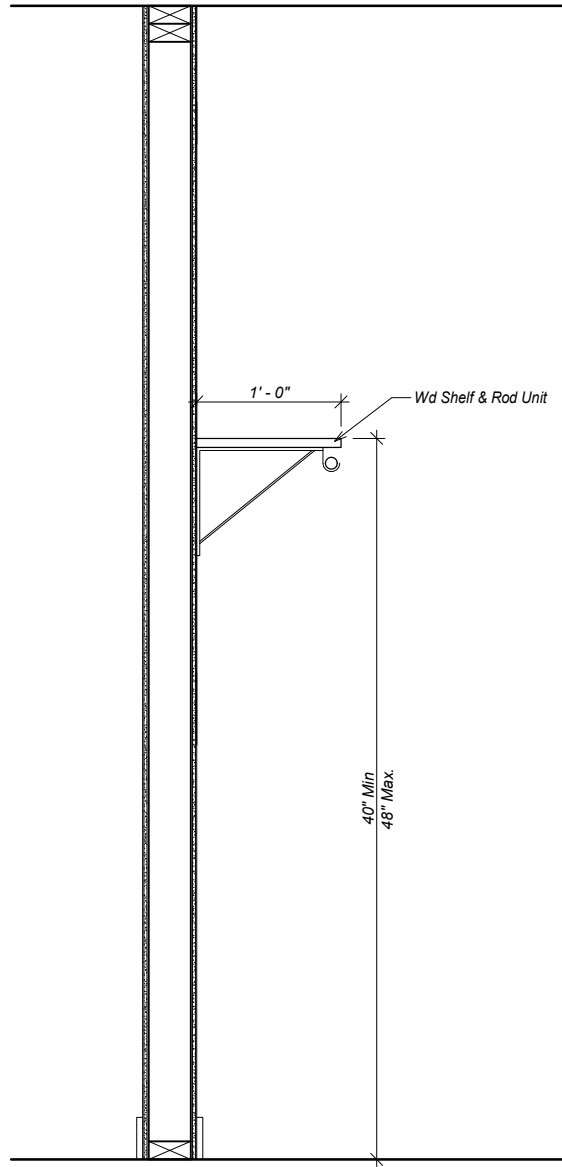

2 **Typ. Closet Shelf & Rod**
3/4" = 1'-0"

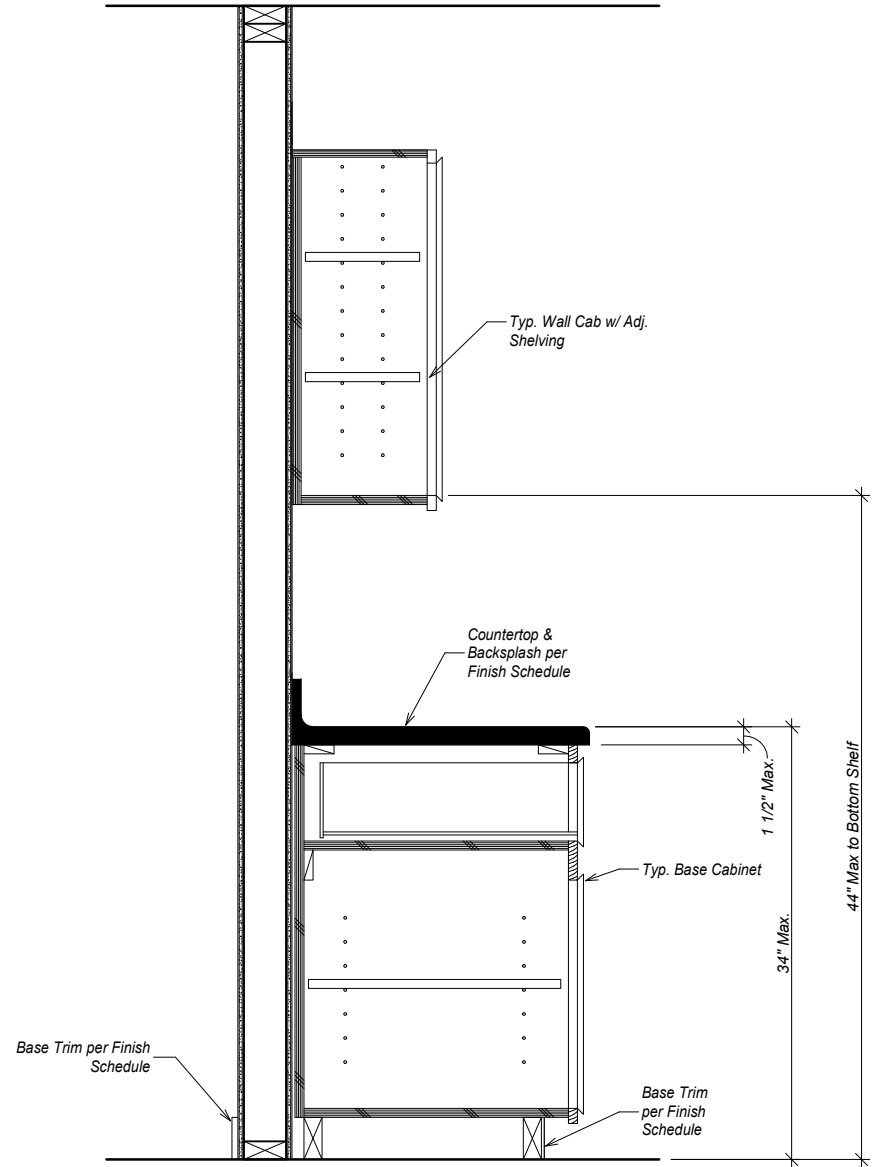

3 **Typ. Casework**
3/4" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:

Interior Details

A703

SHEET:

22 of xx

GENERAL STRUCTURAL NOTES

GENERAL

BUILDING CODE: ALL MATERIALS, WORKMENSHIP, DESIGN, AND CONSTRUCTION SHALL CONFORM TO THE DRAWINGS, SPECIFICATIONS, AND THE INTERNATIONAL BUILDING CODE (IBC), 2021 EDITION.

STANDARDS: REFERENCE TO ASTM AND OTHER STANDARDS SHALL MEAN THE LATEST EDITION IN EFFECT ON THE BID DATE, UNLESS NOTED IN THESE DOCUMENTS OR DESIGNATED BY THE GOVERNING CODE.

LOADS AND CRITERIA

GRAVITY: IN ADDITION TO THE SELF WEIGHT, THE FOLLOWING WERE USED FOR DESIGN:

AREAUNIFORM LIVE LOAD (PSF)

RESIDENTIAL AREAS40

SNOW DESIGN DATA:

GROUND SNOW LOADP_g = 55 PSF
FLAT-ROOF SNOW LOADP_f = 40 psf
SNOW EXPOSURE FACTORC_e = 0.9
SNOW LOAD IMPORTANCE FACTORI_s = 1.0
THERMAL FACTORC_t = 1.0
RAIN-ON-SNOW SURCHARGE= 0 PSF
SLOPED ROOF SNOW LOADP_s = 40 PSF

WIND DESIGN DATA (GOVERNS DESIGN OF LATERAL FORCE RESISTING SYSTEM):

BASIC WIND SPEED (3-SECOND GUST)V = 149 MPH
WIND RISK CATEGORYI_w = II
SURFACE ROUGHNESS= B
EXPOSURE CATEGORY= D
INTERNAL PRESSURE COEFFICIENTGC = 0.18 : ENCLOSED
COMPONENT AND CLADDING PRESSUREP_{ci} = +/- 41 PSF

SEISMIC DESIGN DATA

MAPPED SPECTRAL RESPONSES_s = 0.475 %g
S₁ = 0.32 %g
S_{ds} = 0.34 %g
S_{d1} = 0.29 %g
SEISMIC DESIGN CATEGORYD

SHOP DRAWINGS AND SUBMITTALS SHALL BE SUBMITTED FOR REVIEW PRIOR TO FABRICATION OR CONSTRUCTION OF THESE ITEMS:

CONCRETE MIX DESIGNROOF TRUSSES
CONCRETE REINFORCINGJOIST FRAMING

CONTRACTOR SHALL REVIEW AND STAMP SUBMITTALS PRIOR TO SUBMISSION. IF SHOP DRAWINGS DIFFER FROM DESIGN SHOWN ON STRUCTURAL DRAWINGS, THEY SHALL BE SEALED BY THE ALASKA STATE REGISTERED PROFESSIONAL ENGINEER RESPONSIBLE FOR THE DESIGN. DIMENSIONS AND QUANTITIES ARE CONTRACTOR'S RESPONSIBILITY AND WILL NOT BE REVIEWED. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL MATERIALS PLACED PRIOR TO RECEIPT OF REVIEWED SUBMITTALS. CONTRACTOR SHALL ALLOW SUFFICIENT TIME FOR REVIEW.

NOTE:
SUBMIT TRUSS CALCULATIONS AND LAYOUT PLAN TO ENGINEER OF RECORD FOR APPROVAL PRIOR TO SUBMITTAL TO CITY. PLANS AND CALCULATIONS TO BE APPROVED BY CITY PRIOR TO REQUESTING FRAME INSPECTION.

SOIL BEARING PRESSURE: 3000 PSF (IBC TABLE 1804.2)
SOIL BEARING IS BASED ON THREE TEST PITS EXCAVATED TO THE NATIVE BEACH GRAVEL WHICH CONFIRMED THE SITE WAS FILLED WITH SHOT ROCK FILL.

SPECIAL INSPECTION
CONTRACTOR SHALL PROVIDE SPECIAL INSPECTION FOR THE FOLLOWING:
SOIL SUBGRADE
GENERAL FRAMING
REBAR PLACEMENT
CONCRETE PLACEMENT
STRUCTURAL HOLD DOWNS
ROCK BOLTS (SEE NOTE BELOW)
SUMMARY OF BUILDING INSPECTION (PUR-102)

CONCRETE

REFERENCE STANDARDS: CONCRETE WORK SHALL CONFORM TO ALL REQUIREMENTS OF THE FOLLOWING DOCUMENTS, EXCEPT AS MODIFIED BELOW:

ACI 301 "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE"
ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE"
ACI 304 "GUIDE FOR MEASURING, MIXING, TRANSPORTING, AND PLACING CONCRETE"
ACI 311 "GUIDE FOR CONCRETE INSPECTION"

MATERIALS:
CEMENTASTM C150, C595
AGGREGATEASTM C33
ADMIXTURESASTM C260, C494, & C1017
FLY ASHASTM C618, CLASS "F" OR "C"

AGGREGATES THAT EXHIBIT DELETERIOUS ACTIVITY WHEN EVALUATED IN ACCORDANCE WITH ASTM C33 APPENDIX XI SHALL NOT BE USED. SAND EQUIVALENT FOR FINE AGGREGATE SHALL NOT EXCEED 75.

MAXIMUM LOSS ON IGNITION SHALL BE 1%.

CONCRETE SHALL BE PROPORTIONED TO ACHIEVE A WORKABLE MIX THAT CAN BE PLACED WITHOUT SEGREGATION OR EXCESS FREE SURFACE WATER. MIX DESIGNS SHALL BE SUBMITTED FOR REVIEW PRIOR TO USE. COMPLY WITH IBC SECTION 1905. MIXES SHALL MEET OR EXCEED THE FOLLOWING CRITERIA:

TYPE OF CONSTRUCTION	COMPRESSIVE STRENGTH (f _c)	TEST AGE	MAXIMUM WATER/CEMENT RATIO
FOOTINGS, TOPPING SLABS, RETAINING AND FOUNDATION WALLS, CONCRETE ON METAL DECK, WALLS	4,000 PSI	28 DAYS	0.50

ADMIXTURES: ALL CONCRETE, INCLUDING SLAB ON GRADE, SHALL HAVE A WATER-REDUCING ADMIXTURE COMPLYING WITH ASTM C-494 ADDED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. CALCIUM CHLORIDE OR OTHER CHLORIDE ADMIXTURES SHALL NOT BE USED.

ALL HORIZONTAL SURFACE EXPOSED TO WEATHER SHALL CONTAIN AN AIR-ENTRAINING AGENT COMPLYING WITH ASTM C260. THE AMOUNT OF ENTRAINED AIR SHALL BE 5% +/- 1 1/2% BY VOLUME. TESTS FOR AIR CONTENT SHALL BE MADE AT THE DISCHARGE END OF THE PLACING HOSE IN ACCORDANCE WITH ASTM C173.

WATER/CEMENT RATIO SHALL BE MEASURED BY WEIGHT AND BE BASED ON TOTAL CEMENTITIOUS MATERIAL, INCLUDING CEMENT AND POZZOLANS SUCH AS FLY ASH AND SILICA FUME.

MAXIMUM AGGREGATE SIZE SHALL BE 1 1/2". BUT NOT MORE THAN 3/4 TIMES THE CLEAR DISTANCE BETWEEN REINFORCING BARS NOR 1/5 TIMES THE NARROWEST DIMENSION BETWEEN SIDES OF FORMS. MAXIMUM AGGREGATE SIZE FOR SLABS ON GRADE SHALL BE 1/3 TIMES THE SLAB THICKNESS.

SLUMP REQUIRED FOR PROPER PLACEMENT SHALL BE DETERMINED BY CONTRACTOR AND SUPPLIER, AND INCLUDED IN MIX DESIGN SUBMITTALS. FIELD MEASURED SLUMP SHALL CONFORM TO SUBMITTED CONCRETE MIX DESIGN. SLUMP SHALL CONFORM TO ASTM C94.

EMBEDDED ITEMS: CONDUIT AND SLEEVES SHALL NOT BE EMBEDDED IN OR PASS THROUGH CONCRETE WITHOUT APPROVAL. ALUMINUM ITEMS SHALL NOT BE EMBEDDED IN CONCRETE. SUBMIT CONDUIT LAYOUTS AND EMBEDDED ITEM PLANS FOR REVIEW PRIOR TO PLACING CONCRETE.

CONSTRUCTION JOINTS IN WALLS SHALL BE KEYED IN ACCORDANCE WITH TYPICAL CONSTRUCTION JOINT DETAILS SHOWN ON DRAWINGS OR, AT CONTRACTOR'S OPTION, SHALL BE AN INTENTIONALLY ROUGHENED CONSTRUCTION JOINT DEFINED BY THE FOLLOWING:
1. SURFACE OF JOINT SHALL BE SAND BLASTED OR ROUGHENED WITH A CHIPPING HAMMER TO EXPOSE AGGREGATE EMBEDDED IN PREVIOUS POUR.
2. EXPOSED AGGREGATE SHALL BE CLEANED AND LAITANCE REMOVED.
3. JOINT SURFACE SHALL BE CLEANED AND LAITANCE REMOVED.
4. JOINT SHALL BE WETTED AND STANDING WATER REMOVED IMMEDIATELY BEFORE NEW CONCRETE IS PLACED.

CONSTRUCTION JOINTS WHEN REQUIRED SHALL BE IN ACCORDANCE WITH ACI 6.4. SUBMIT JOINT LAYOUT PLAN FOR REVIEW PRIOR TO PLACING CONCRETE.

CONCRETE REINFORCEMENT

REFERENCE STANDARDS: CONCRETE REINFORCEMENT SHALL CONFORM TO ALL REQUIREMENTS OF THE FOLLOWING CODES, SPECIFICATIONS, AND STANDARDS, EXCEPT AS MODIFIED BELOW:

ACI 301
ACI SP-66
ACI 318
CRSI
CRSI
WRI

MATERIALS:

DEFORMED BARSASTM A615, GRADE 60
SMOOTH WELDED WIREASTM A185, 65 KSI YIELD
BAR SUPPORTSCONFORM TO CHAPTER 3, CRSI MSP-1

REINFORCING STEEL SHALL BE PLACED AND SUPPORTED IN ACCORDANCE WITH CRSI MSP-1. REINFORCING STEEL SHALL BE DETAILED IN ACCORDANCE WITH ACI SP-66. NO BENDING OR STRAIGHTENING OF REINFORCEMENT WILL BE PERMITTED AFTER PARTIAL EMBEDMENT IN CONCRETE.

LAP ALL CONTINUOUS REINFORCEMENT IN ACCORDANCE WITH THE SECTIONS AND DETAILS. PROVIDE CORNER BARS AT ALL WALL AND FOOTING INTERSECTIONS. LAP ADJACENT MATS OF WELDED WIRE FABRIC A MINIMUM OF 1 CROSS WIRE SPACING + 2" OR 8" WHICHEVER IS GREATER.

BAR SIZE	#4	#5
L	30"	37.5"
L _d 18"	22.5"	

WELDING OR TACK WELDING OF REINFORCING BARS TO OTHER BARS OR TO PLATES, ANGELS, ETC IS PROHIBITED, EXCEPT WHERE SPECIFICALLY APPROVED. WHERE WELDING IS APPROVED, IT SHALL BE DONE BY AWS CERTIFIED WELDERS USING E9018 ELECTRODES. WELDING PROCEDURES SHALL COMPLY WITH AWS-D1.4.

CONCRETE COVER: UNLESS NOTED OTHERWISE, MINIMUM COVER FOR REINFORCING SHALL BE:

ELEVATED SLABS3/4" (1" AT FIRE-RESISTIVE RATING ≥ 2 HOURS)
SLABS ON GRADE2" BOTTOM
INTERIOR WALL FACES3/4"
EXPOSED FORMED WALL FACES1 1/2" (#5 AND SMALLER), 2" (#6 & LARGER)
FOOTINGS3" (2" TOP AND FORMED SIDES)
BEAMS, COLUMNS1 1/2" (TO TIES, SPIRALS, STIRRUPS)

FIBROUS REINFORCEMENT: POLYPROPYLENE FIBROUS REINFORCEMENT ("FIBERMESH", "GRACE FIBERS", OR APPROVED EQUAL) SHALL BE USED WHERE NOTED ON THE DRAWINGS. SUBMIT PROPOSED PRODUCT DATA AND SPECIFICATIONS FOR REVIEW. ADD FIBERS TO CONCRETE MIX AND FINISH IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. COMPLY WITH ASTM C116, TYPE III, PERFORMANCE LEVEL 1. MINIMUM APPLICATION RATE SHALL BE 1.5 LB/CY.

ANCHORAGE

POST-INSTALLED ANCHORS SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS AND NOTED ICC-ES REPORTS. SUBSTITUTES PROPOSED BY CONTRACTOR SHALL BE SUBMITTED FOR REVIEW WITH ICC-ES REPORTS INDICATING EQUIVALENT OR GREATER LOAD CAPACITIES. ALLOWABLE EPOXY PRODUCTS INCLUDE HILTI HY-150 OR APPROVED EQUAL.

NO REINFORCING BARS SHALL BE CUT TO INSTALL ANCHORS. ALL DEFECTIVE ANCHOR HOLES SHALL BE GROUTED WITH EPOXY ADHESIVE AND A NEW HOLE DRILLED A MINIMUM OF 3 BOLT DIAMETERS AWAY.

WOOD

REFERENCE STANDARDS: WOOD FRAMING SHALL CONFORM TO ALL REQUIREMENTS OF THE FOLLOWING DOCUMENTS, EXCEPT AS MODIFIED BELOW:

AITC
AF & PA

PLYWOOD: WOOD STRUCTURAL PANELS SHALL CONFORM TO REQUIREMENTS OF U.S. DEPARTMENT OF COMMERCE PS-1 OR PS-2. EACH PANEL SHALL BEAR THE AMERICAN PLYWOOD ASSOCIATION (APS) GRADE MARK. SEE DRAWINGS FOR GRADE AND THICKNESS.

SHEATHING: UNLESS NOTED OTHERWISE, ROOF AND FLOOR PANELS SHALL BE INSTALLED WITH LONG DIMENSION PERPENDICULAR TO SUPPORTS AND CONTINUOUS OVER 2 OR MORE SPANS. PLACE NAILS 3/8" FROM PANEL ENDS AND EDGES. DRIVE ALL NAILS FLUSH WITH SHEATHING SURFACE.

USE	SIZE	SPECIES	GRADE
WALL STUDS	2x 3x	HEM-FIR	#2
SILL PLATES	2x 3x	HEM-FIR	#2
JOISTS	2x	HEM-FIR	#2
JOISTS	3x 4x	HEM-FIR	#2
BEAMS/POSTS	4x	HEM-FIR	#2
BEAMS/POSTS	6x	HEM-FIR	#1
T&G DECKING	2x	HEM-FIR	#2

GLUE LAMINATED MEMBERS (GLULAMS) SHALL BE FABRICATED IN CONFORMANCE WITH U.S. PRODUCT STANDARD PS 56-73 AND AITC STANDARD SPECIFICATIONS FOR STRUCTURAL GLUED LAMINATED TIMBER OF SOFTWOOD SPECIES, MANUFACTURING REQUIREMENTS AITC 117-93. EACH MEMBER SHALL BEAR AN AITC OF CONFORMANCE. GLULAMS SHALL BE ARCHITECTURAL GRADE WITH STRENGTH GRADES AS NOTED BELOW:

BEAMS: 24F-E11 (Fb=2400 PSI, Fv=195 PSI, E=1800 KSI)

ENGINEERED WOOD JOISTS: DESIGN SHOWN ON DRAWINGS IS BASED ON JOISTS MANUFACTURED BY BOISE CASCADE. SUBSTITUTES SHALL BE SUBMITTED WITH A CURRENT ICC-ES EVALUATION REPORT AND AN ITEMIZED SUBSTITUTION LIST FOR APPROVAL. JOIST SHALL BE INSTALLED IN CONFORMANCE WITH MANUFACTURERS INSTRUCTIONS. ALL NECESSARY ACCESSORIES, SUCH AS BRIDGING, BLOCKING AND STIFFENERS, SHALL BE FURNISHED BY THE MANUFACTURER.

ENGINEERED LUMBER: DESIGN SHOWN ON DRAWINGS IS BASED ON LUMBER MANUFACTURED BY BOISE CASCADE. SUBSTITUTES SHALL BE SUBMITTED WITH A CURRENT ICC-ES EVALUATION REPORT AND AN ITEMIZED SUBSTITUTION LIST FOR APPROVAL.

CONNECTORS: DESIGN SHOWN ON DRAWINGS IS BASED ON CONNETEERS MANUFACTURED BY SIMPSON STRONG-TIE IN ACCORDANCE WITH CATALOG C-2004. SUBSTITUTES SHALL BE SUBMITTED WITH A CURRENT ICC-ES EVALUATION REPORT AND AN ITEMIZED SUBSTITUTION LIST FOR APPROVAL. CONNECTORS SHALL BE INSTALLED IN CONFORMANCE WITH MANUFACTURER'S INSTRUCTIONS.

NAILING NOT SHOWN SHALL BE AS SHOWN IN IBC TABLE 2304.9.1 OR CURRENT ICC-ES REPORT NER-272. MINIMUM NAIL DIMENSIONS SHALL BE AS FOLLOWS:

SIZE	DIAMETER	LENGTH
6d	0.113"	2"
8d	0.131"	2 1/2"
10d	0.148" 3"	
12d	0.148" 3 1/4"	
16d	0.162" 3 1/2"	
20d	0.192" 4"	

BOLTS AND LAG SCREWS SHALL CONFORM TO ASTM A307.

WOOD PROTECTION: ALL WOOD MEMBERS EXPOSED TO WEATHER AND SPECIFIED AS "PT" ON THE DRAWINGS SHALL BE PRESSURE-TREATED WITH AN APPROVED PRESERVATIVE. FASTENERS IN TREATED WOOD SHALL BE HOT DIPPED ZINC COATED GALVANIZED PER ASTM A153, STAINLESS STEEL, SILICON BRONZE OR COPPER.

FLOOR FRAMING: ALL FLOOR FRAMING TO HAVE A MINIMUM LIVE LOAD DEFLECTION LIMIT OF L/480.

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: TSS
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Structural Notes

S100

SHEET:

23 of xx

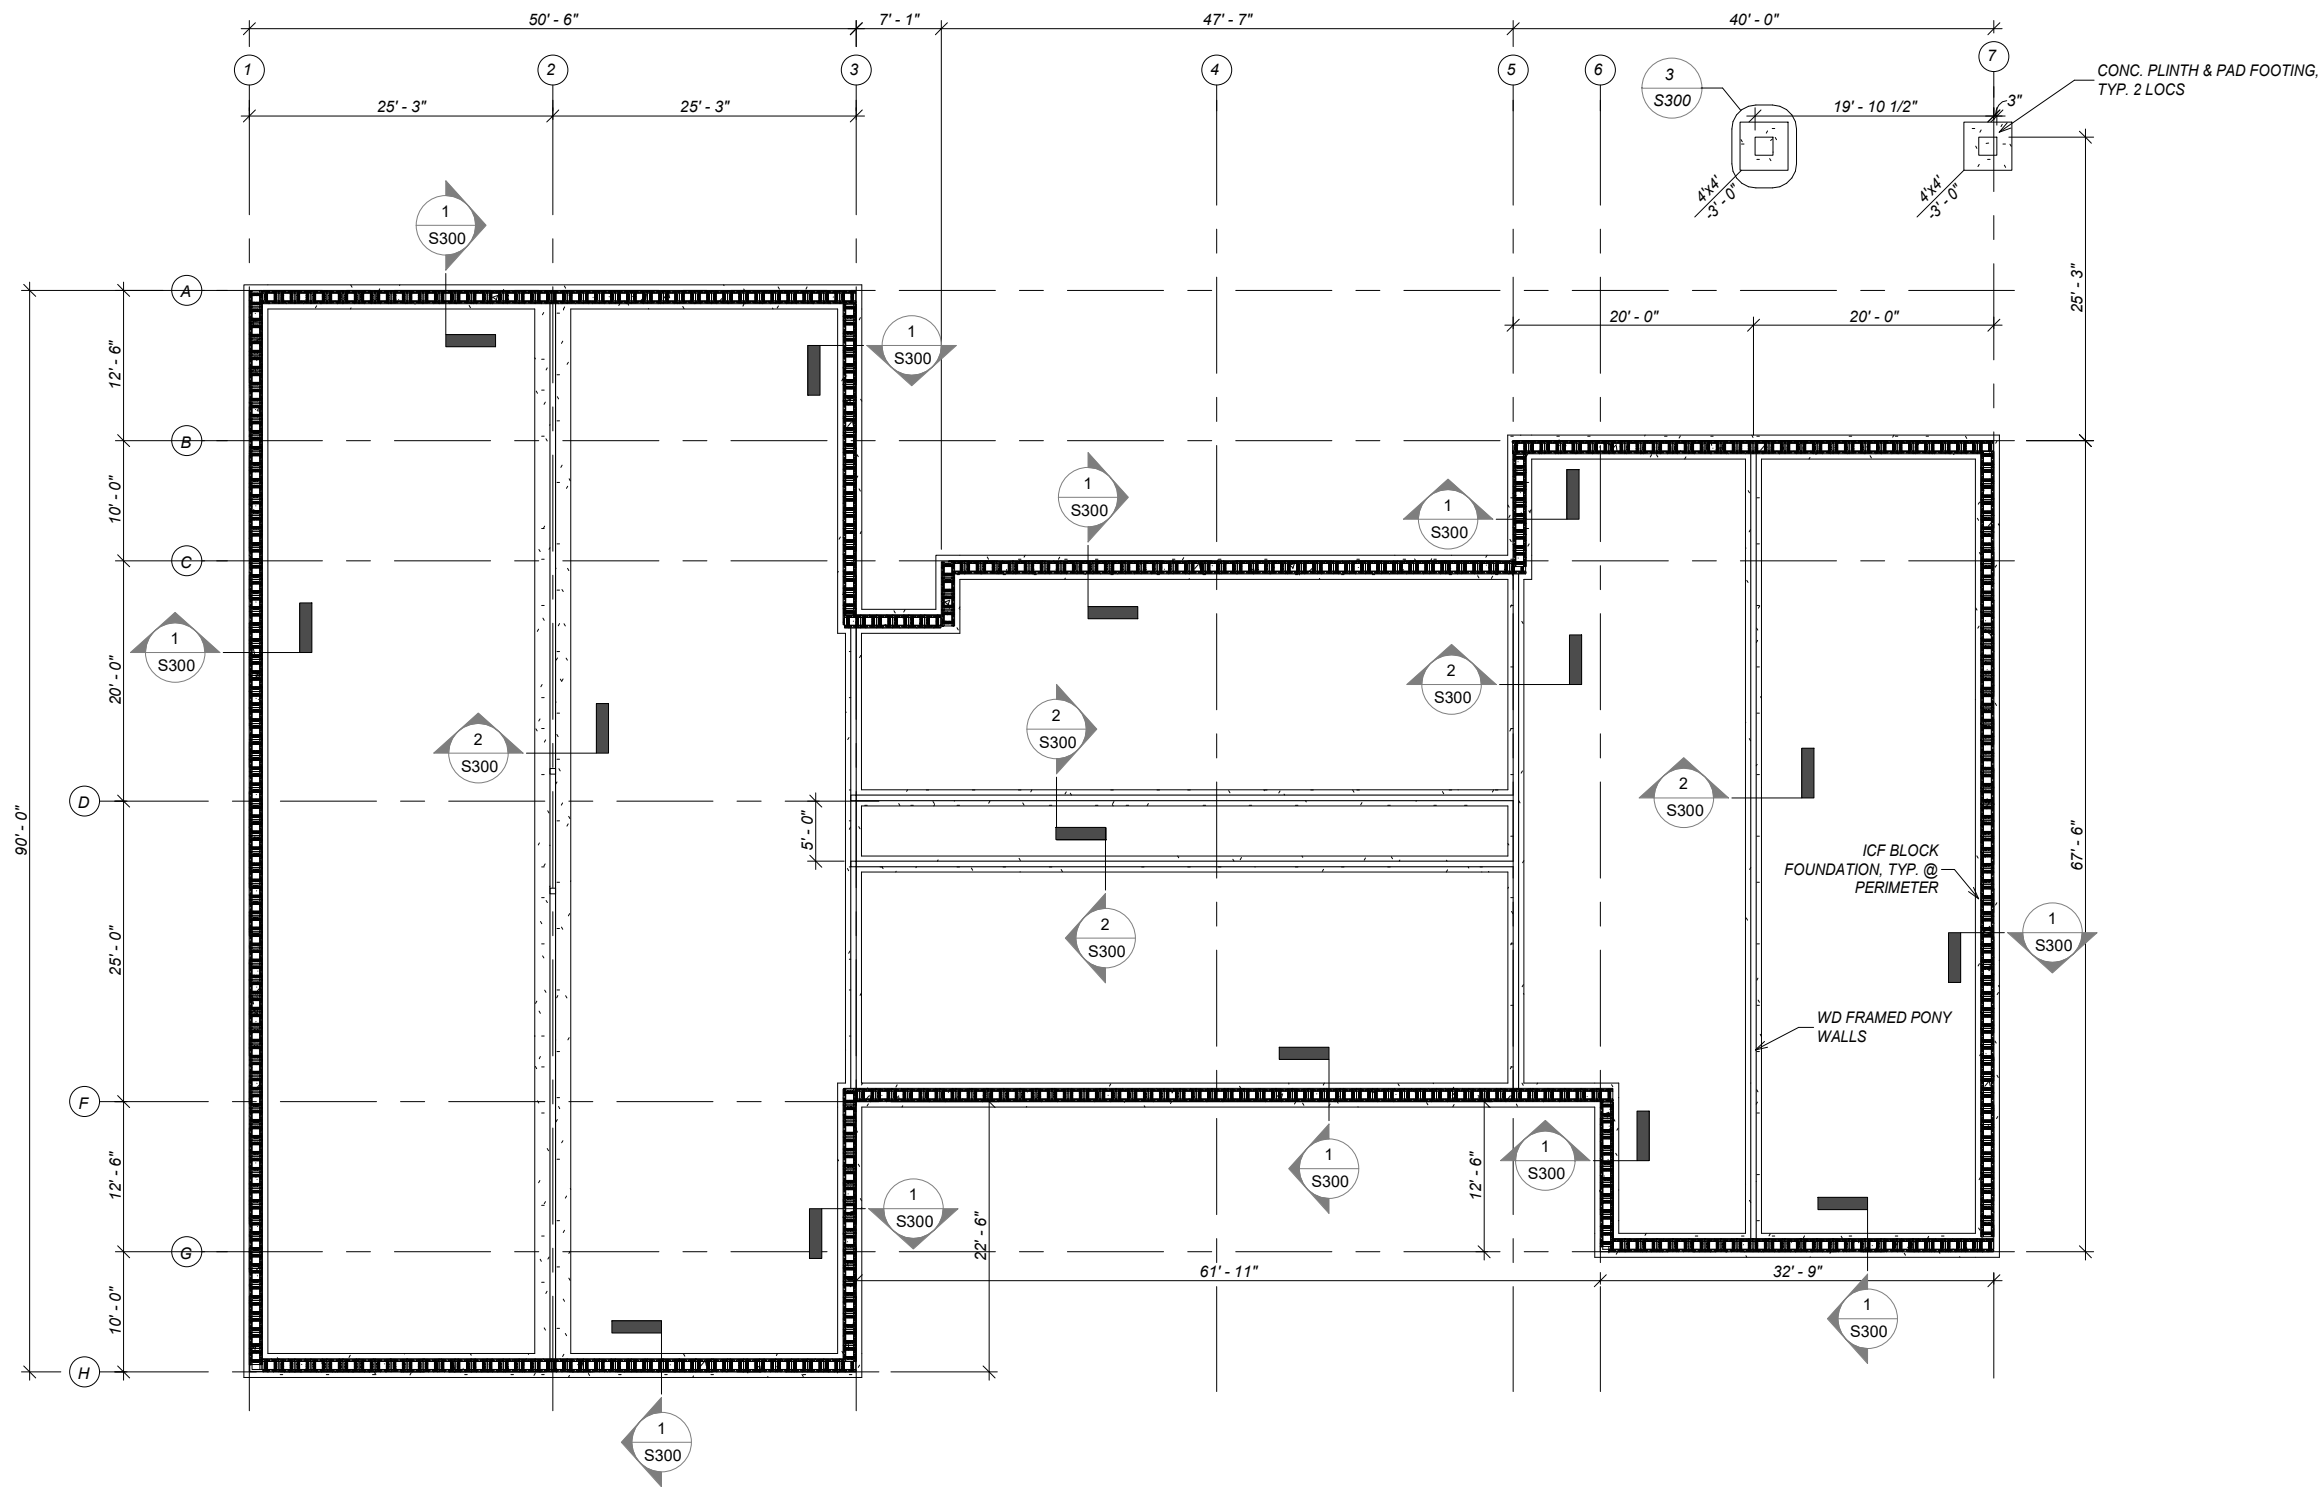

1 Foundation Plan
1/16" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: TSS
DATE: 2.12.24
PROJECT #: 222321.02


R&M

R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Foundation Plan

S200
SHEET:
24 of xx

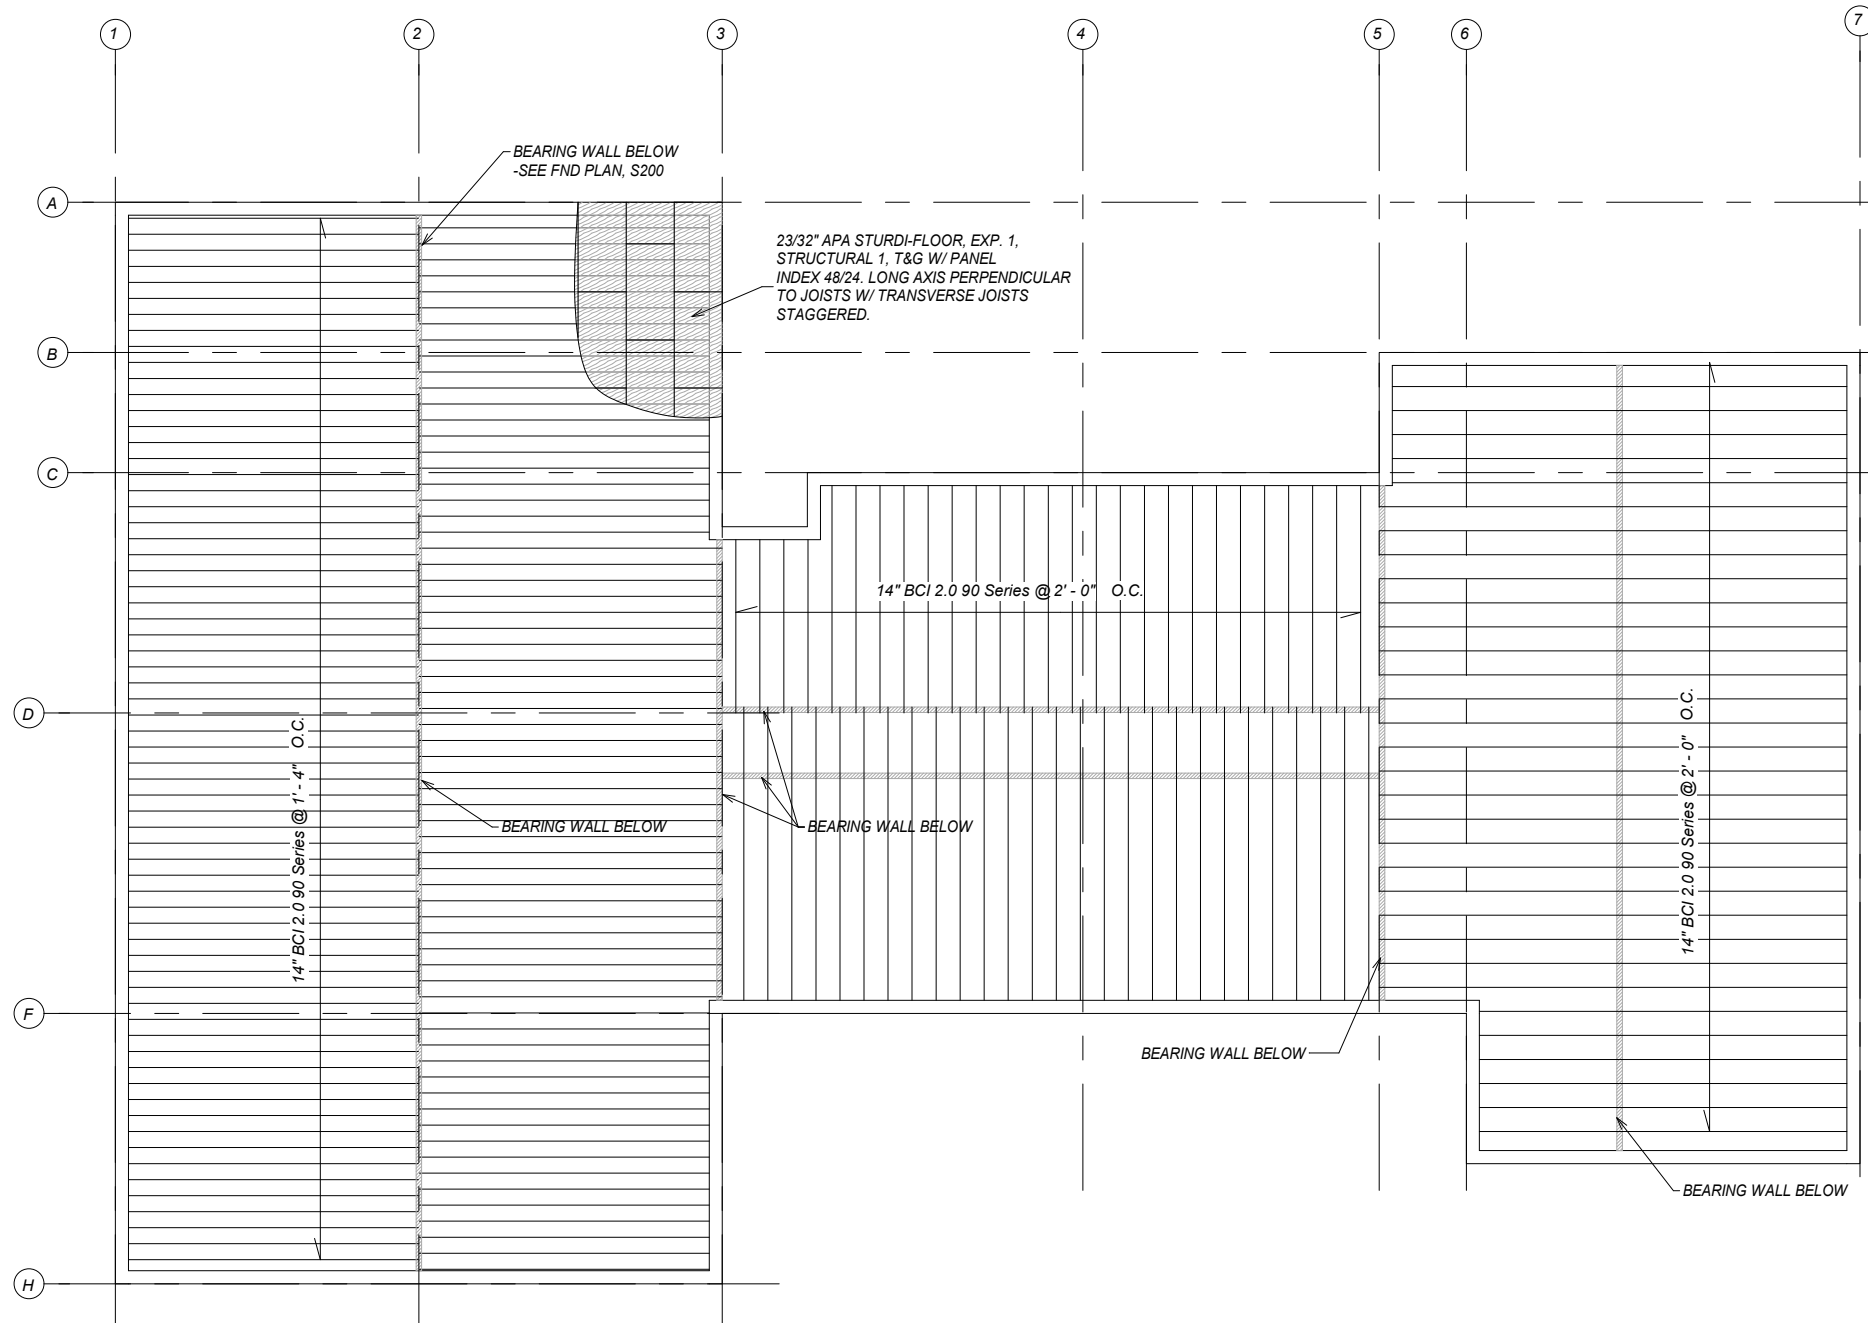

1 Main Level Floor Framing Plan
1/16" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: TSS
DATE: 2.12.24
PROJECT #: 222321.02

R&M


R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:
Main Floor Framing Plan

S201

SHEET:
25 of xx

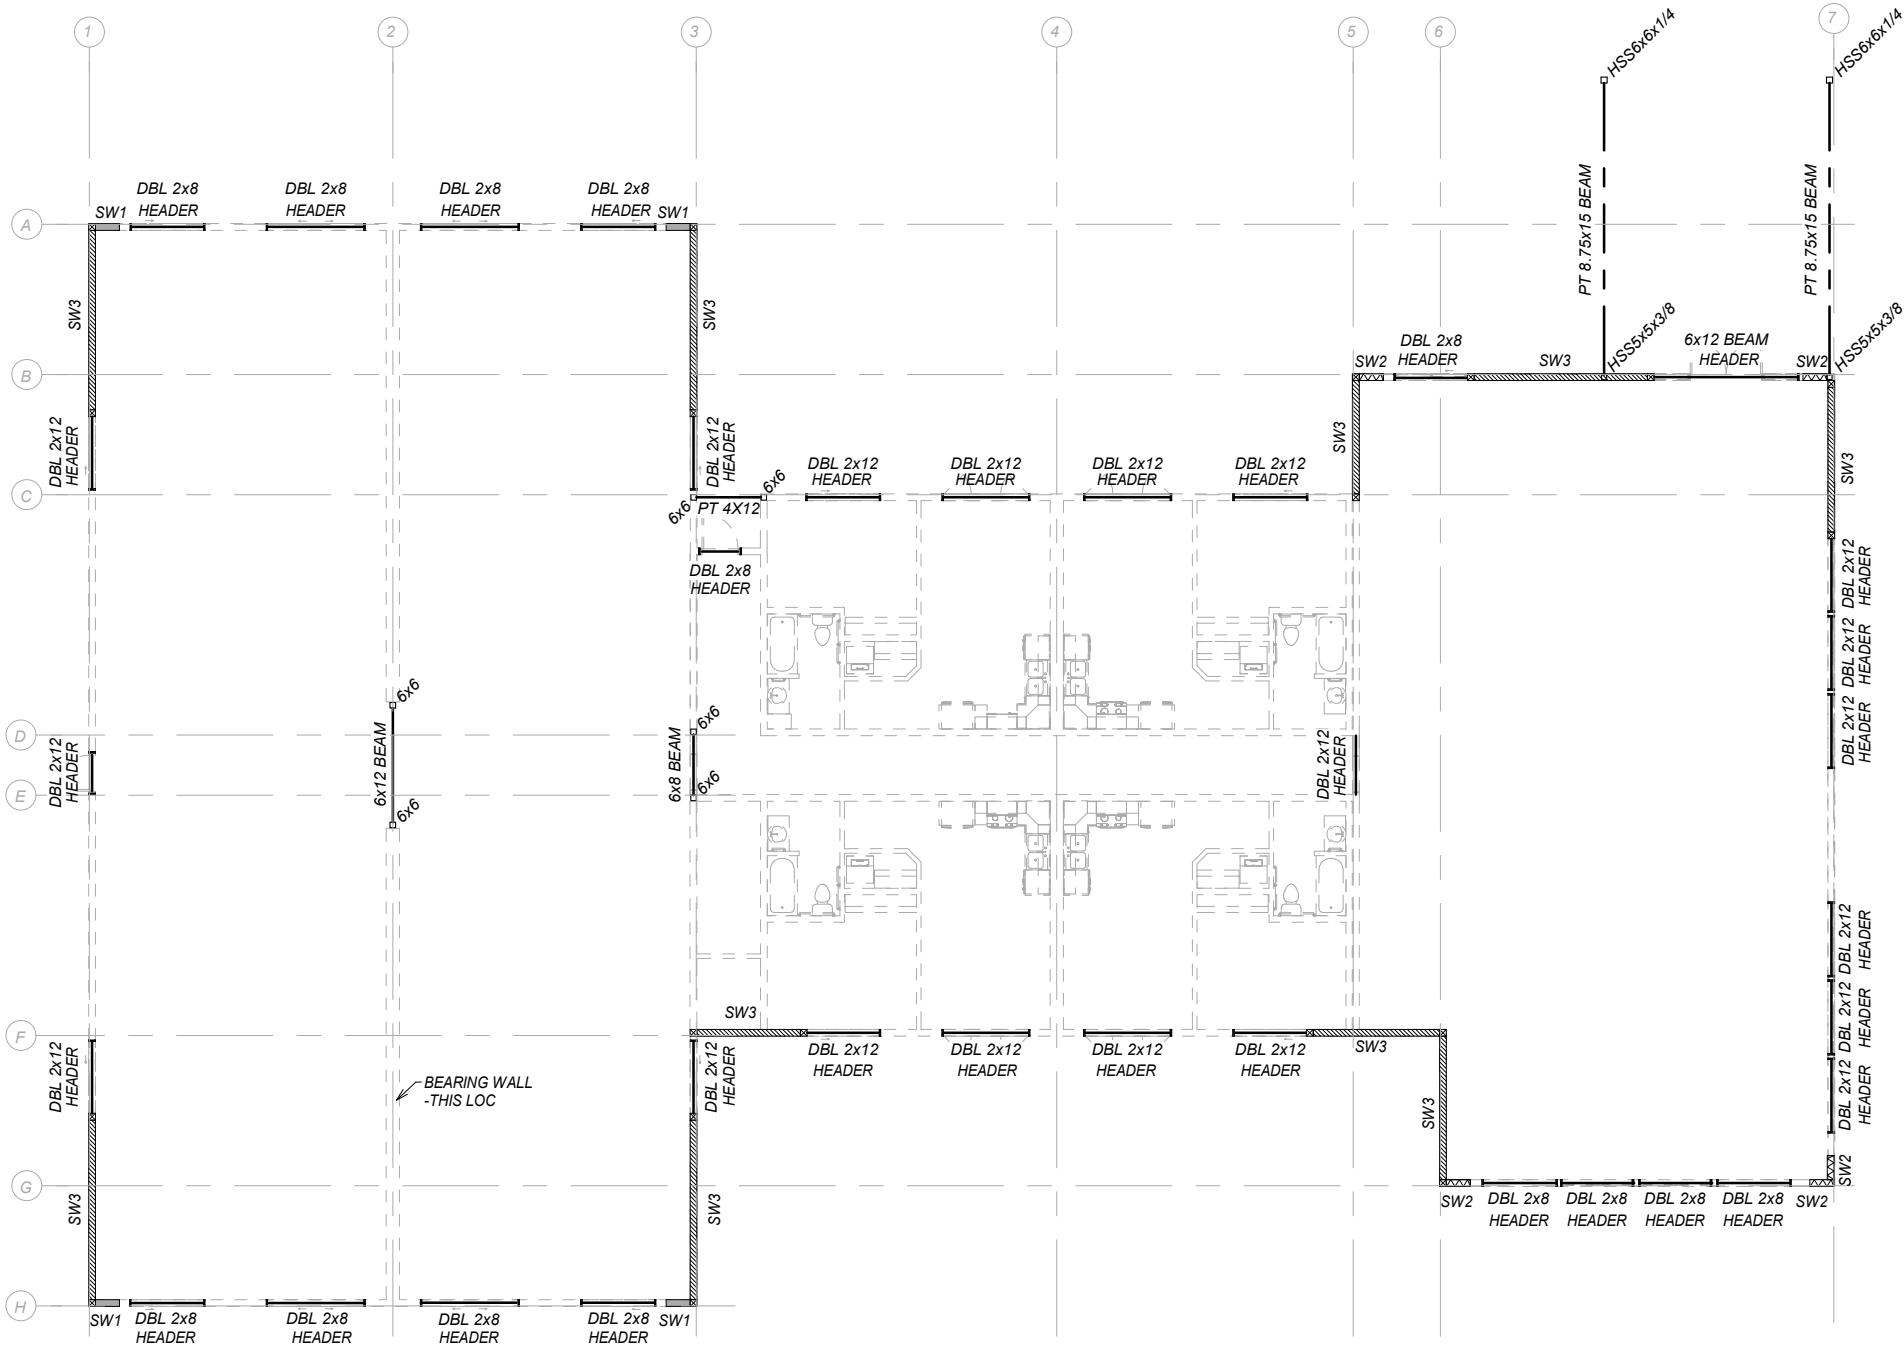

SHEARWALL SCHEDULE

SW1 SIMPSON STRONG WALL - SSW24X8

SW2 SIMPSON STRONG WALL - SSW24X11

SW3 15/32" CDX STRUCTURAL SHEATHING ONE SIDE. FASTENERS TO BE 10d WITH 1-1/2" PENETRATION INTO FRAMING. OUTSIDE PANEL NAILING TO BE 4", INTERIOR SPACING TO BE 12". MIN 4x6 AT EACH END OR AS NOTED WITH SIMPSON HDU5-SDS2.5. SILL PLATE BOLTS TO BE 5/8" @ 24" O.C. SILL PLATE BOLTS AT NON SHEARWALLS LOCATIONS TO BE 5/8" @ 48" O.C.

NOTES:

- FLOOR SHEATHING SHALL BE 23/32" APA STURDI-FLOOR, EXP. 1, STRUCTURAL 1, T&G W/ PANEL INDEX 48/24. LONG AXIS PERPENDICULAR TO JOISTS W/ TRANSVERSE JOISTS STAGGERED.
- BEARING WALLS SHALL BE 2"x6" LUMBER BEAMS, SET @ 16" O.C., UNLESS OTHERWISE NOTED.
- INTERIOR WALL SHALL BE 2"x4" LUMBER BEAMS, SET AT 16" O.C., UNLESS OTHERWISE NOTED.
- FLOOR TO FLOOR STRAPPING TO BE SIMPSON CMST12, CLEAR SPAN +90°, ON 8' CENTERS ALONG THE EXTERIOR WALLS.
- ALL BEAMS MUST HAVE MINIMUM BEARING LENGTH OF 3"
- INTERIOR HEADERS LOCATED W/IN A NON-BEARING WALL SHALL CONSISTS OF A (2) 2x8 HEADER SUPPORTED BY A (1) 2x (MIN.) JACK STUD @ BOTH ENDS.
- CONTRACTOR TO VERIFY HANGER DIMENSION AND CONFIGURATIONS WITH SIMPSON PRIOR TO CONSTRUCTION. ADDITIONALLY, ALL JOIST HANGERS AND BEAM SUPPORTS SHALL BE APPROVED BY THE DESIGN ENGINEER PRIOR TO CONSTRUCTION.

1 Header & Shearwall Plan

1/16" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: TSS
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Header & Shearwall Plan

S202

SHEET:

26 of xx

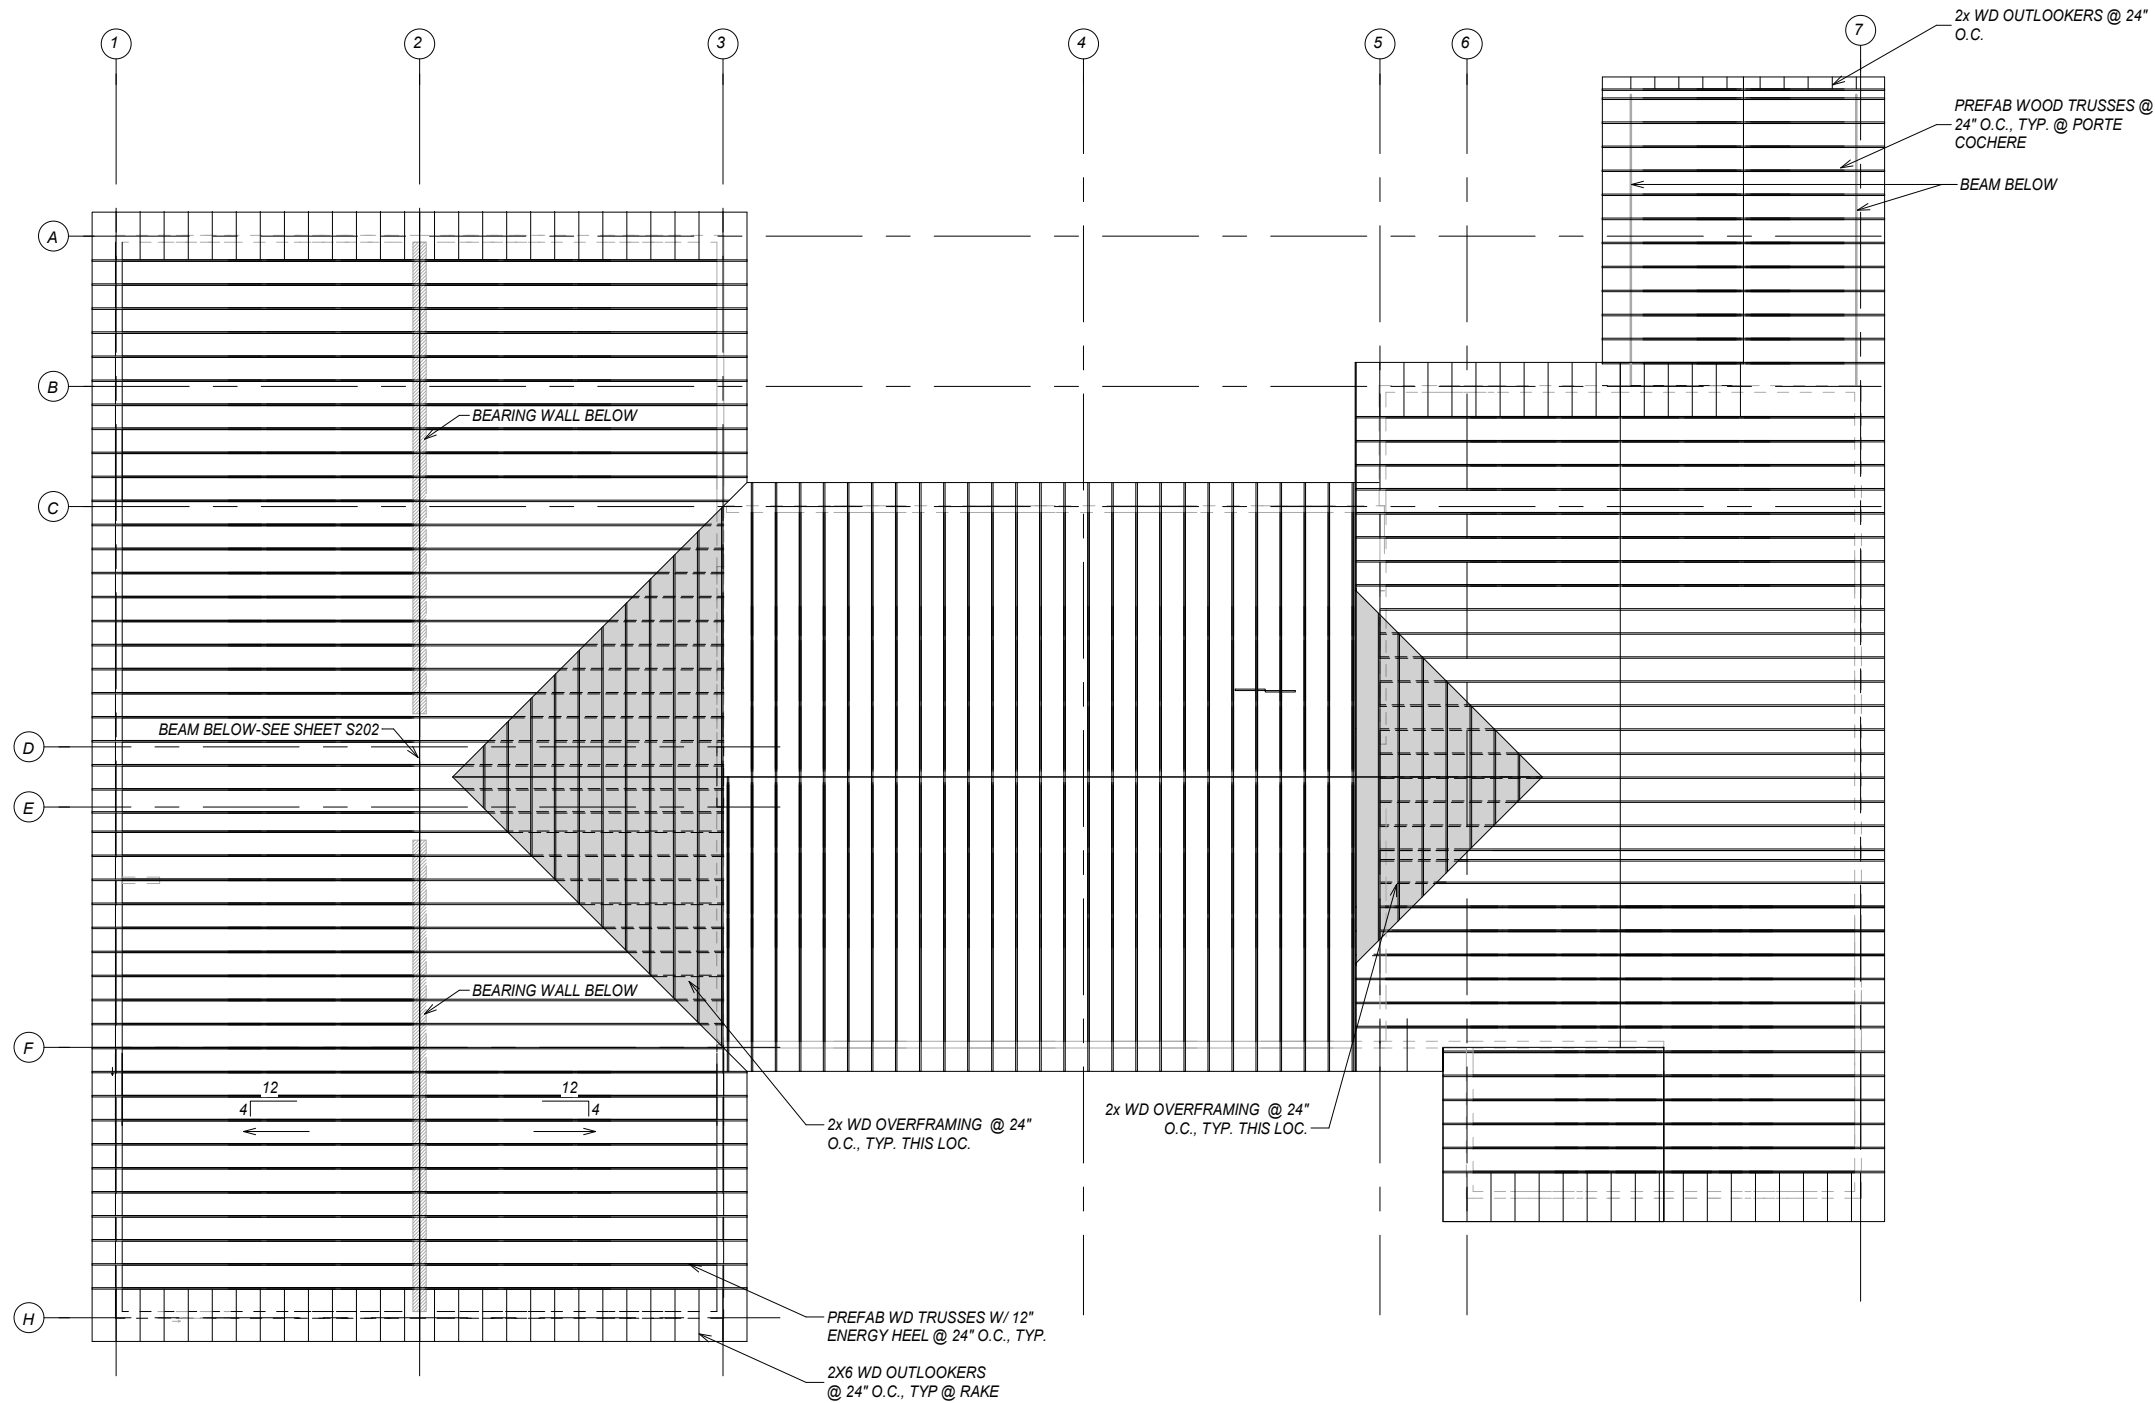

1 Roof Framing Plan
1/16" = 1'-0"

ROOF SHEATHING
19/32" APA CDX RATED SHEATHING w/ PANEL INDEX 40/20, EXTERIOR GLUE. LONG AXIS PERPENDICULAR TO TRUSSES w/ TRANSVERSE JOINTS STAGGERED. BLOCK DIAPHRAGM AT PANEL EDGES WITHIN 8' OF ENDWALLS AND SHEARWALLS. BLOCK WITH FLAT 2x6 AT EVERY PANEL EDGE, 6" EXTERIOR NAIL SPACING.

REVISIONS:


THRHA - Craig Senior Center
PHASE 1

STATUS:
**PERMIT
DRAWINGS**

DRAWN BY: NMG
CHECKED BY: TSS
DATE: 2.12.24
PROJECT #: 222321.02


R&M

R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:
Roof Framing Plan



S203
SHEET:
27 of xx

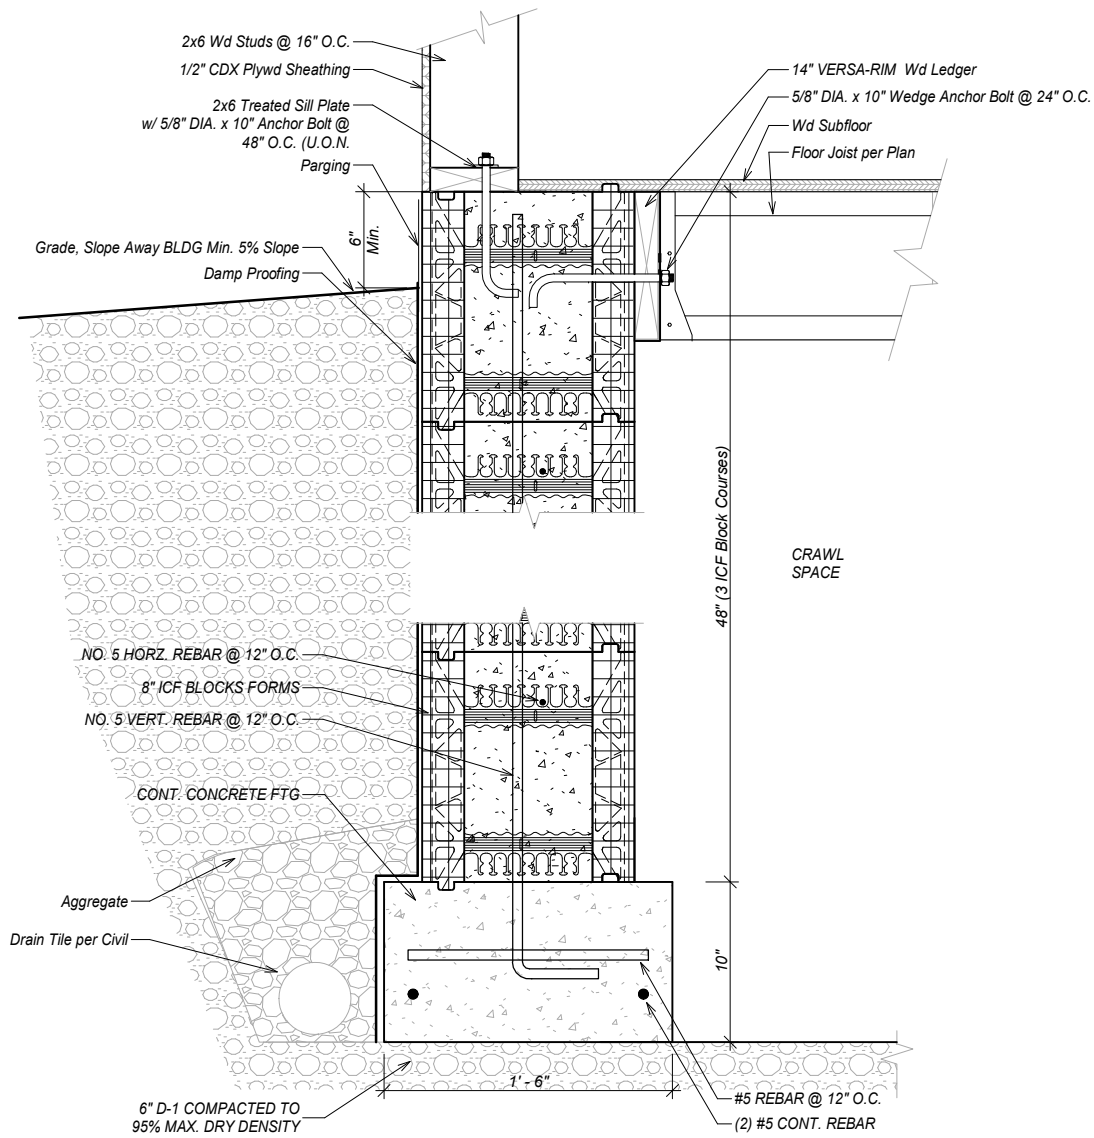

1 Typ. FND Detail
1" = 1'-0"

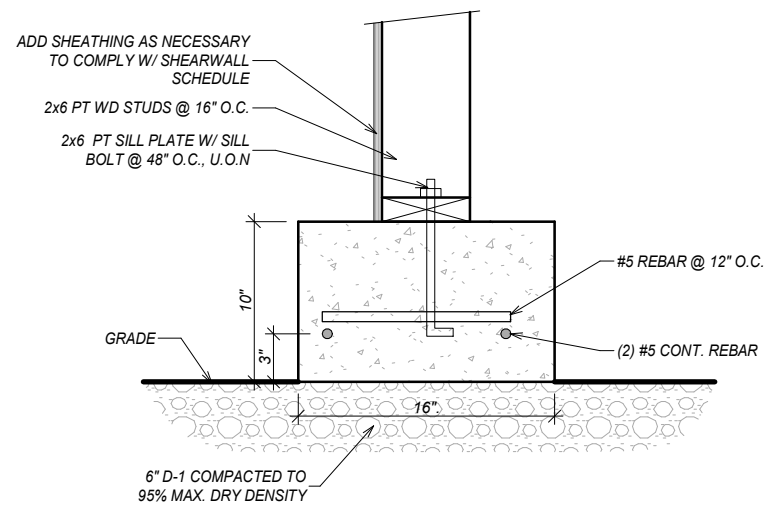

2 Typ. Pony Wall Detail
1" = 1'-0"

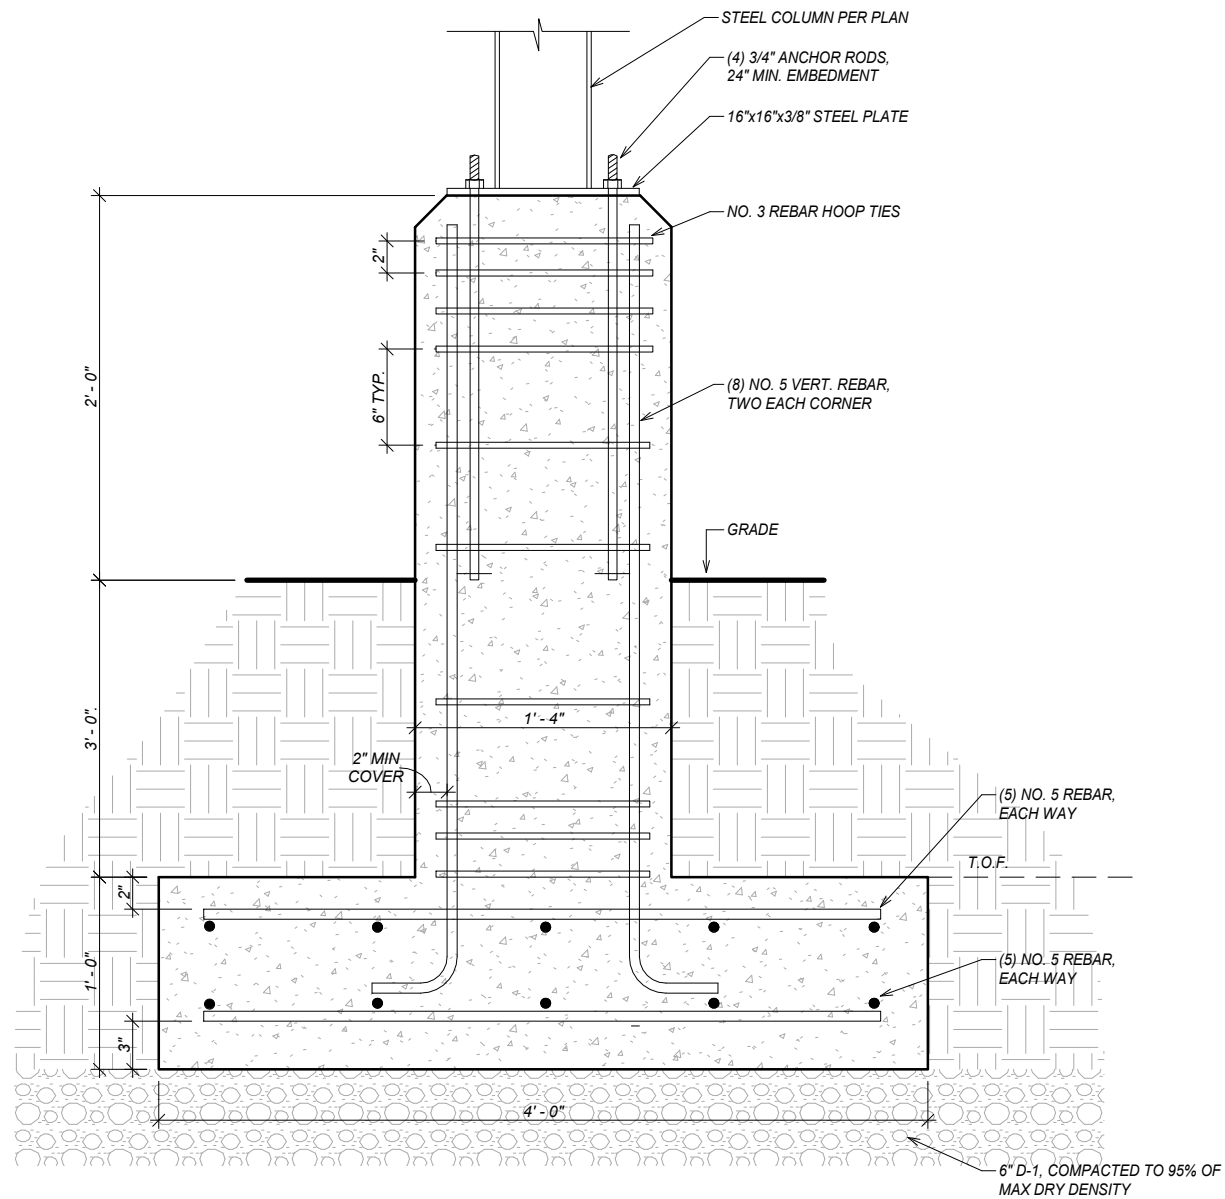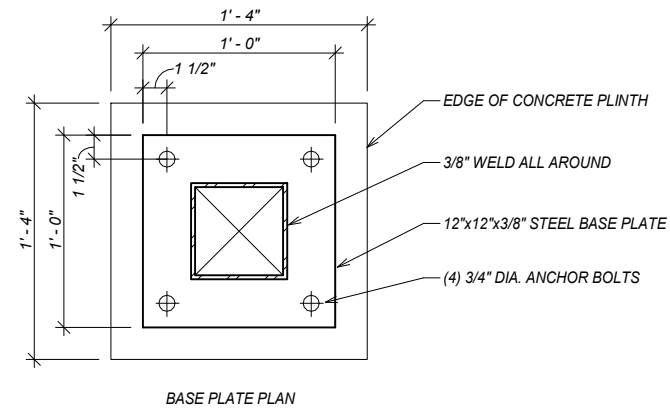

3 Typ. Column Base Detail
1" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: TSS
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com




SHEET DESCRIPTION:

Structural Details

S300

SHEET:


28 of xx

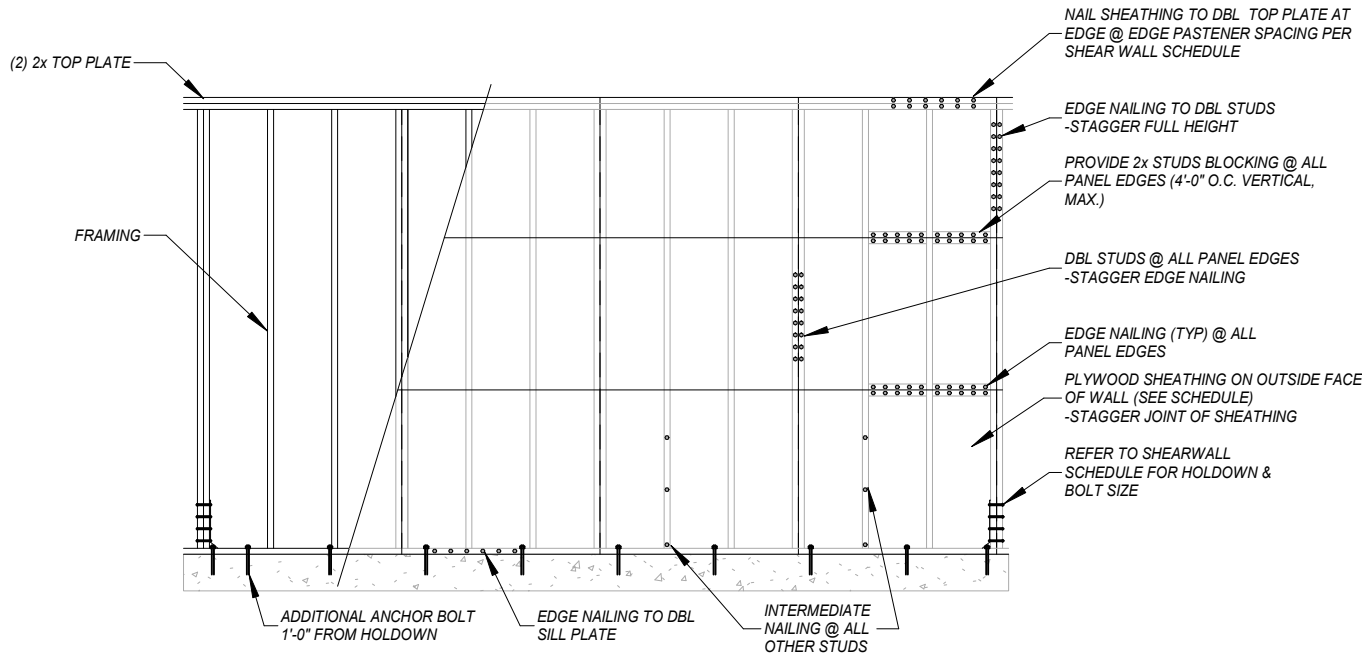

1. EXTERIOR PLYWOOD SHEATHING SHALL BE APA RATED, STRUCTURAL 1.
2. SEE SHEARWALL SCHEDULE FOR FASTENER SPACING REQUIREMENTS.
3. STRUCTURAL PLYWOOD APA RATED SHEATHING PERMITTED TO BE APPLIED EITHER PARALLEL OR PERPENDICULAR TO FRAMING, STAGGER JOINT OF SHEATHING.
4. FACE NAIL DOUBLE STUDS 16d AT 6" O.C. FOR SHEAR TRANSFER BETWEEN PANELS.
5. ANCHOR BOLT FOR SILL PLATE TO BE 5/8" SIMPSON AT MIN. EMBEDMENT 7" AT 2 FOOT CENTERS, ANCHOR BOLTS TO BE SPACED AT 4 FOOT CENTERS AT NON-SHEARWALL LOCATIONS.


1 Shearwall Detail

1/4" = 1'-0"

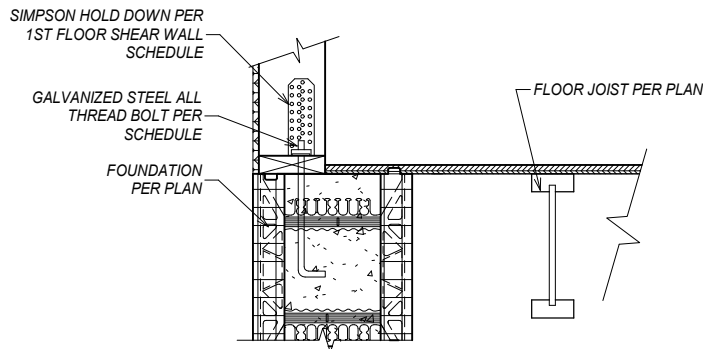

2 Typ. Shearwall Holddown Detail

3/4" = 1'-0"

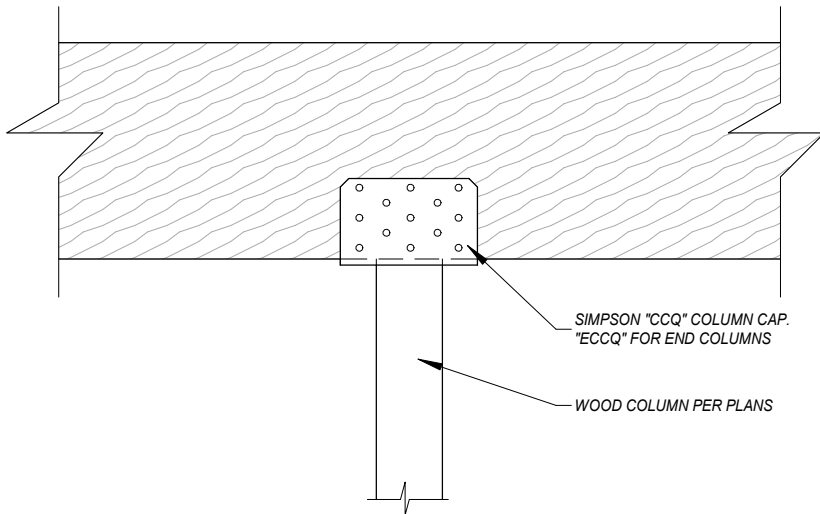

3 Typ. Column to Beam Detail

3/4" = 1'-0"

REVISIONS:

THRHA - Craig Senior Center
PHASE 1

STATUS:

PERMIT
DRAWINGS

DRAWN BY: NMG
CHECKED BY: NMG
DATE: 2.12.24
PROJECT #: 222321.02

R&M
R&M ENGINEERING-KETCHIKAN, INC.
7180 REVILLA ROAD, SUITE 300
KETCHIKAN, ALASKA 99901
PH: 907.225.7917
www.ketchikanengineer.com



SHEET DESCRIPTION:

Structural Details

S301

SHEET:

29 of xx